


GENERATION USE OF SYSTEM TARIFF ZONES AS AT 1 APRIL 2003 (ELECTRICAL)

KEY	
—	400V CIRCUITS
—	275KV CIRCUITS
□	400KV SUBSTATIONS
○	275KV SUBSTATIONS
⊗	CIRCUIT BREAKER
⊘	SWITCH DISCONNECTOR
⊕	QUADRATURE BOOSTER
⊖	REACTOR

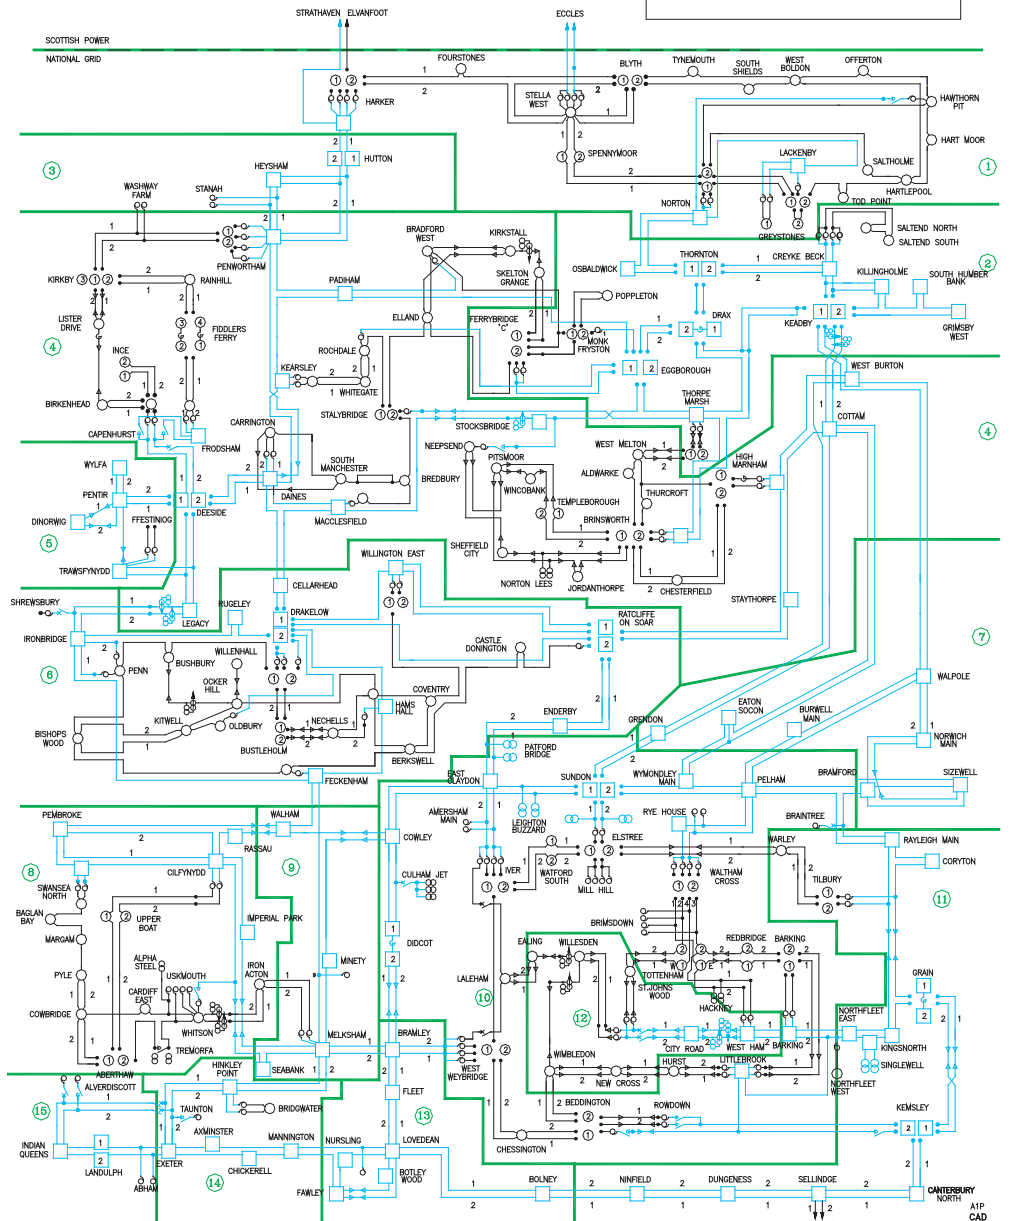

COPYRIGHT - NOT TO BE REPRODUCED WITHOUT THE WRITTEN PERMISSION OF The National Grid Company plc