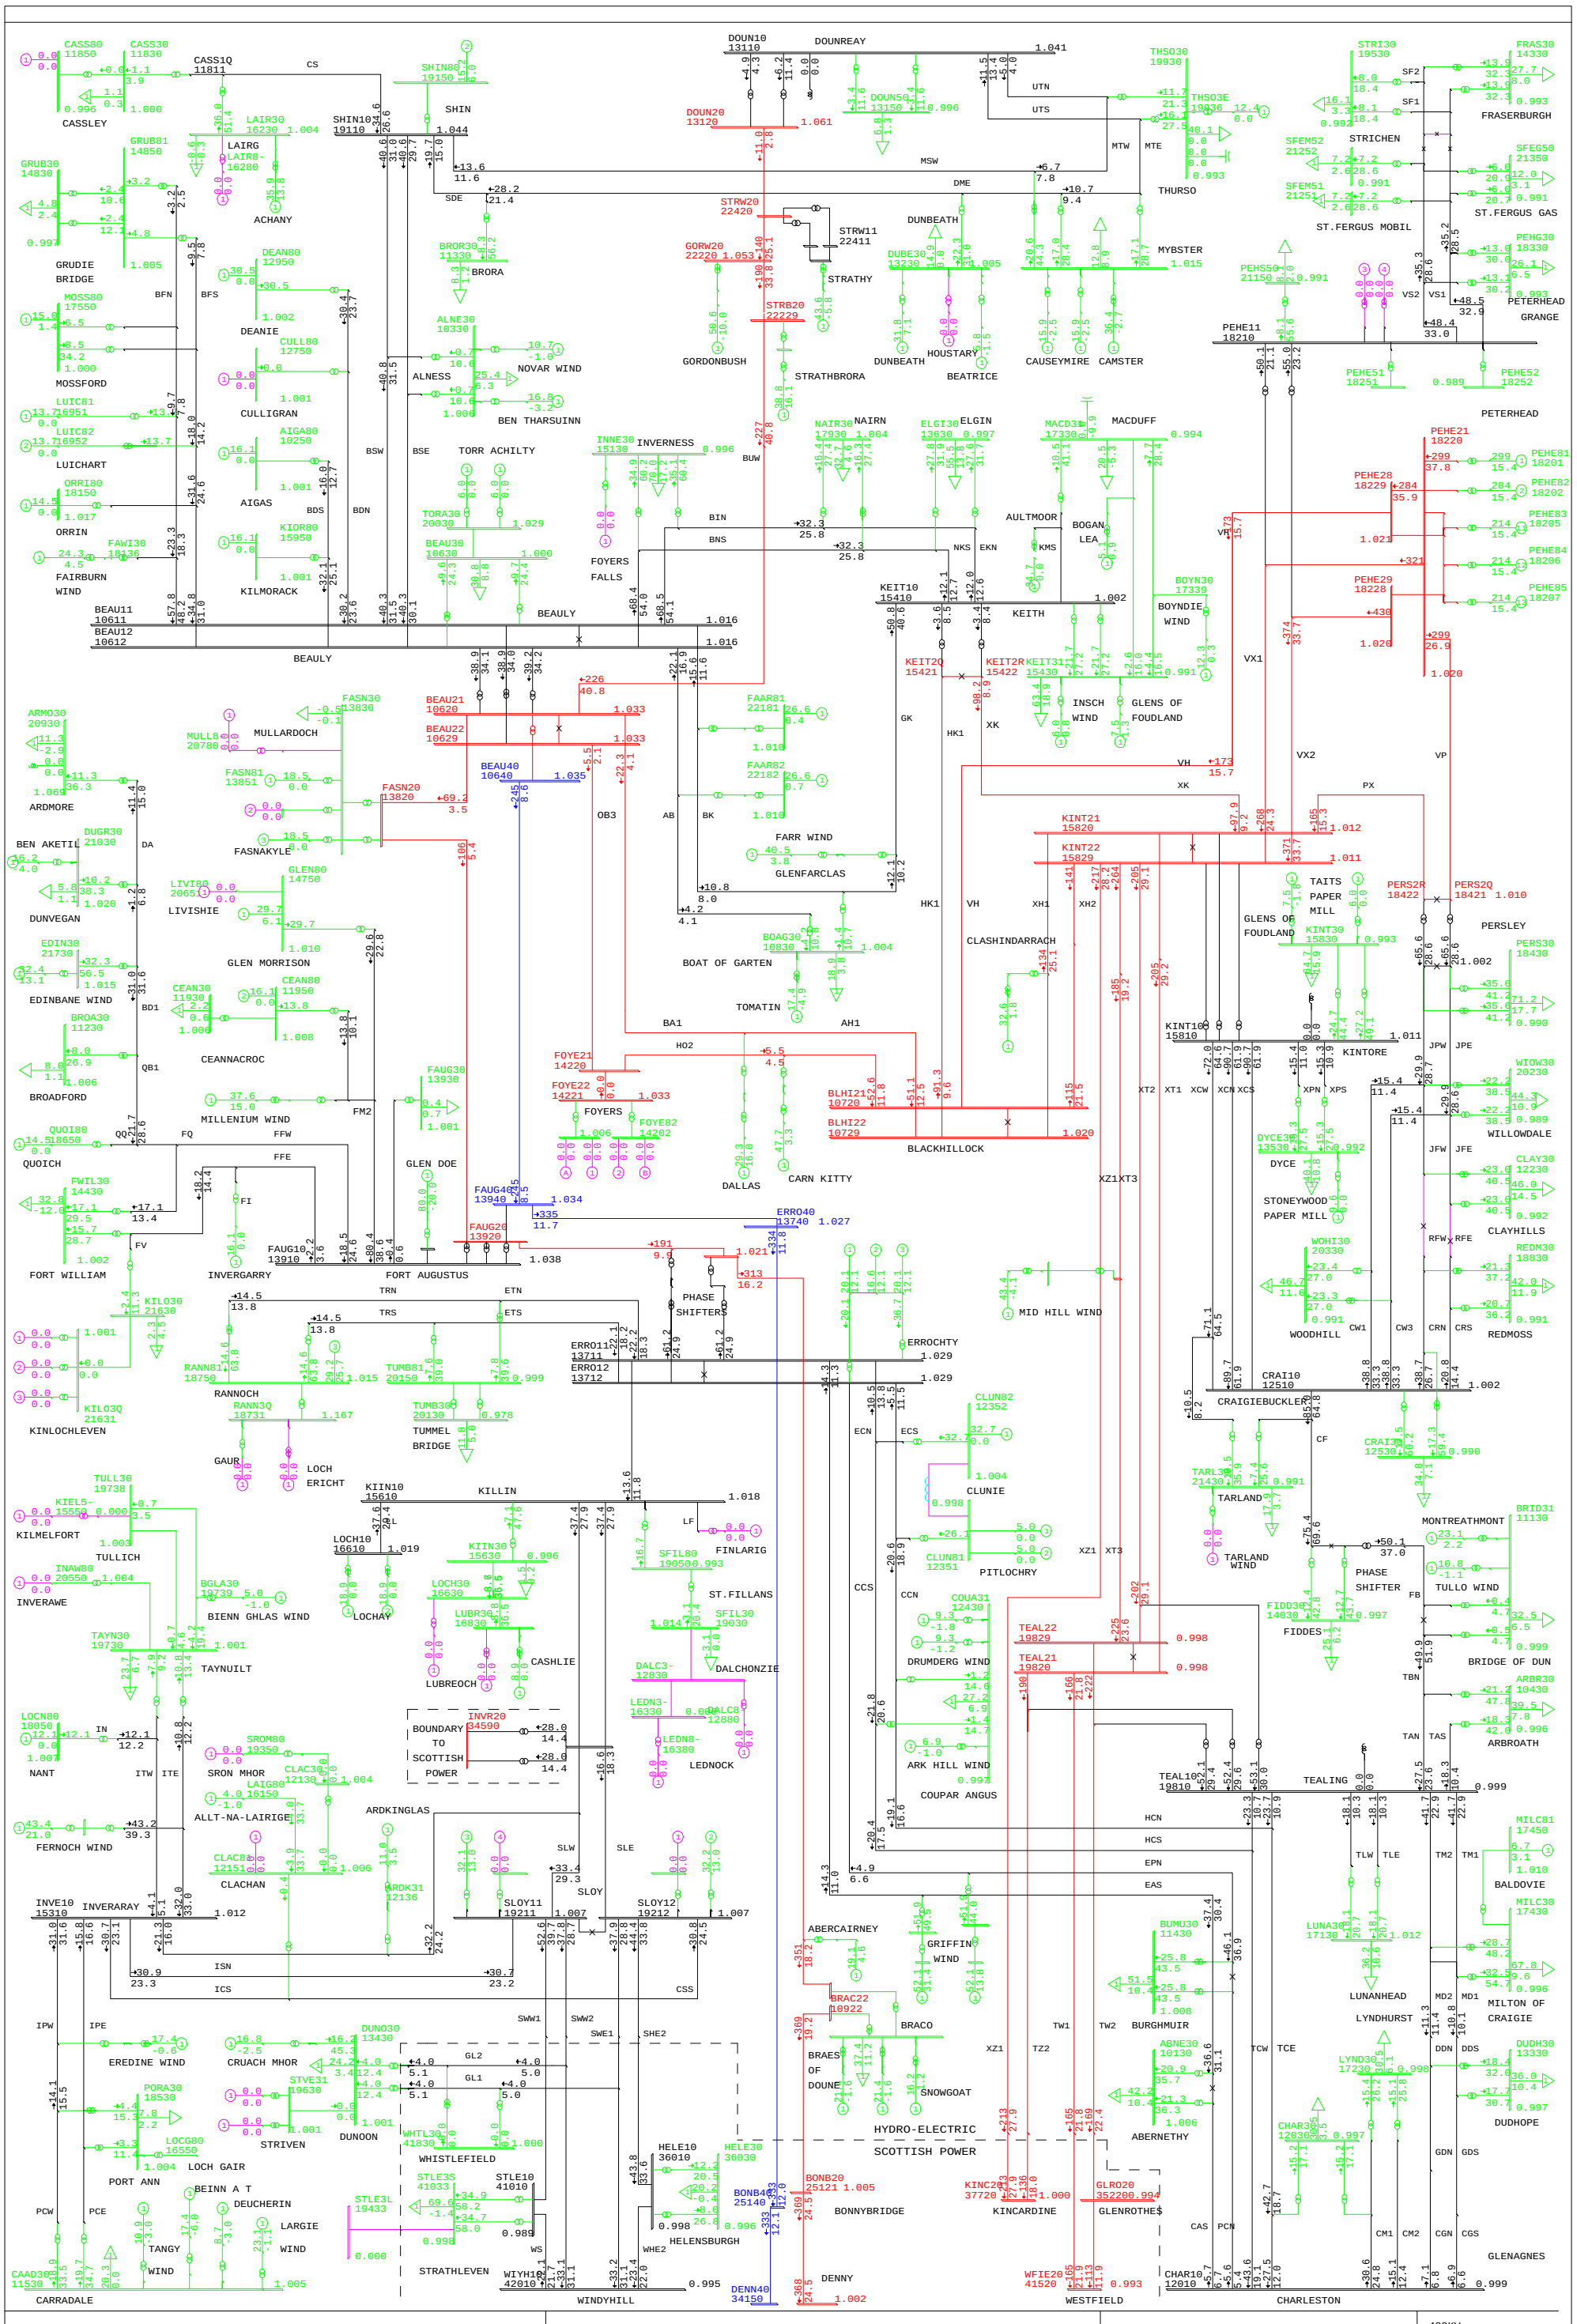

SCOTTISH HYDRO-ELECTRIC TRANSMISSION LTD

SEVEN YEAR STATEMENT 2006

WINTER MAX - YEAR 3 - 2008/09

FIGURE C1-3

400KV
275KV
132KV
<=33KV

SCOTTISH & SOUTHERN ENERGY - SYS06QA-YEAR3-OPFLO DATASET
THIS IS THE GB MODEL CONVERTED FROM OPFL & RASM FILES
THU, APR 27 2006 9:24

200% RATEA
0.700UV 1.3000V
KV:≤100 ,≤230 ,≤330

BUS -VOLTAGE(PU)
BRANCH MW/% OF RATEA
EQUIPMENT MW/MVAR