



THIS MAP IS REPRODUCED FROM ORDNANCE SURVEY MATERIAL BY WSP Group ON BEHALF OF National Grid WITH THE PERMISSION OF THE CONTROLLER OF HER MAJESTY'S STATIONARY OFFICE. ©CROWN COPYRIGHT. UNAUTHORISED REPRODUCTION INFRINGES CROWN COPYRIGHT AND MAY LEAD TO PROSECUTION OR CIVIL PROCEEDINGS LICENCE NUMBER: 100024241

- LEGEND**
- NEW EQUIPMENT
 - - - CONSTRUCTION SITE BOUNDARY
 - PERMANENT SITE BOUNDARY
 - ELECTRICITY CABLE
 - GAS MAIN
 - BT CABLE
 - UNIDENTIFIED TRACE
 - WATER
 - SURFACE WATER
 - OVERHEAD LINE

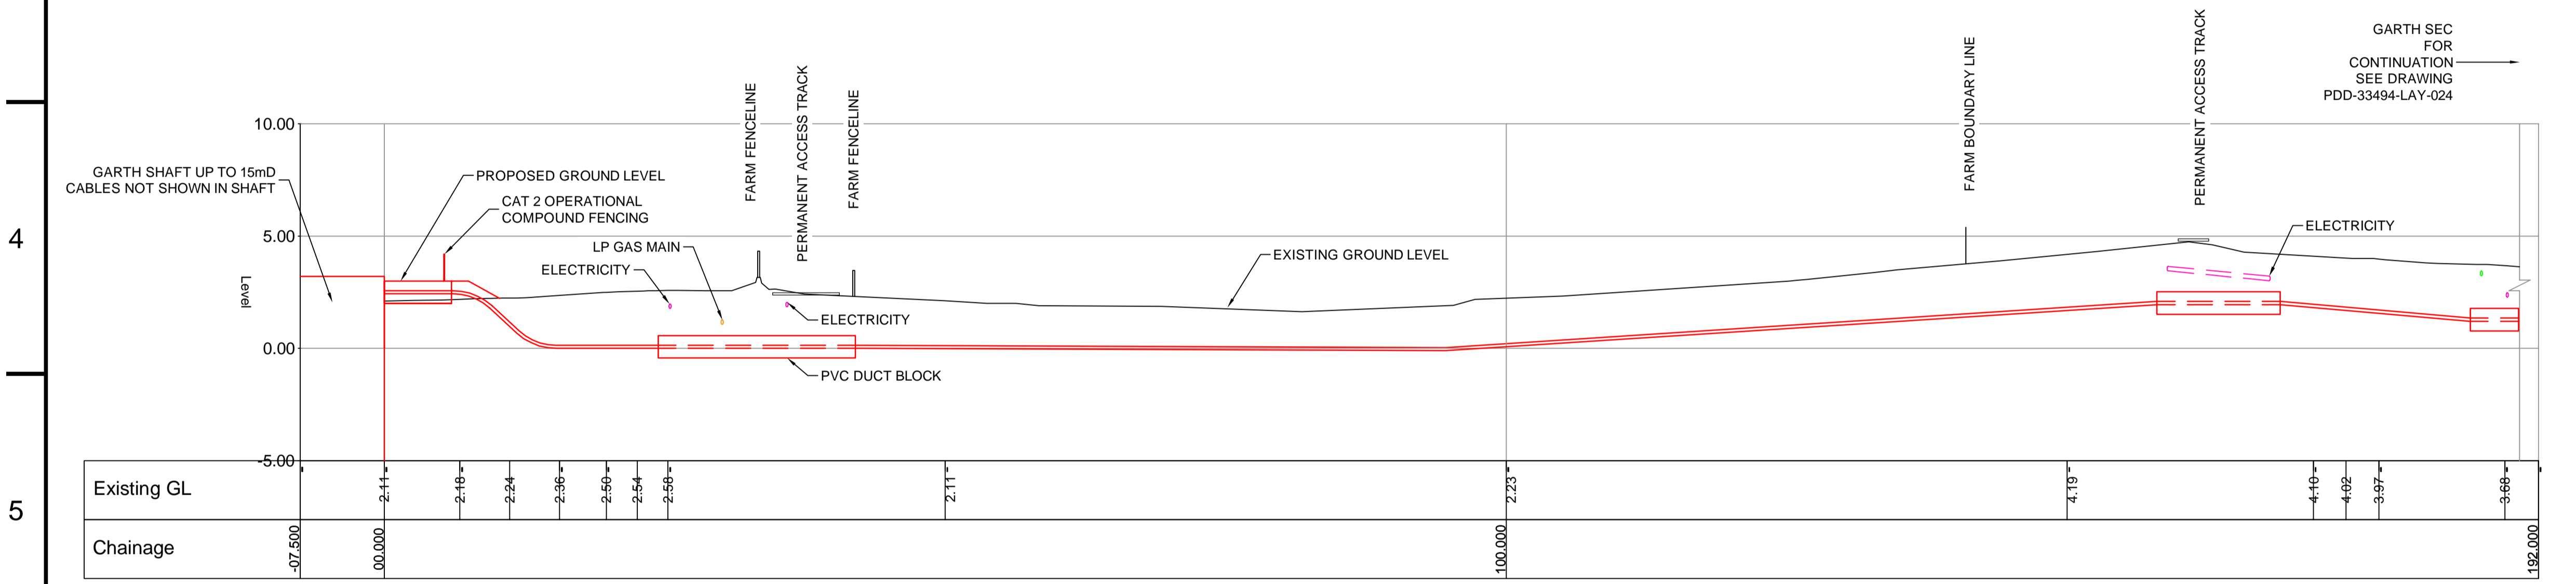

SECTION A - A'
400kV CABLE ELEVATION BETWEEN HEADHOUSE AND SEALING END COMPOUND
CROSSING UTILITIES
LONG SECTION
H: 1:400; V: 1:200

- NOTES:**
- ALL LEVELS ARE IN m ABOVE OD.
 - TO BE READ IN CONJUNCTION WITH DRAWING PDD-33494-LAY-024 AND ALL OTHER RELEVANT PROJECT DRAWINGS.
 - FOR GROUND CONDITIONS REFER TO PROJECT FACTUAL GROUND INVESTIGATION REPORT.
 - DEPTH OF SERVICES TO BE CONFIRMED BY CONTRACTOR ON SITE. ALL DIMENSIONS ARE INDICATIVE AND NOT TO BE RELIED UPON.

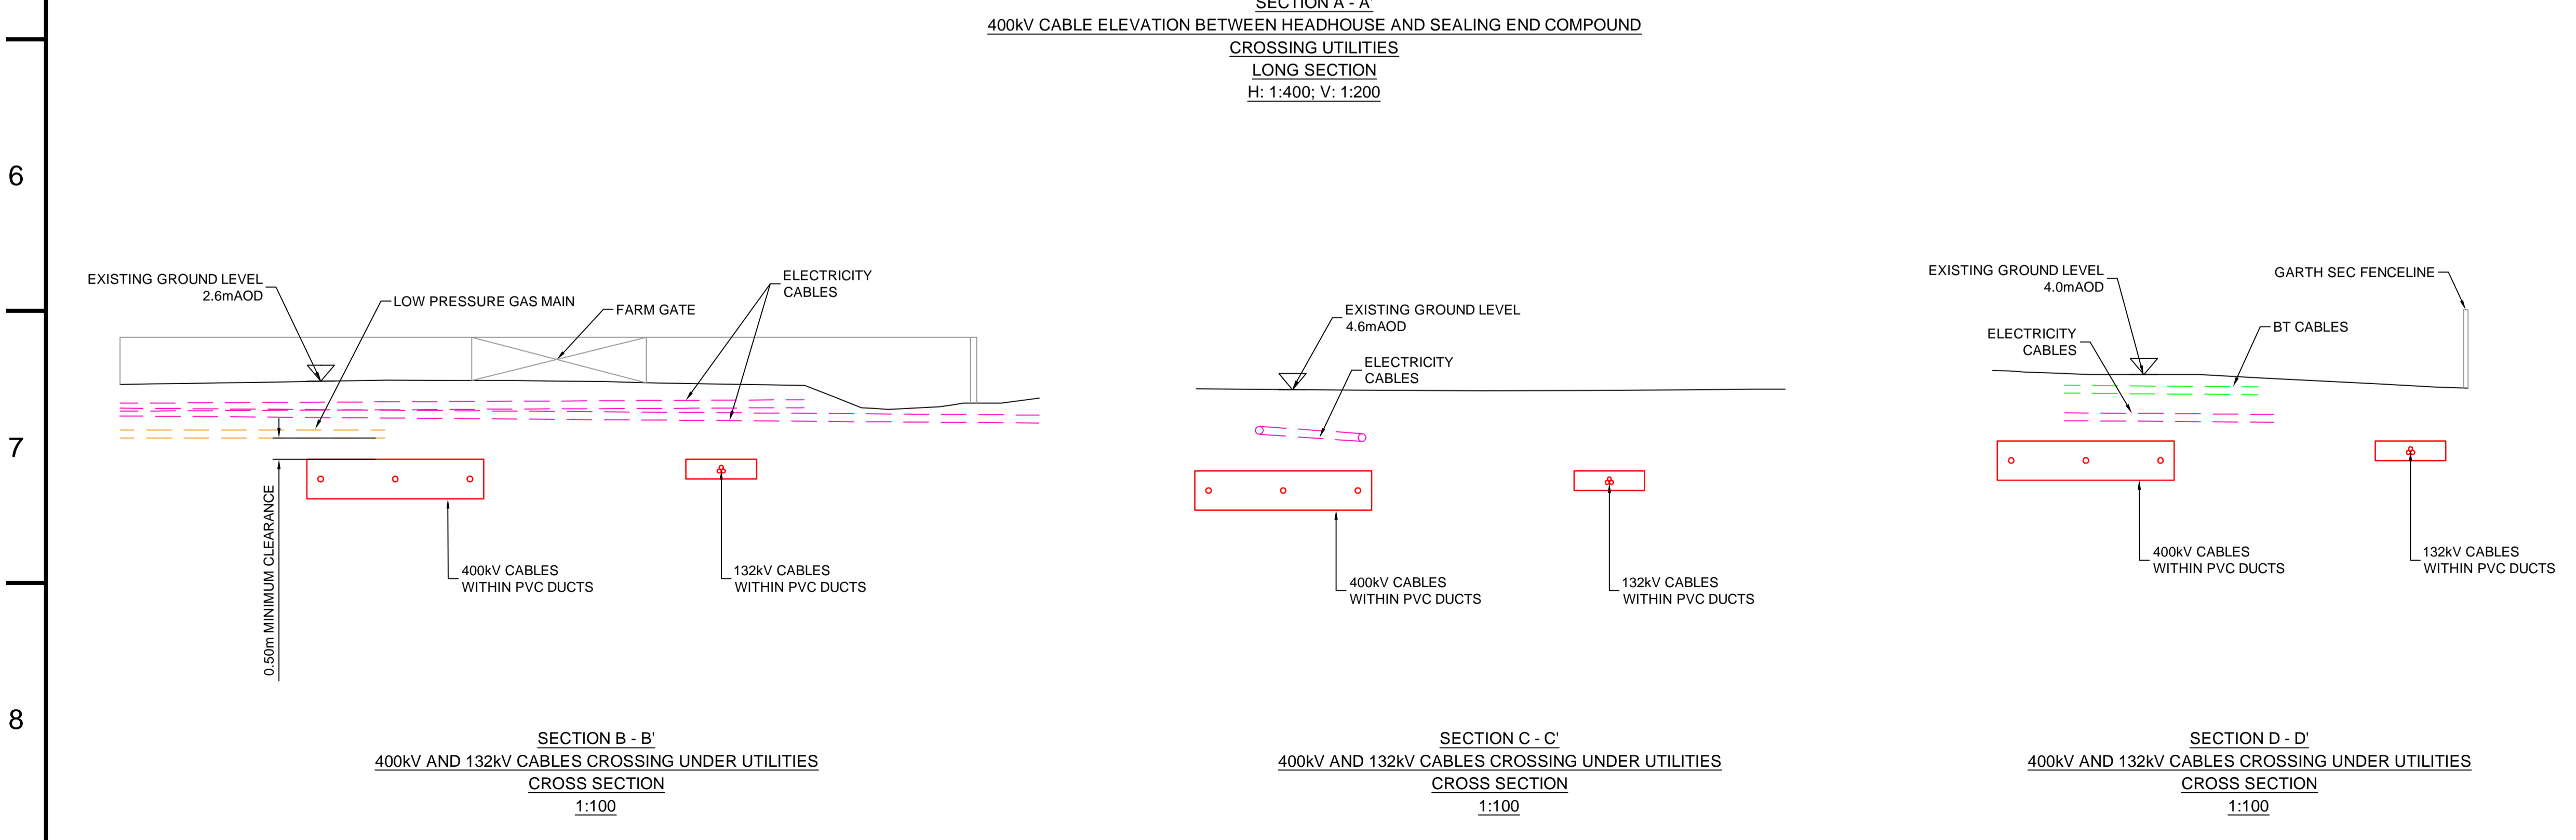

SECTION B - B'
400kV AND 132kV CABLES CROSSING UNDER UTILITIES
CROSS SECTION
1:100

SECTION C - C'
400kV AND 132kV CABLES CROSSING UNDER UTILITIES
CROSS SECTION
1:100

SECTION D - D'
400kV AND 132kV CABLES CROSSING UNDER UTILITIES
CROSS SECTION
1:100

P01	ISSUE FOR TENDER	CM	VB	MR	09.07.19
Rev	Description	Cre'd	Chk'd	App'd	Date



Master Scheme No: 33494	Sub-Scheme No:	Site: PROJECT WIDE
Scheme Name: SNOWDONIA VIP		

Document Title: Figure 2.4: PROPOSED GARTH SEALING END COMPOUND CABLE CIRCUIT ELEVATIONS					
Created by: CM	Date: 05/07/19	Checked by: VB	Date: 05/07/19	Approved by: MR	Date: 05/07/19
Development Eng: JB	Document Type: LAY	Scale: AS SHOWN	Format: A1	Sheet(s): 1 OF 1	Rev: P01

National Grid Document Number:
PDD-33494-LAY-027
FEED Document Number: