

The Great Grid Upgrade

Sea Link

General Arrangement Plans

Version A

October 2023

To assist with understanding these plans please see the **Guide to Interacting with the Consultation Plans and Drawings**

nationalgrid


Contents

Section	Scheme	Plan Type/ Drawing Numbers
01	Sea Link	Overall Location Plan: S42_T/OLP/SS/3001
02	Suffolk Onshore Scheme	Location Plan: S42_S/OLP/SS/0001 Key Plan: S42_S/MKP/SS/0001 General Arrangement Plans: S42_S/IGA/PS/0001 S42_S/IGA/PS/0002 S42_S/IGA/PS/0003 S42_S/IGA/PS/0004 S42_S/IGA/PS/0005 S42_S/IGA/PS/0006 S42_S/IGA/PS/0007
03	Suffolk Onshore Scheme – Converter colocation	General Arrangement Plan – Colocation: S42_S/IGA/SS/0008
04	Kent Onshore Scheme	Location Plan: S42_K/OLP/SS/2001 Key Plan: S42_K/MKP/SS/2001 General Arrangement Plans: S42_K/IGA/PS/2001 S42_K/IGA/PS/2002 S42_K/IGA/PS/2003 S42_K/IGA/PS/2004
05	Offshore Scheme	Key Plan: S42_M/MKP/SS/1001 General Arrangement Plans: S42_M/IGA/PS/1001 S42_M/IGA/PS/1002 S42_M/IGA/PS/1003

01. Overall Location Plan

Section	Scheme	Plan Type/ Drawing Numbers
01	Sea Link	Overall Location Plan: S42_T/OLP/SS/3001



To assist with understanding these plans please see the **Guide to Interacting with the Consultation Plans and Drawings**

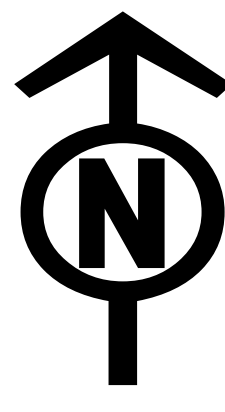

THE NATIONAL GRID ELECTRICITY TRANSMISSION PLC (SEA LINK) ORDER
OVERALL LOCATION PLAN FOR CONSULTATION

SHEET 1 OF 1

SUFFOLK COUNTY COUNCIL, EAST SUFFOLK DISTRICT COUNCIL, KENT COUNTY COUNCIL, DOVER DISTRICT COUNCIL, THANET DISTRICT COUNCIL

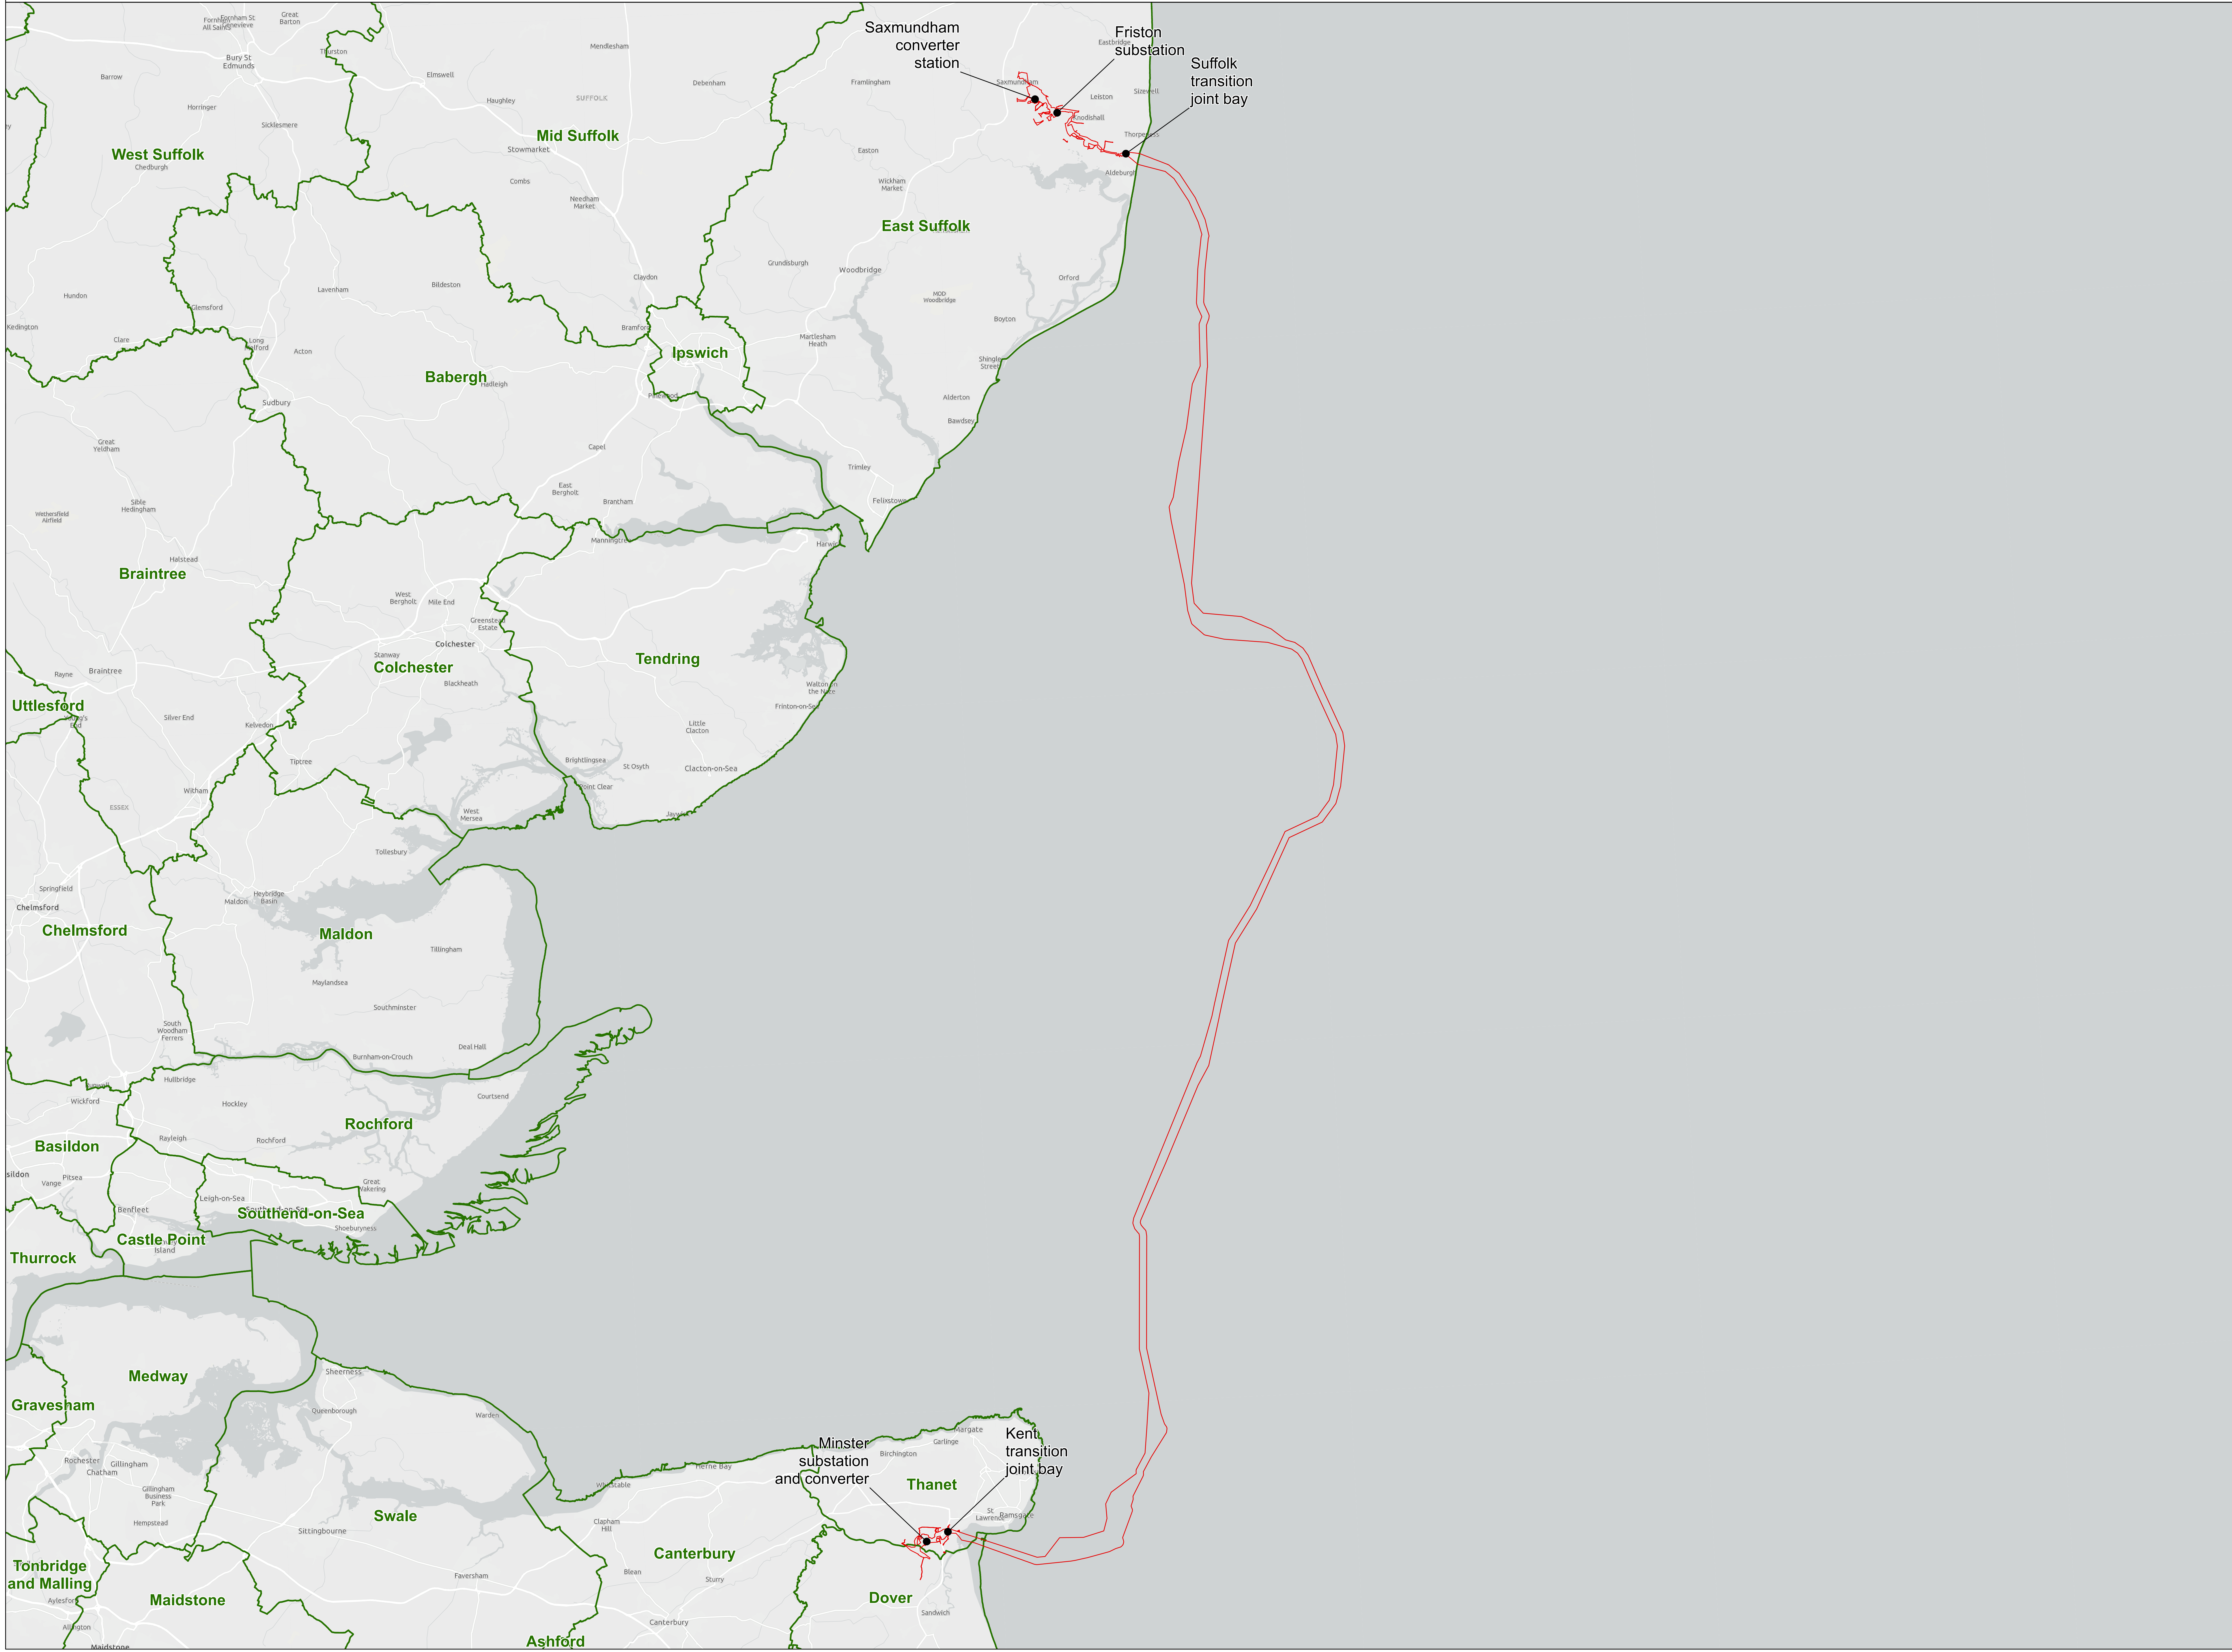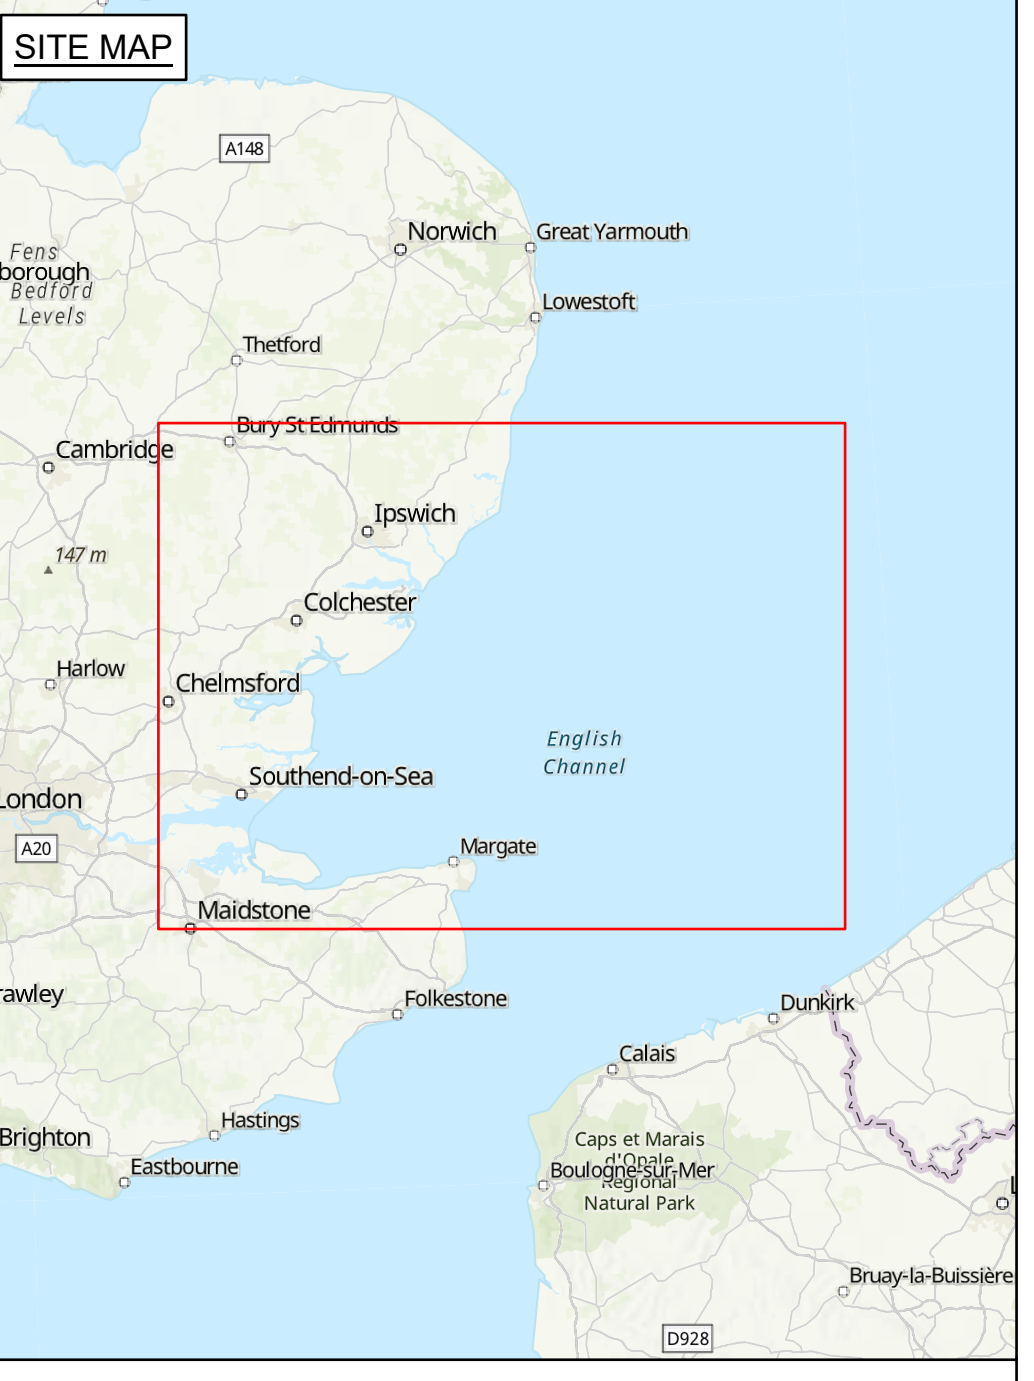

Legend

- Draft Order Limits
- District Council boundary

Notes
For statutory consultation purposes only.

- This plan is scaled at paper size A0, therefore any prints taken at smaller sizes will affect accuracy of the measurement units and should not be scaled against.
- These plans show the Draft Order Limits and cable alignment and potential pylon locations. Due to the need for future flexibility, National Grid will be applying for Order Limits and Limits of Deviation within its Development Consent Order, within which any final alignment (including pylon locations) would lie. Therefore the cable alignment and pylon locations should be treated as indicative only. Further information is provided in our 'Guide to interacting with our consultation plans' document.
- For further information on construction please refer to the construction section of the Preliminary Environmental Impact Report, Volume 1, Part 1, Chapter 4.

Coordinate System: British National Grid
 Sheet X Centroid Coordinate: NA Sheet Y Centroid Coordinate: NA



BACKGROUND MAPPING INFORMATION HAS BEEN REPRODUCED FROM THE ORDNANCE SURVEY BY PERMISSION OF ORDNANCE SURVEY OF THE CONTROLLER OF HIS MAJESTY'S STATIONERY OFFICE. CROWN COPYRIGHT ORDNANCE SURVEY © 100024241. BLUESKY INTERNATIONAL LTD © NATIONAL GRID ELECTRICITY. ESRI COMMUNITY MAPS CONTRIBUTORS, ESRI UK, ESRI, HERE, GARMIN, FOUR SQUARE, GEOTECHNOLOGIES, INC, METINFUSA, USGS

Issue	Date	Remarks	Drawn	Checked	Approved
A	29/08/23	Final	JF	SC	KJ

Title

THE NATIONAL GRID ELECTRICITY TRANSMISSION PLC (SEA LINK) ORDER
 OVERALL LOCATION PLAN FOR CONSULTATION
 SHEET 1 OF 1

nationalgrid

Application Number: EN020026


National Grid Drawing Reference: S42_T/OLP/SS/3001

Scale	Sheet Size	Sheet	Issue
1:150,000	A0	SHEET 1 OF 1	A



02. Suffolk Onshore Scheme

Section	Scheme	Plan Type/ Drawing Numbers
02	Suffolk Onshore Scheme	Location Plan: S42_S/OLP/SS/0001 Key Plan: S42_S/MKP/SS/0001 General Arrangement Plans: S42_S/IGA/PS/0001 S42_S/IGA/PS/0002 S42_S/IGA/PS/0003 S42_S/IGA/PS/0004 S42_S/IGA/PS/0005 S42_S/IGA/PS/0006 S42_S/IGA/PS/0007

To assist with understanding these plans please see the **Guide to Interacting with the Consultation Plans and Drawings**

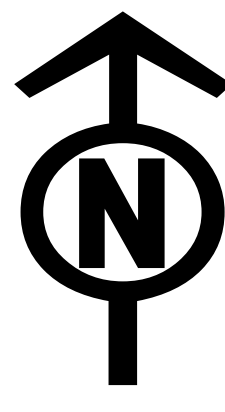

THE NATIONAL GRID ELECTRICITY TRANSMISSION PLC (SEA LINK) ORDER
 LOCATION PLAN FOR CONSULTATION
 SHEET 1 OF 1
 SUFFOLK
 SUFFOLK COUNTY COUNCIL, EAST SUFFOLK DISTRICT COUNCIL

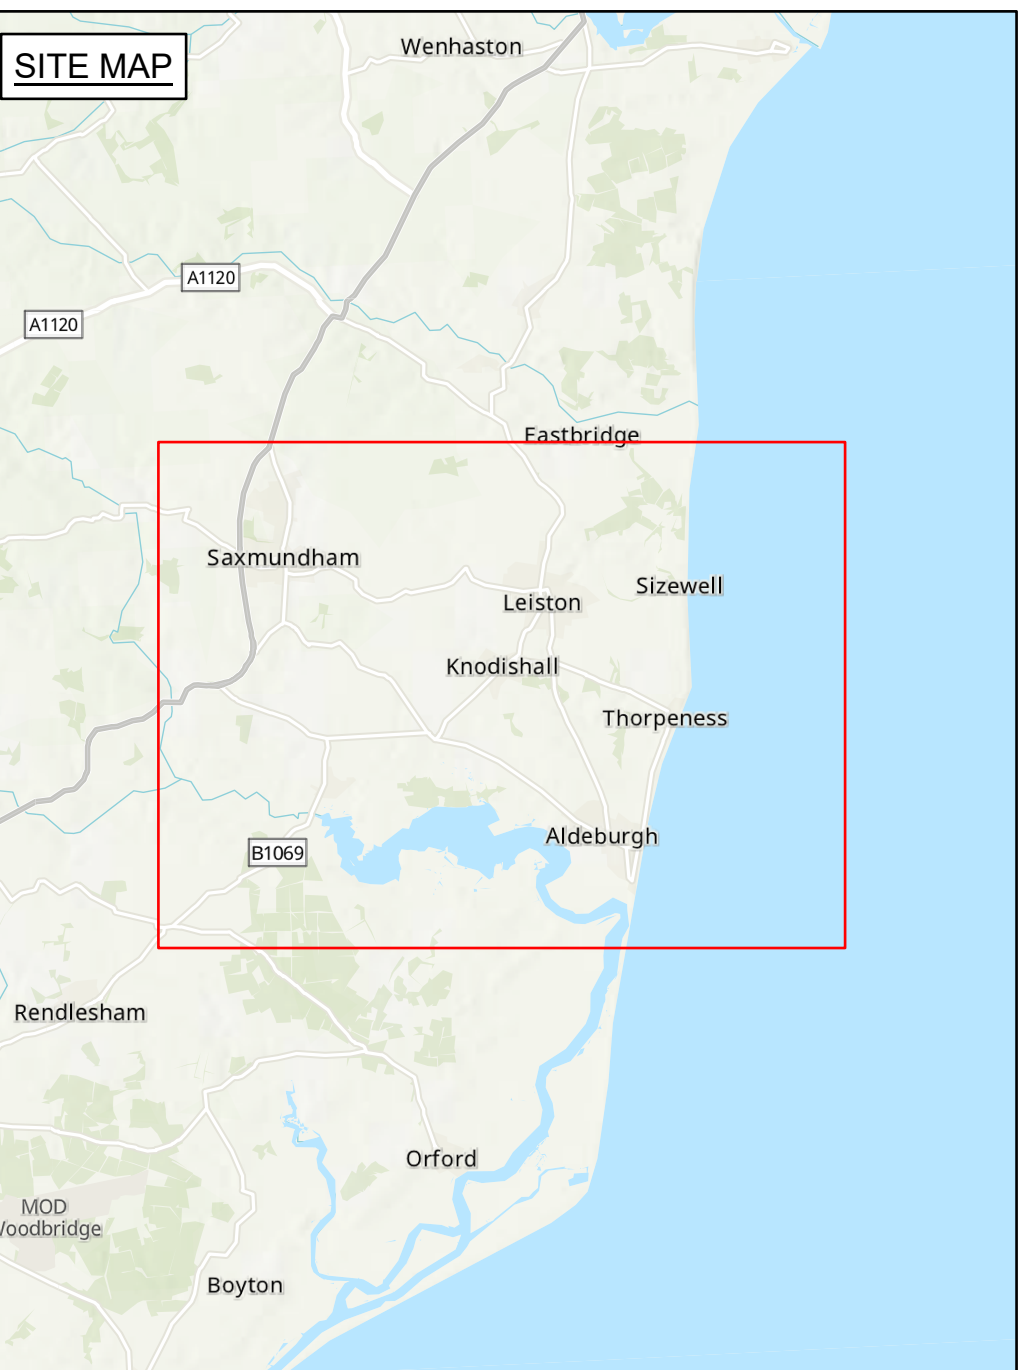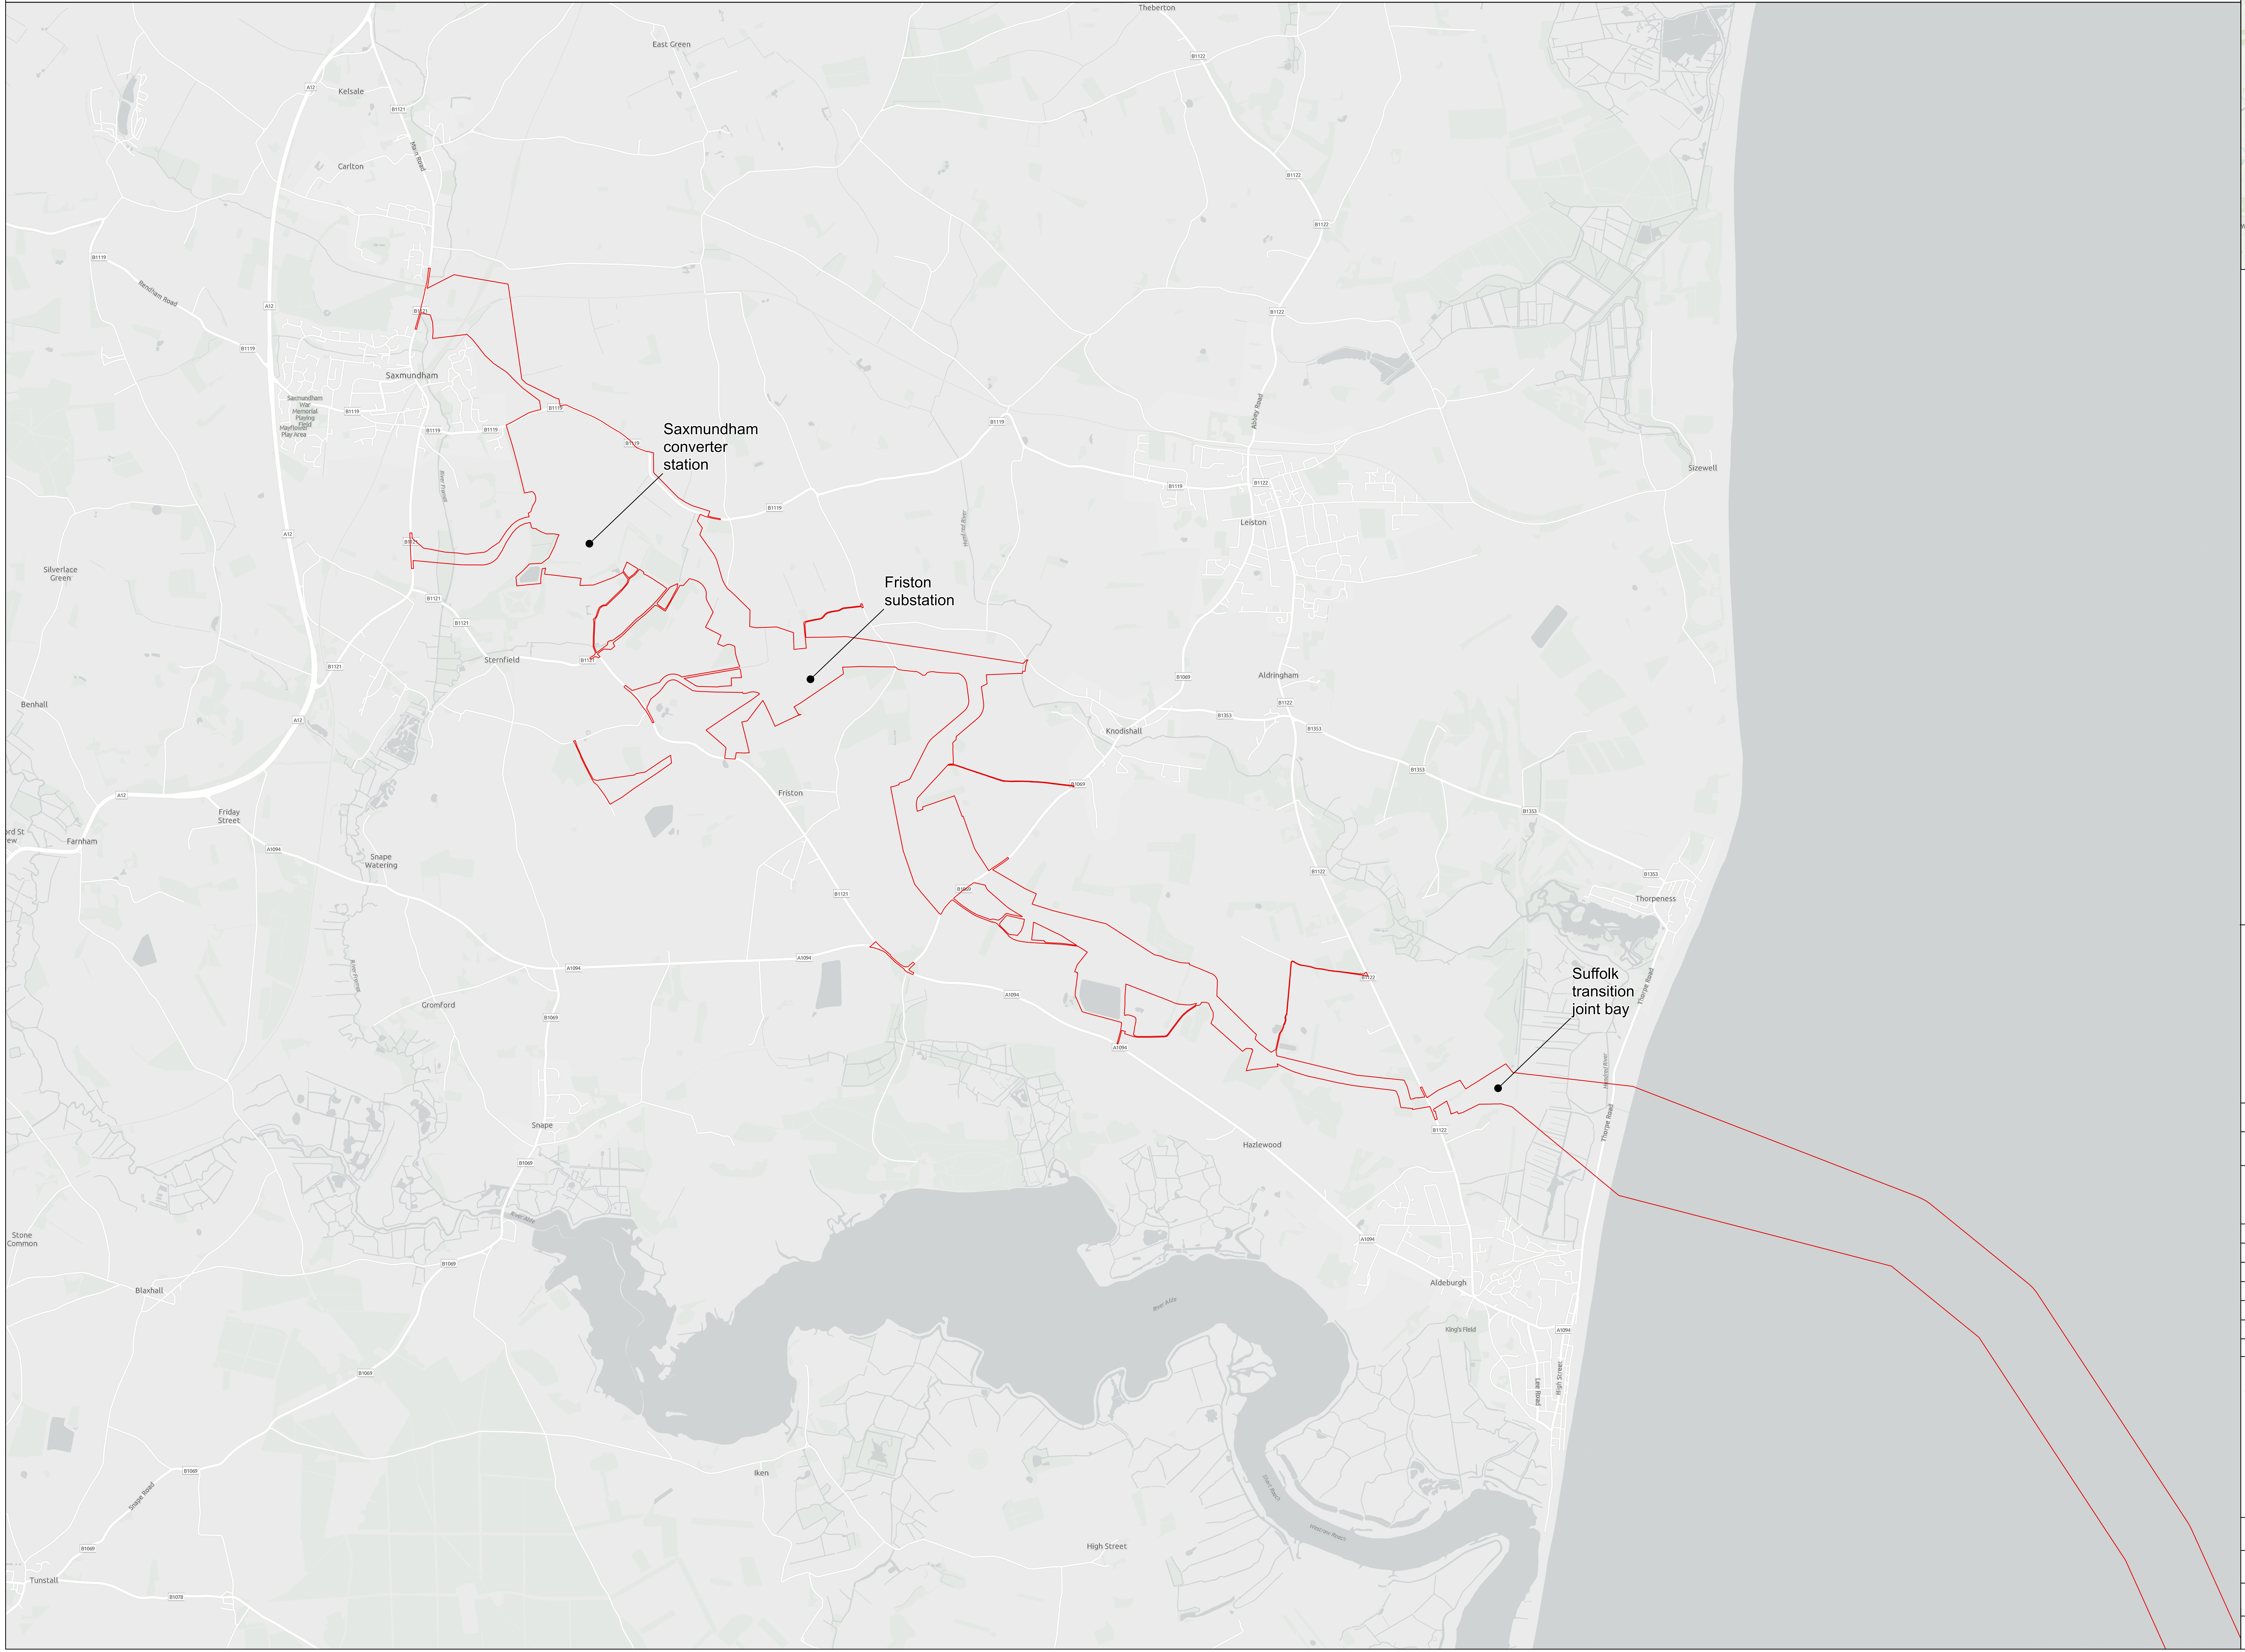

Legend
 Draft Order Limits

Notes
For statutory consultation purposes only.
 1. This plan is scaled at paper size A0, therefore any prints taken at smaller sizes will affect accuracy of the measurement units and should not be scaled against.
 2. These plans show the Draft Order Limits and cable alignment and potential pylon locations. Due to the need for future flexibility, National Grid will be applying for Order Limits and Limits of Deviation within its Development Consent Order, within which any final alignment (including pylon locations) would lie. Therefore the cable alignment and pylon locations should be treated as indicative only. Further information is provided in our 'Guide to interacting with our consultation plans' document.
 3. For further information on construction please refer to the construction section of the Preliminary Environmental Impact Report, Volume 1, Part 1, Chapter 4.

Coordinate System: British National Grid
 Sheet X Centroid Coordinate: NA
 Sheet Y Centroid Coordinate: NA




BACKGROUND MAPPING INFORMATION HAS BEEN REPRODUCED FROM THE ORDNANCE SURVEY BY PERMISSION OF ORDNANCE SURVEY OF THE CONTROLLER OF HIS MAJESTY'S STATIONERY OFFICE. CROWN COPYRIGHT ORDNANCE SURVEY © - 100024241. BLUESKY INTERNATIONAL LTD © NATIONAL GRID ELECTRICITY. ESRI COMMUNITY MAPS CONTRIBUTORS, ESRI UK, ESRI, HERE, GARMIN, COURTSQUARE, GEOTECHNOLOGIES, INC, METUNISA, USGS

Issue	Date	Remarks	Drawn	Checked	Approved
A	29/08/23	Final	JF	SC	KJ



THE NATIONAL GRID ELECTRICITY TRANSMISSION PLC
 (SEA LINK) ORDER
 LOCATION PLAN FOR CONSULTATION
 SHEET 1 OF 1
 SUFFOLK

nationalgrid

Application Number: EN020026
 National Grid Drawing Reference: S42_S/OLP/SS/0001
 Scale: 1:15,000
 Sheet Size: A0
 Sheet: SHEET 1 OF 1
 Issue: A

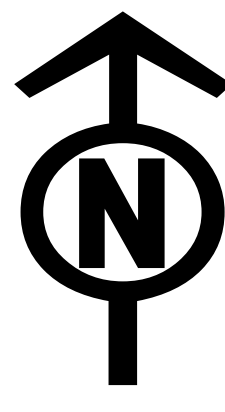

THE NATIONAL GRID ELECTRICITY TRANSMISSION PLC (SEA LINK) ORDER
 MASTER KEY PLAN FOR CONSULTATION
 SHEET 1 OF 1
 SUFFOLK
 SUFFOLK COUNTY COUNCIL, EAST SUFFOLK DISTRICT COUNCIL

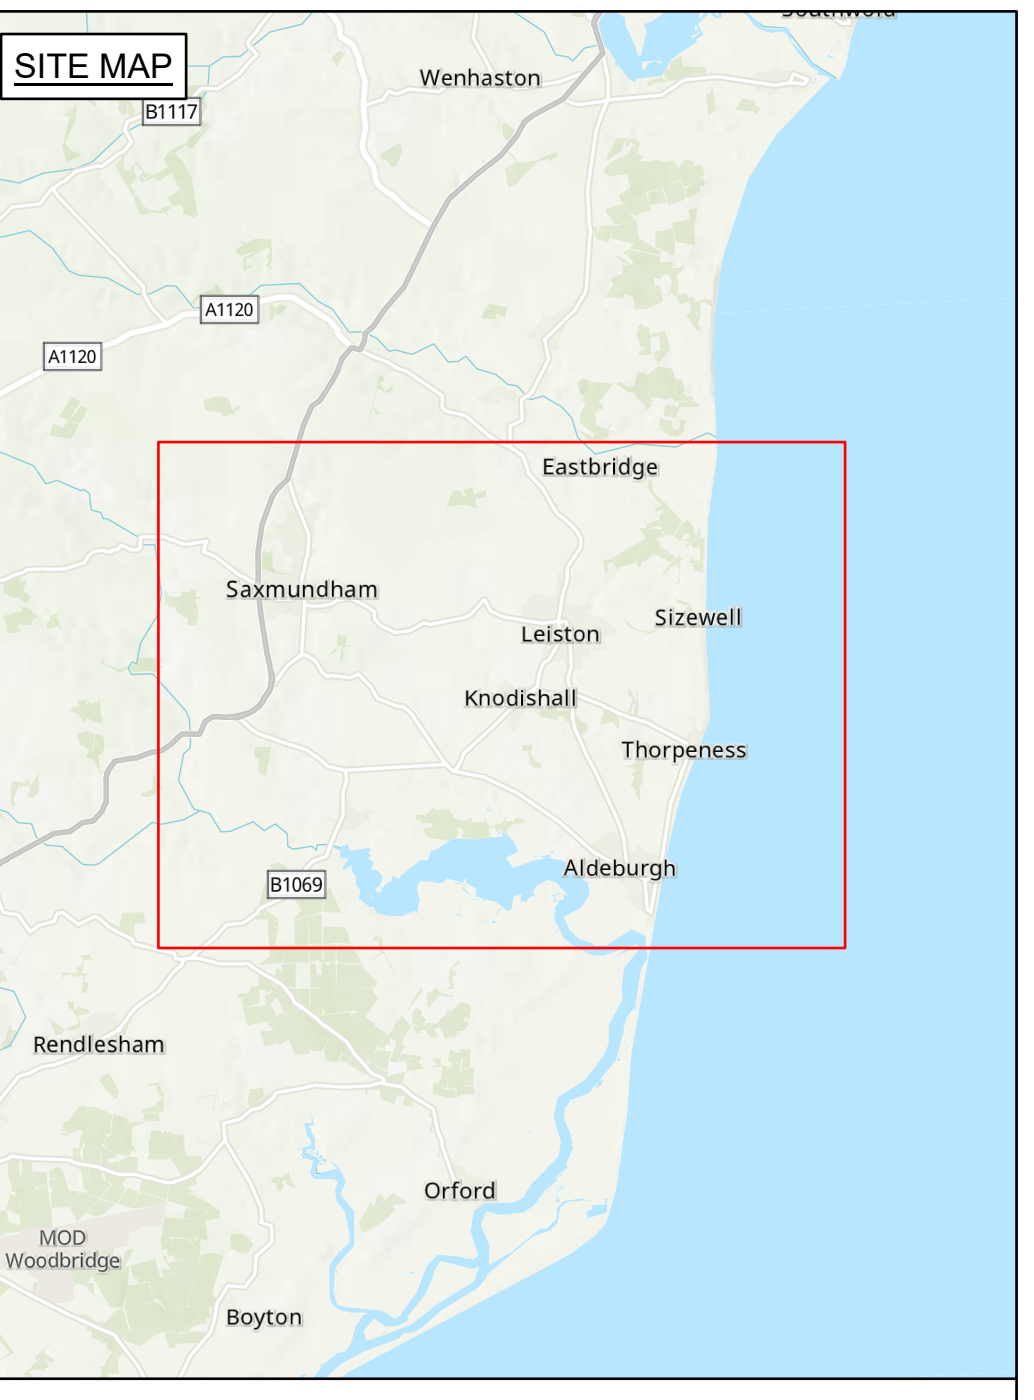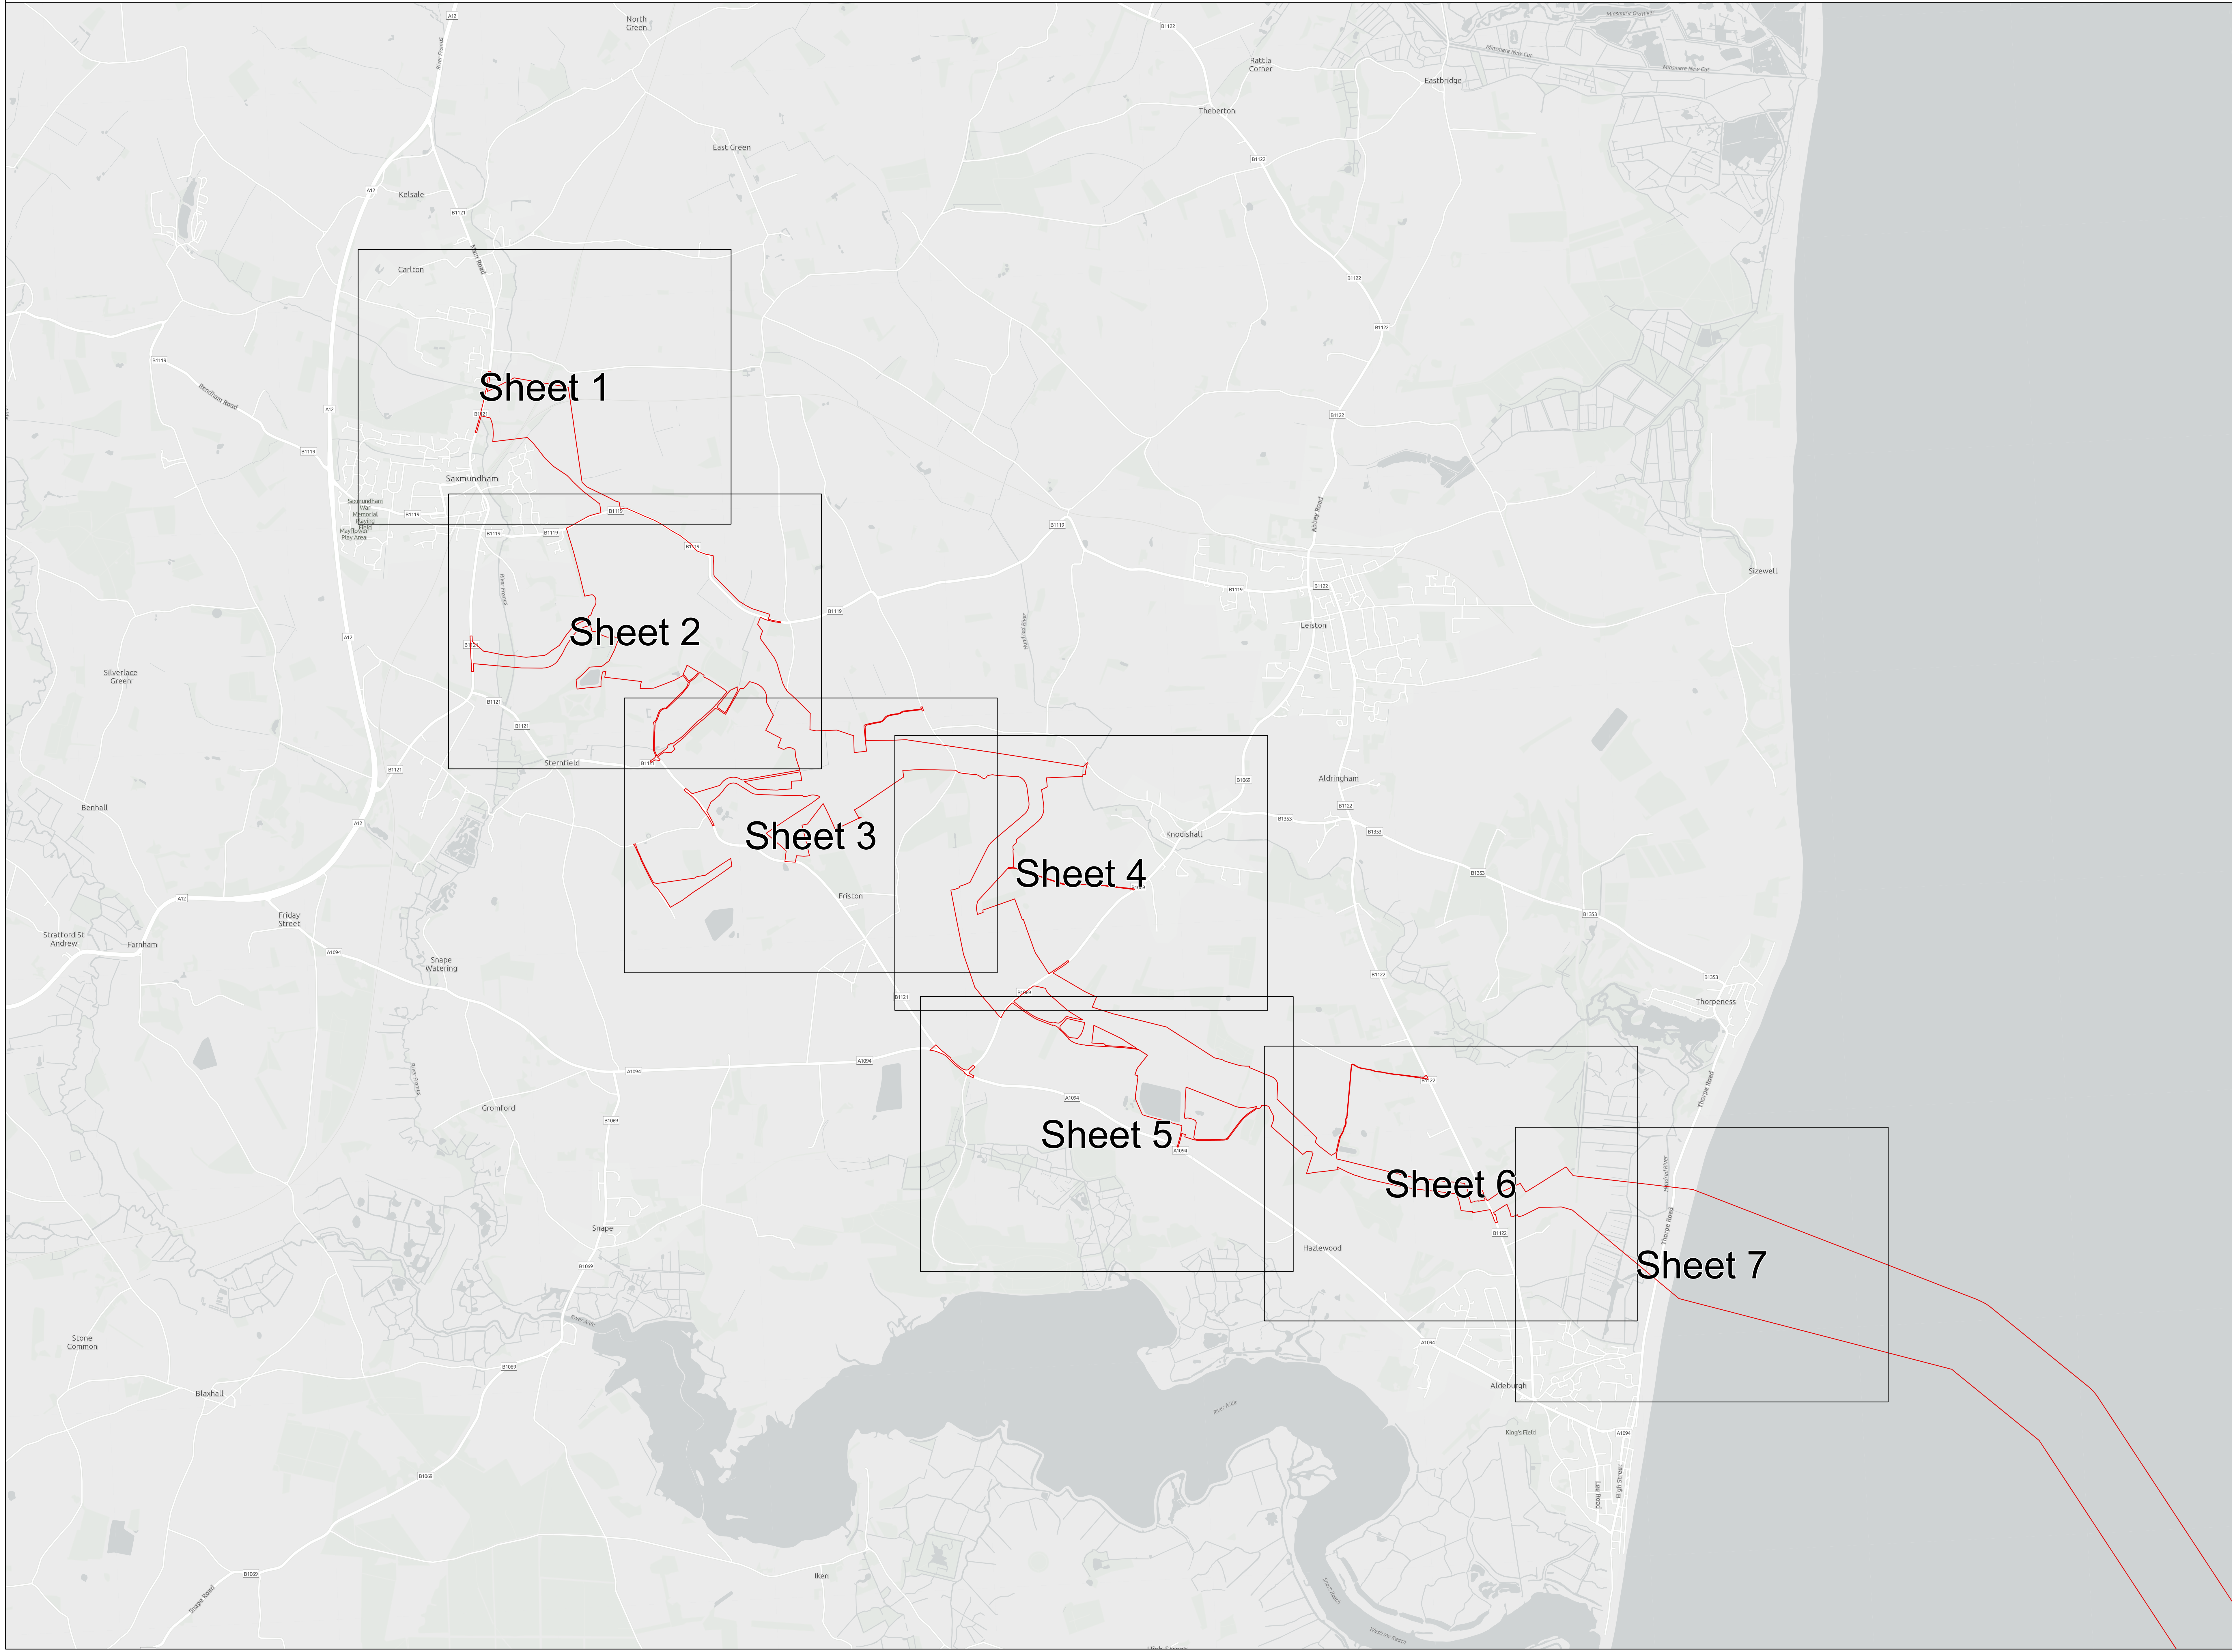

Legend

□ Draft Order Limits
 □ Detailed sheet

Notes
For statutory consultation purposes only.

1. This plan is scaled at paper size A0, therefore any prints taken at smaller sizes will affect accuracy of the measurement units and should not be scaled against.
2. These plans show the Draft Order Limits and cable alignment and potential pylon locations. Due to the need for future flexibility, National Grid will be applying for Order Limits and Limits of Deviation within its Development Consent Order, within which any final alignment (including pylon locations) would lie. Therefore the cable alignment and pylon locations should be treated as indicative only. Further information is provided in our 'Guide to interacting with our consultation plans' document.
3. For further information on construction please refer to the construction section of the Preliminary Environmental Impact Report, Volume 1, Part 1, Chapter 4.

Coordinate System: British National Grid
 Sheet X Centroid Coordinate: NA
 Sheet Y Centroid Coordinate: NA




BACKGROUND MAPPING INFORMATION HAS BEEN REPRODUCED FROM THE ORDNANCE SURVEY BY PERMISSION OF ORDNANCE SURVEY OF THE CONTROLLER OF HIS MAJESTY'S STATIONERY OFFICE. CROWN COPYRIGHT ORDNANCE SURVEY © - 100024241. BLUEWAY INTERNATIONAL LTD ©, NATIONAL GRID ELECTRICITY, ESRI COMMUNITY MAPS CONTRIBUTORS, ESRI UK, ESRI, HERE, GARMIN, FOUR SQUARE, GEOTECHNOLOGIES, INC., METUNISA, USGS

Issue	Date	Remarks	Drawn	Checked	Approved
A	29/08/23	Final	JF	SC	KJ



THE NATIONAL GRID ELECTRICITY TRANSMISSION PLC
 (SEA LINK) ORDER
 MASTER KEY PLAN FOR CONSULTATION
 SHEET 1 OF 1
 SUFFOLK

nationalgrid

Application Number: EN020026
 National Grid Drawing Reference: S42_S/MKP/SS/0001
 Scale: 1:15,000
 Sheet Size: A0
 Sheet: SHEET 1 OF 1
 Issue: A

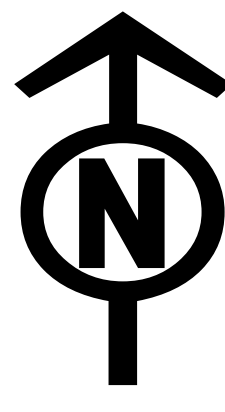

THE NATIONAL GRID ELECTRICITY TRANSMISSION PLC (SEA LINK) ORDER
 GENERAL ARRANGEMENT PLAN SERIES FOR CONSULTATION
 SHEET 1 OF 7
 SUFFOLK
 SUFFOLK COUNTY COUNCIL, EAST SUFFOLK DISTRICT COUNCIL

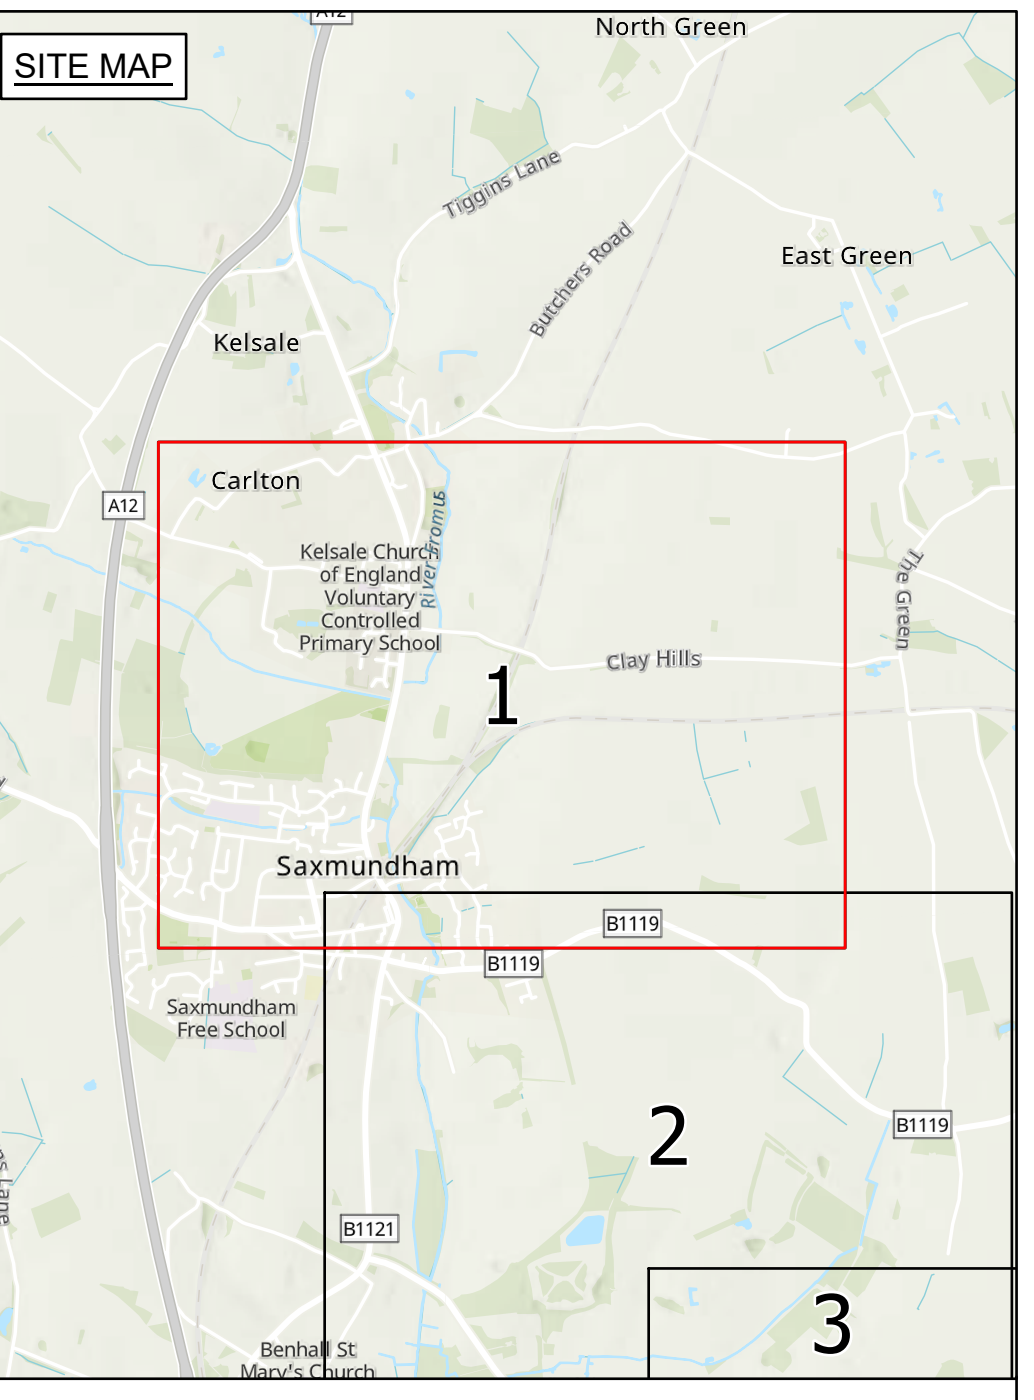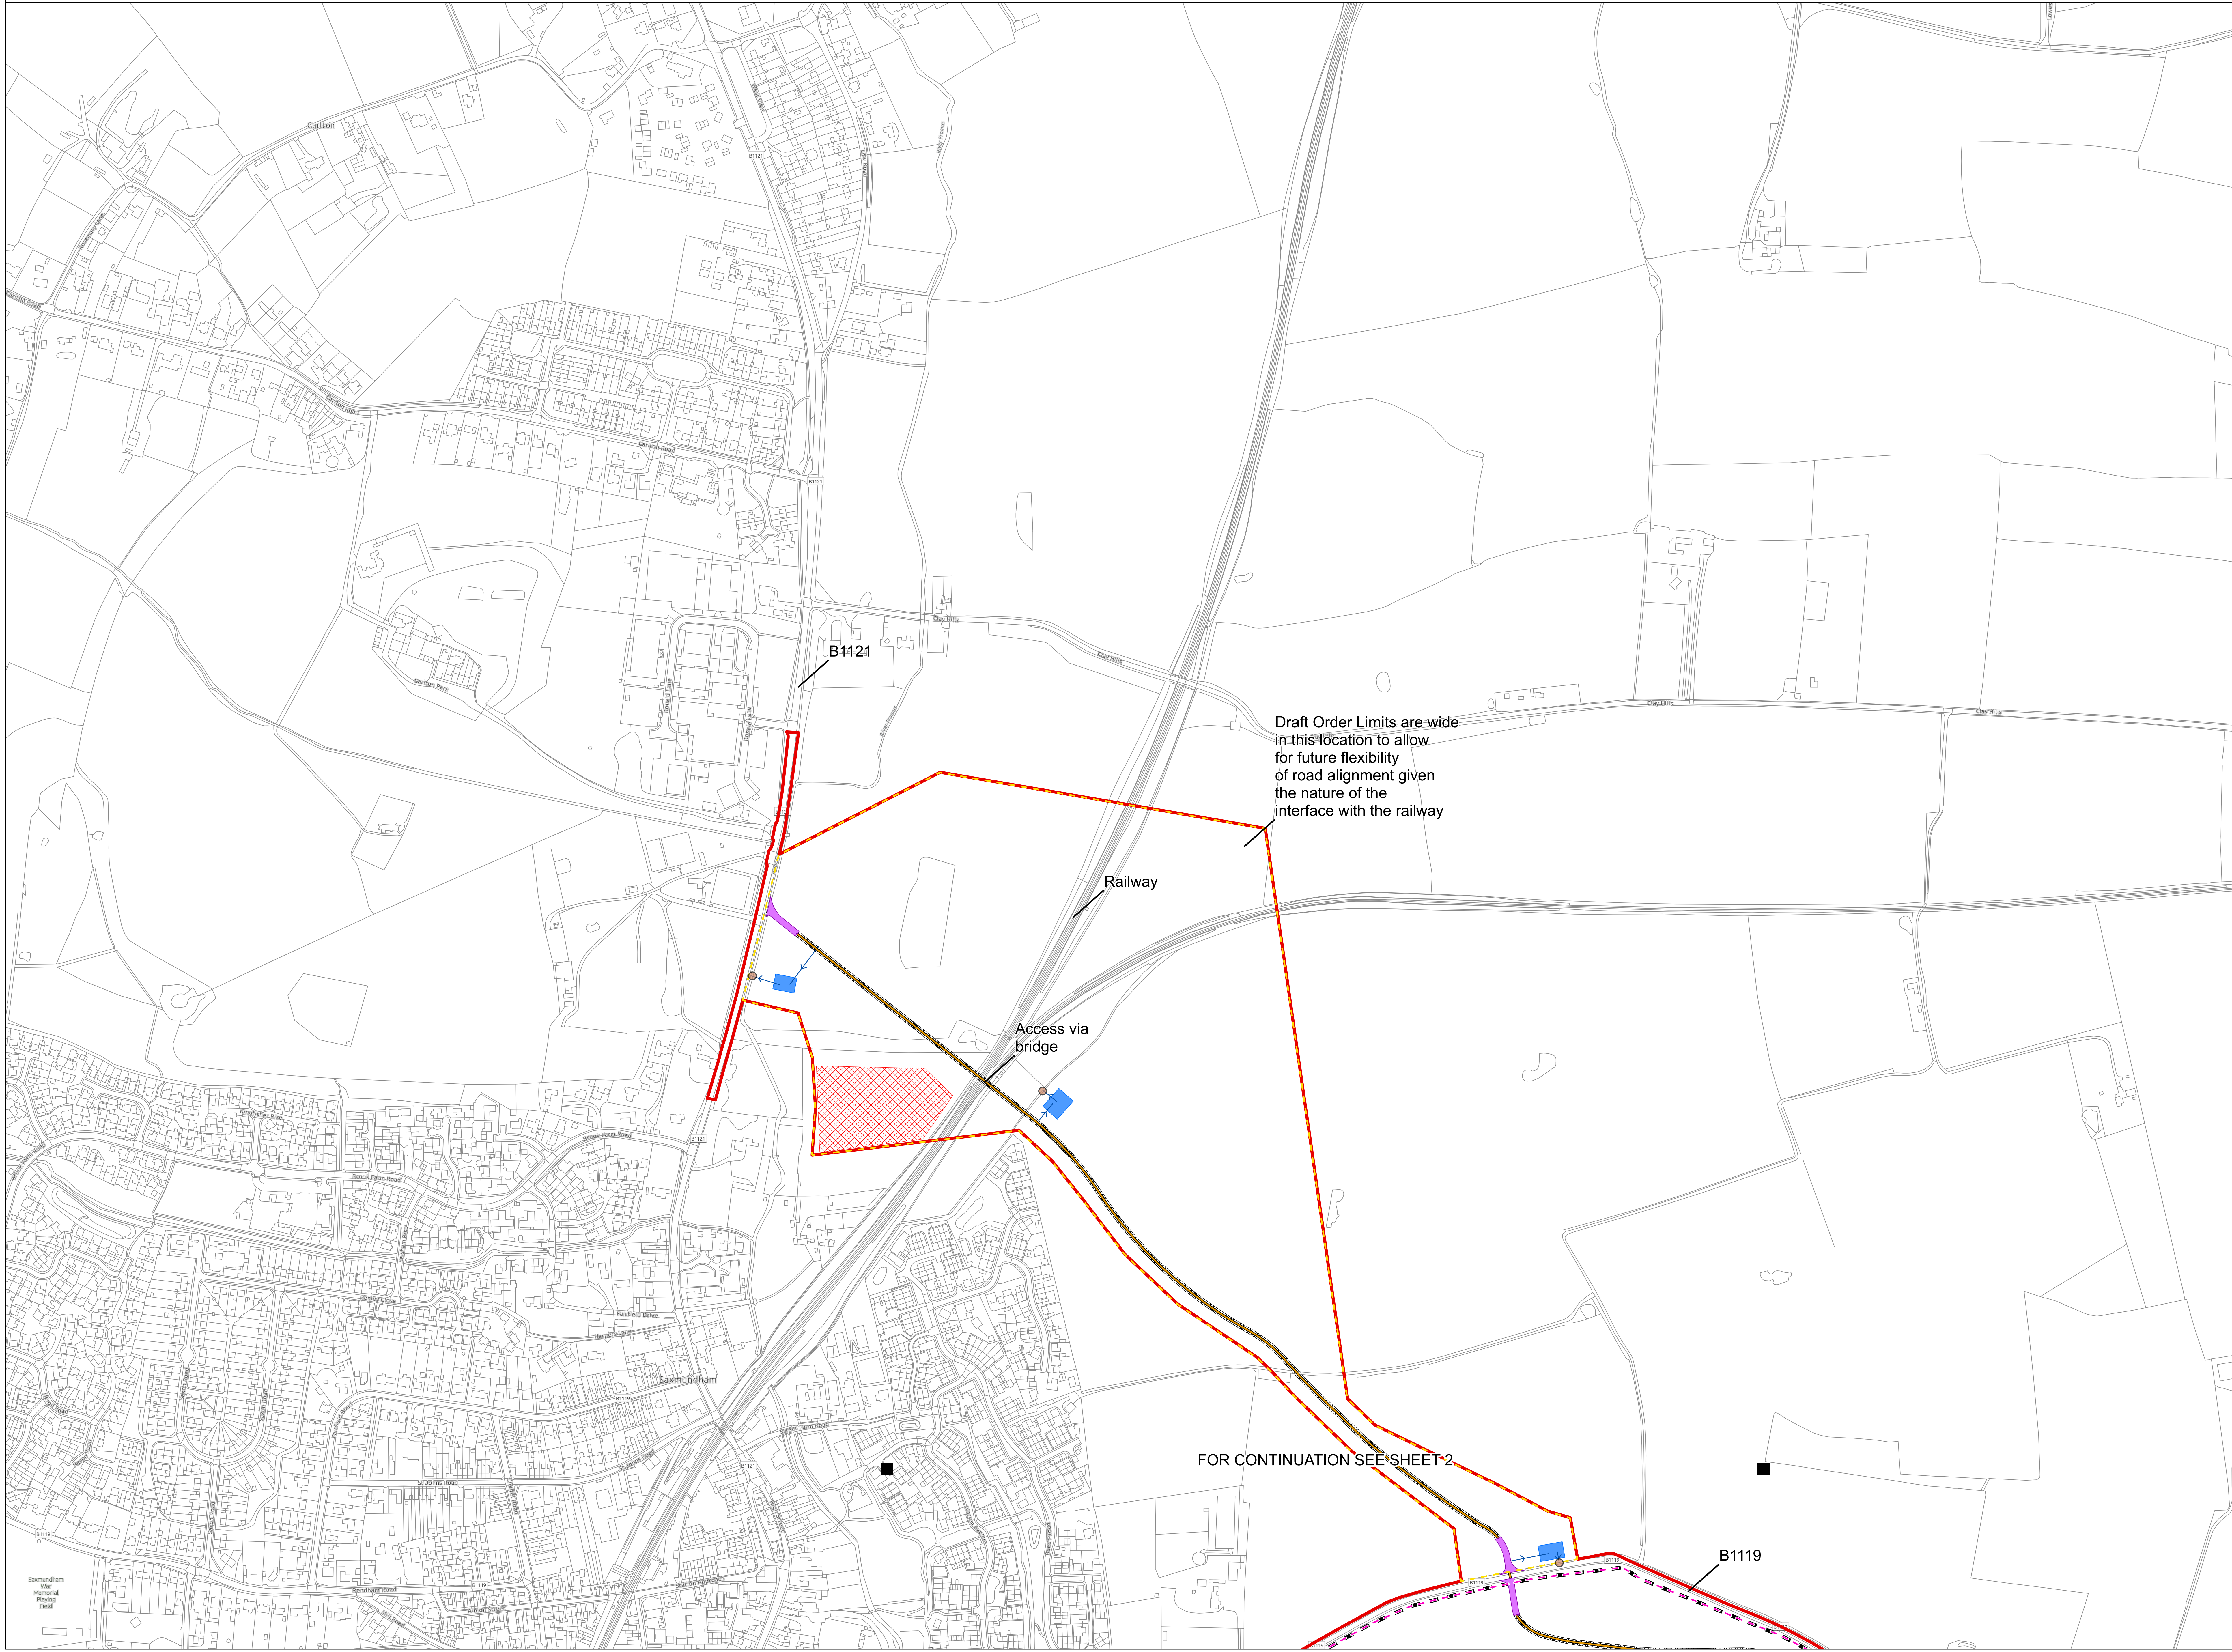

- Legend**
- Draft Order Limits
 - - - Cable Limit of Deviation (LoD)
 - - - Permanent access Limit of Deviation (LoD)
 - - - Converter station Limit of Deviation (LoD)
 - Proposed permanent outfall
 - Proposed access route
 - Proposed permanent attenuation outfall pipe
 - ▨ Proposed construction compound
 - ▨ Proposed permanent bellmouth
 - ▨ Proposed permanent attenuation pond (includes 5 metre buffer)

Notes
For statutory consultation purposes only.
 1. This plan is scaled at paper size A0, therefore any prints taken at smaller sizes will affect accuracy of the measurement units and should not be scaled against.
 2. These plans show the Draft Order Limits and cable alignment and potential pylon locations. Due to the need for future flexibility, National Grid will be applying for Order Limits and Limits of Deviation within its Development Consent Order, within which any final alignment (including pylon locations) would lie. Therefore the cable alignment and pylon locations should be treated as indicative only. Further information is provided in our 'Guide to interacting with our consultation plans' document.
 3. The Permanent access LoD is only shown where permanent access routes fall outside of the Cable LoD.
 4. Access routes shown are a combination of primary construction accesses, mobilisation accesses, and monitoring and maintenance accesses.
 5. For further information on construction please refer to the construction section of the Preliminary Environmental Impact Report, Volume 1, Part 1, Chapter 4.

Coordinate System: British National Grid
 Sheet X Centroid Coordinate: 63996.3125 Sheet Y Centroid Coordinate: 264012.53125



BACKGROUND MAPPING INFORMATION HAS BEEN REPRODUCED FROM THE ORDNANCE SURVEY BY PERMISSION OF ORDNANCE SURVEY OF THE CONTROLLER OF HIS MAJESTY'S STATIONERY OFFICE. CROWN COPYRIGHT ORDNANCE SURVEY © - 100024241. BLUEBERRY INTERNATIONAL LTD © NATIONAL GRID ELECTRICITY. ESRI COMMUNITY MAPS CONTRIBUTORS, ESRI UK, ESRI, HERE, GARMIN, FOUR SQUARE, GEOTECHNOLOGIES, INC, METINKASA, USGS

Issue	Date	Remarks	Drawn	Checked	Approved
A	31/08/23	Final	JF	SC	JW




THE NATIONAL GRID ELECTRICITY TRANSMISSION PLC (SEA LINK) ORDER
 GENERAL ARRANGEMENT PLAN SERIES FOR CONSULTATION
 SHEET 1 OF 7
 SUFFOLK



Application Number		EN020026	
National Grid Drawing Reference		S42_S/IGA/PS/0001	
Scale	Sheet Size	Sheet	Issue
1:2,500	A0	SHEET 1 OF 7	A

FOR CONTINUATION SEE SHEET 2

THE NATIONAL GRID ELECTRICITY TRANSMISSION PLC (SEA LINK) ORDER
 GENERAL ARRANGEMENT PLAN SERIES FOR CONSULTATION
 SHEET 2 OF 7
 SUFFOLK
 SUFFOLK COUNTY COUNCIL, EAST SUFFOLK DISTRICT COUNCIL

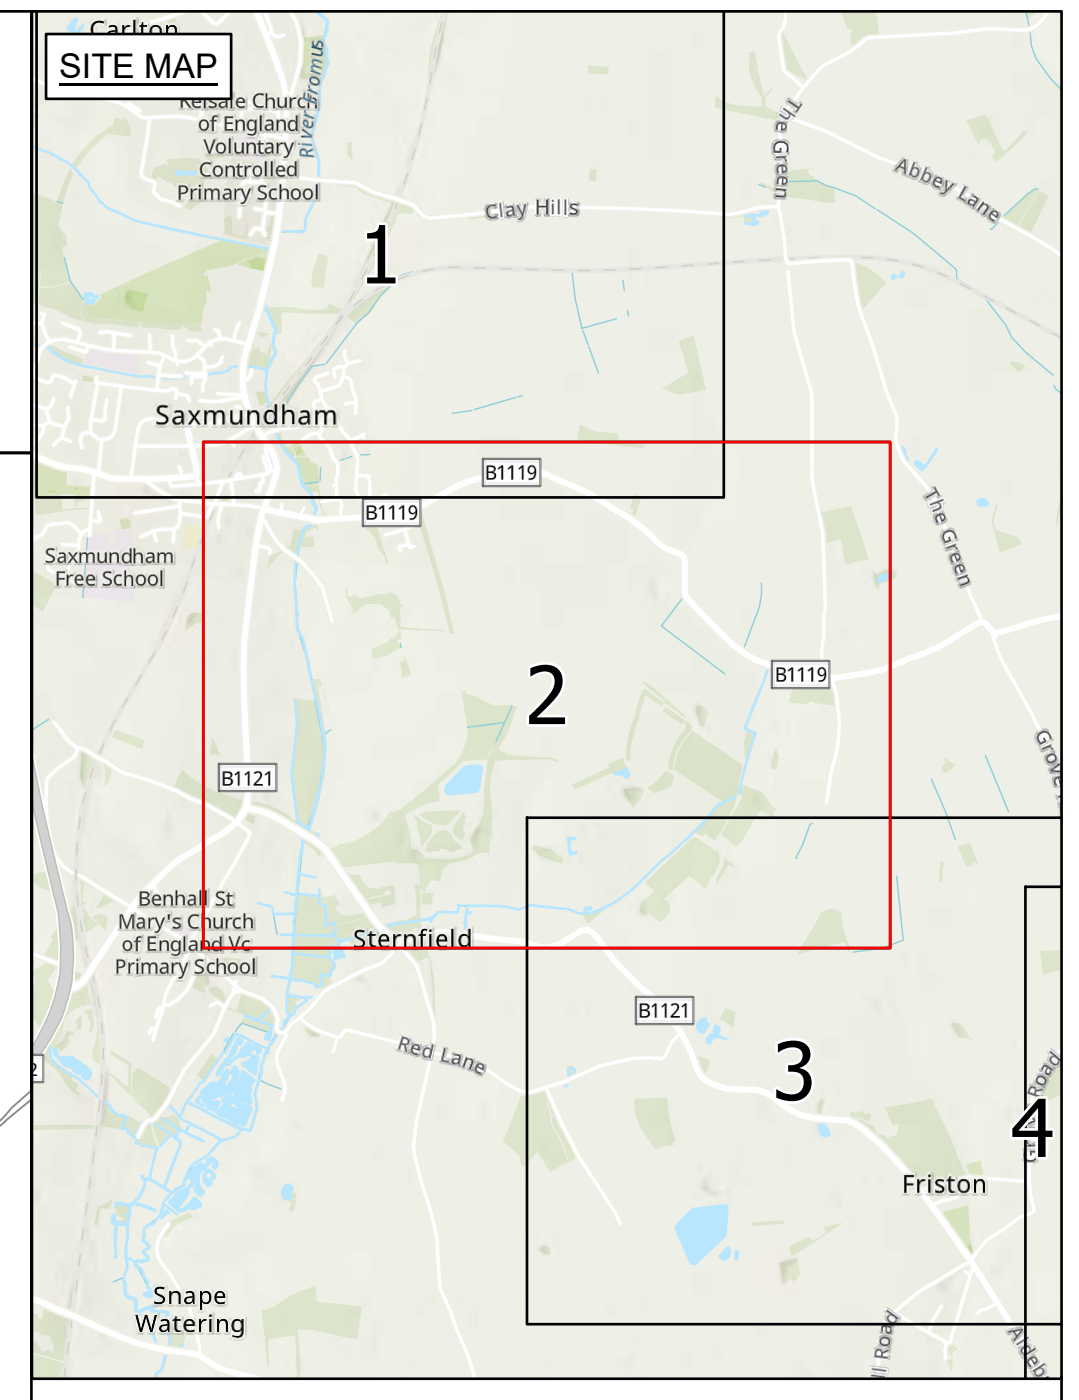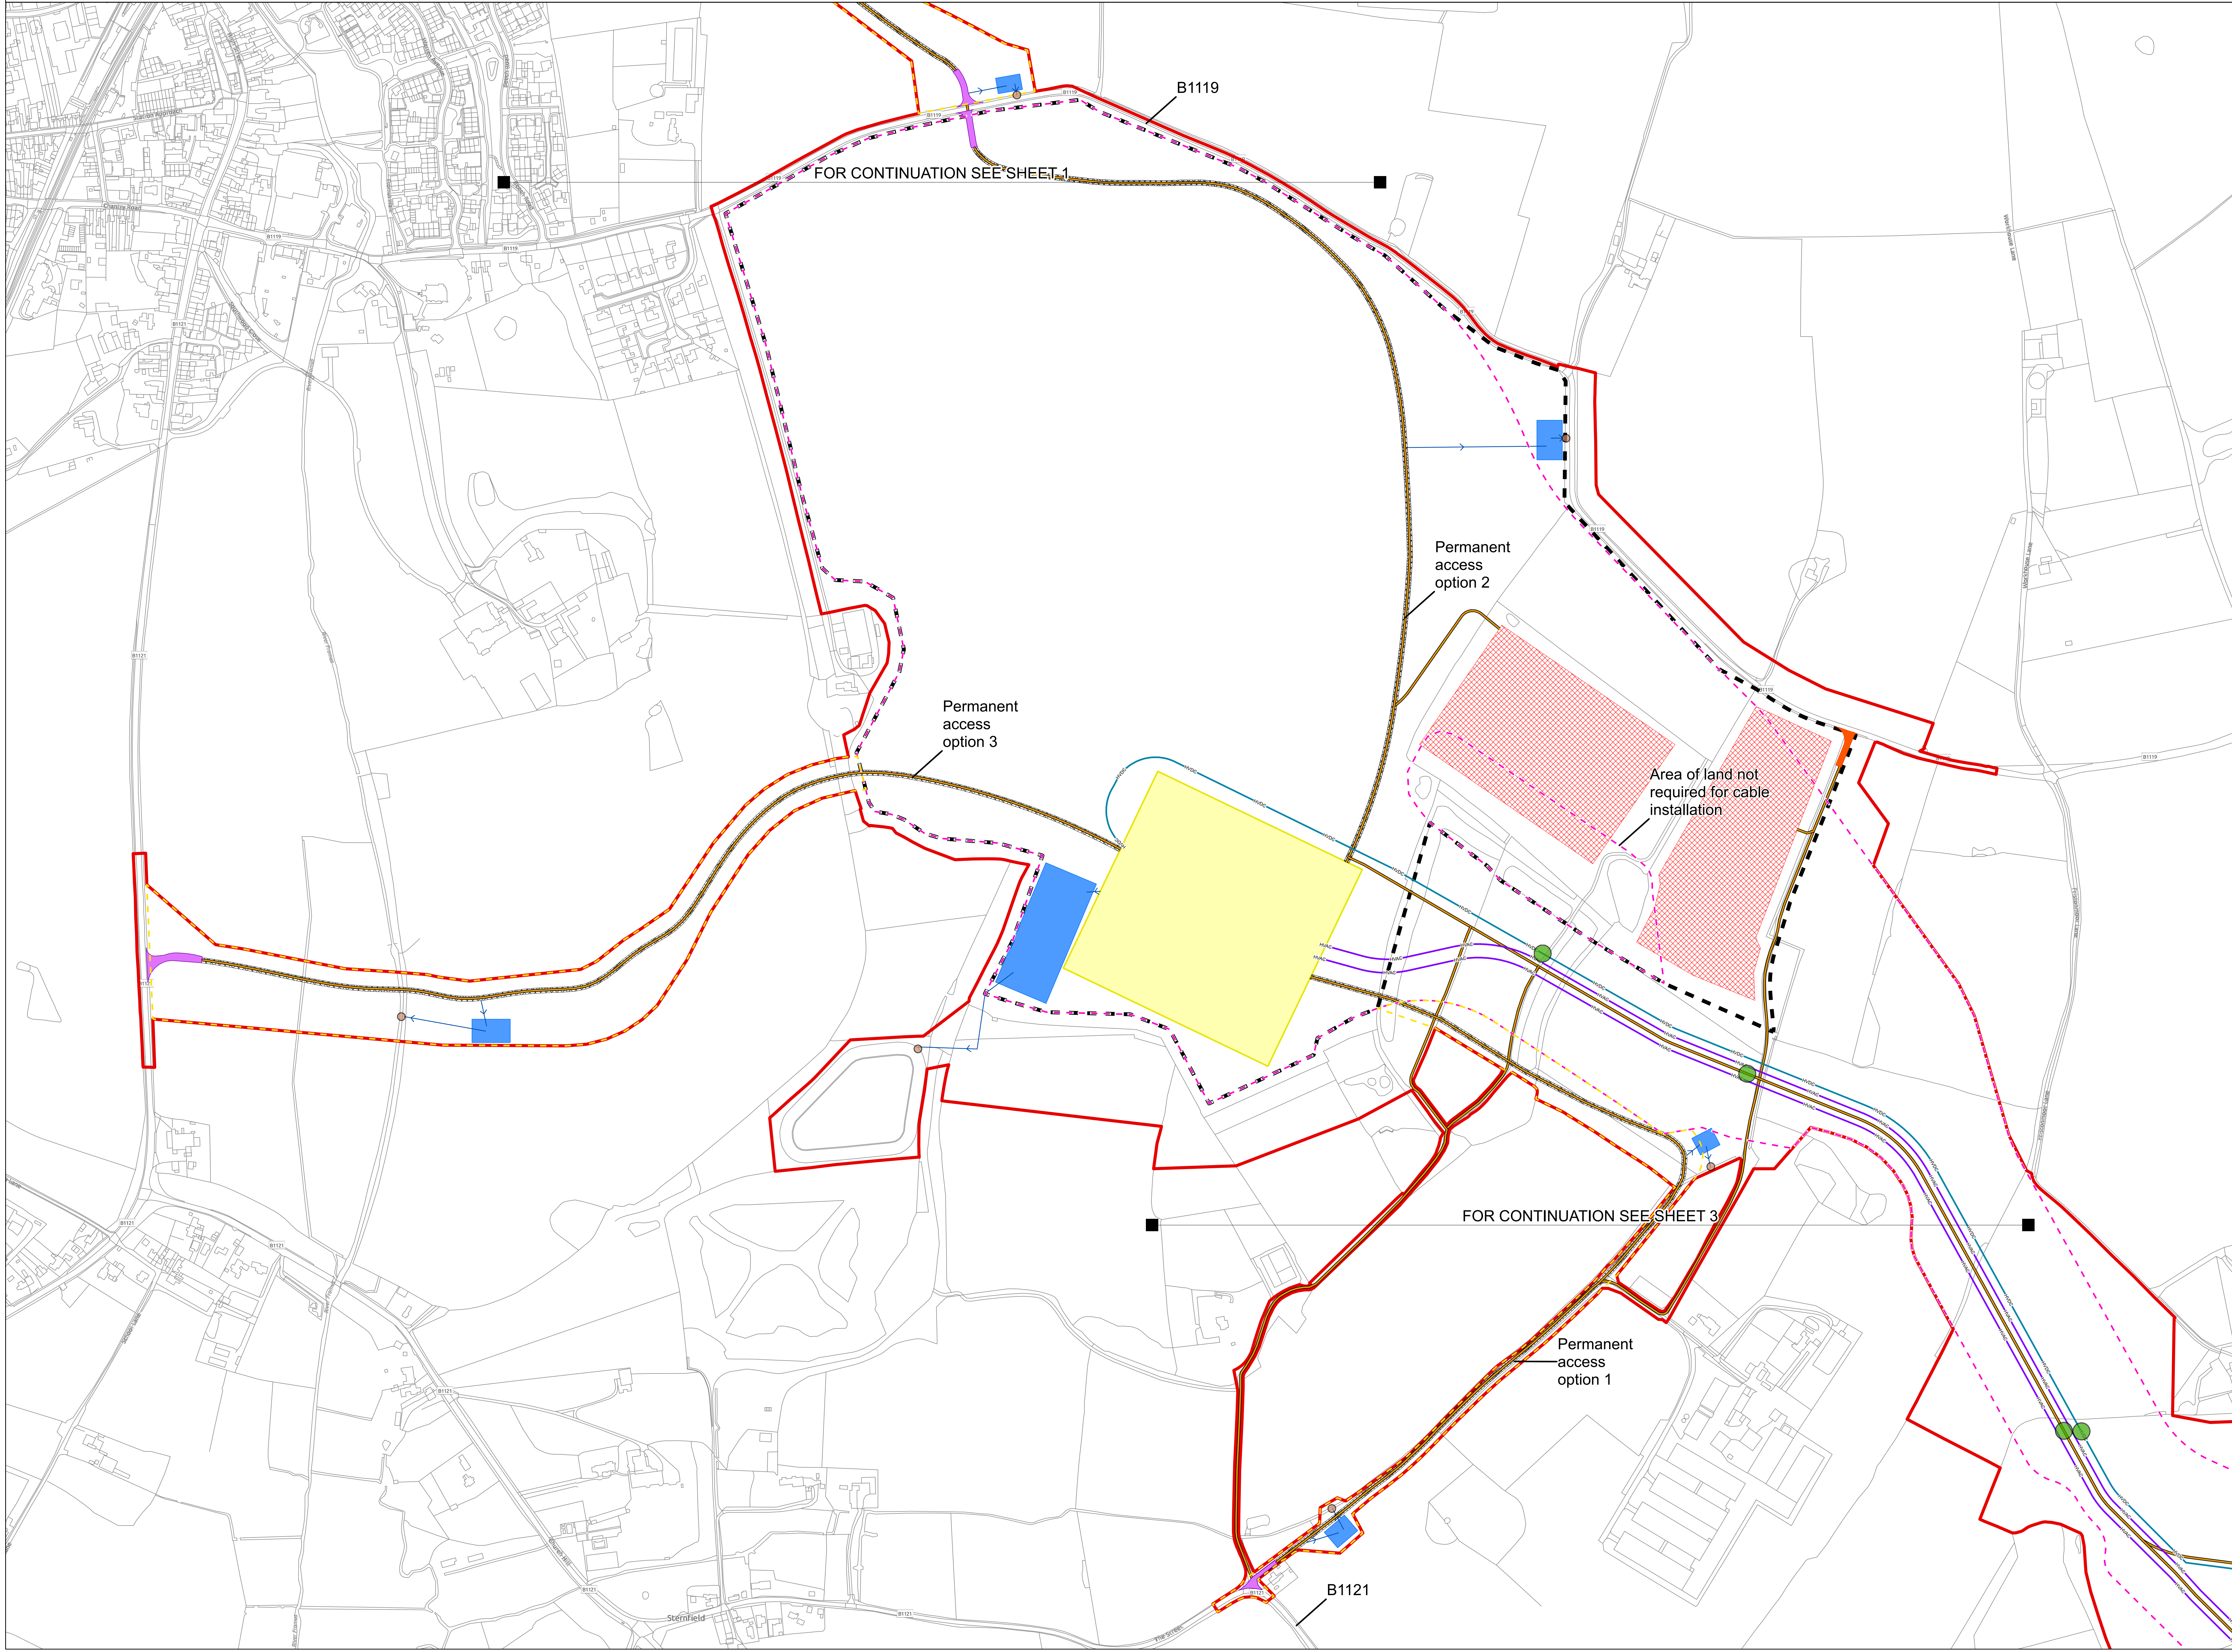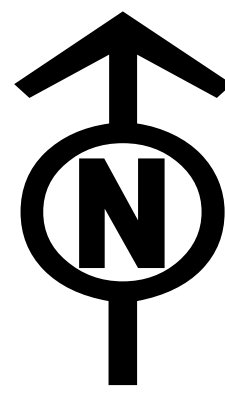


Legend

- Draft Order Limits
- - - Cable Limit of Deviation (LoD)
- - - Permanent access Limit of Deviation (LoD)
- - - Converter station Limit of Deviation (LoD)
- Proposed permanent outfall
- Proposed joint bay
- Proposed access route
- Proposed High Voltage Alternating Current (HVAC) cable alignment
- Proposed High Voltage Direct Current (HVDC) cable alignment
- Proposed permanent attenuation outfall pipe
- ▨ Proposed construction compound
- ▨ Proposed permanent access
- Proposed converter station
- Proposed permanent bellmouth
- Proposed temporary bellmouth
- Proposed permanent attenuation pond (includes 5 metre buffer)

Notes
For statutory consultation purposes only.
 1. This plan is scaled at paper size A0, therefore any prints taken at smaller sizes will affect accuracy of the measurement units and should not be scaled against.
 2. These plans show the Draft Order Limits and cable alignment and potential pylon locations. Due to the need for future flexibility, National Grid will be applying for Order Limits and Limits of Deviation within its Development Consent Order, within which any final alignment (including pylon locations) would lie. Therefore the cable alignment and pylon locations should be treated as indicative only. Further information is provided in our 'Guide to interacting with our consultation plans' document.
 3. The Permanent access LoD is only shown where permanent access routes fall outside of the Cable LoD.
 4. Access routes shown are a combination of primary construction accesses, mobilisation accesses, and monitoring and maintenance accesses.
 5. For further information on construction please refer to the construction section of the Preliminary Environmental Impact Report, Volume 1, Part 1, Chapter 4.

Coordinate System: British National Grid
 Sheet X Centroid Coordinate: 63987.8125 Sheet Y Centroid Coordinate: 262330.78125




BACKGROUND MAPPING INFORMATION HAS BEEN REPRODUCED FROM THE ORDNANCE SURVEY BY PERMISSION OF ORDNANCE SURVEY OF THE CONTROLLER OF HIS MAJESTY'S STATIONERY OFFICE. CROWN COPYRIGHT ORDNANCE SURVEY © 10020241. BLUEBERRY INTERNATIONAL LTD © NATIONAL GRID ELECTRICITY. ESRI COMMUNITY MAPS CONTRIBUTORS: ESRI UK, ESRI, HERE, GARMIN, FOUR SQUARE, GEOTECHNOLOGIES, INC, METINKASA, USGS

Issue	Date	Remarks	Drawn	Checked	Approved
A	31/08/23	Final	JF	SC	JW



THE NATIONAL GRID ELECTRICITY TRANSMISSION PLC (SEA LINK) ORDER
 GENERAL ARRANGEMENT PLAN SERIES FOR CONSULTATION
 SHEET 2 OF 7
 SUFFOLK

nationalgrid

Application Number: EN020026
 National Grid Drawing Reference: S42_S/IGA/PS/0002
 Scale: 1:2,500 Sheet Size: A0 Sheet: SHEET 2 OF 7 Issue: A

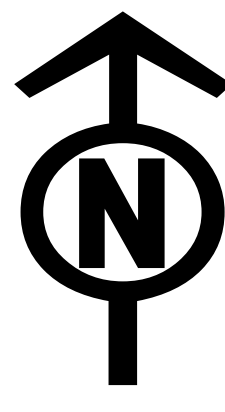

THE NATIONAL GRID ELECTRICITY TRANSMISSION PLC (SEA LINK) ORDER
 GENERAL ARRANGEMENT PLAN SERIES FOR CONSULTATION
 SHEET 3 OF 7
 SUFFOLK
 SUFFOLK COUNTY COUNCIL, EAST SUFFOLK DISTRICT COUNCIL

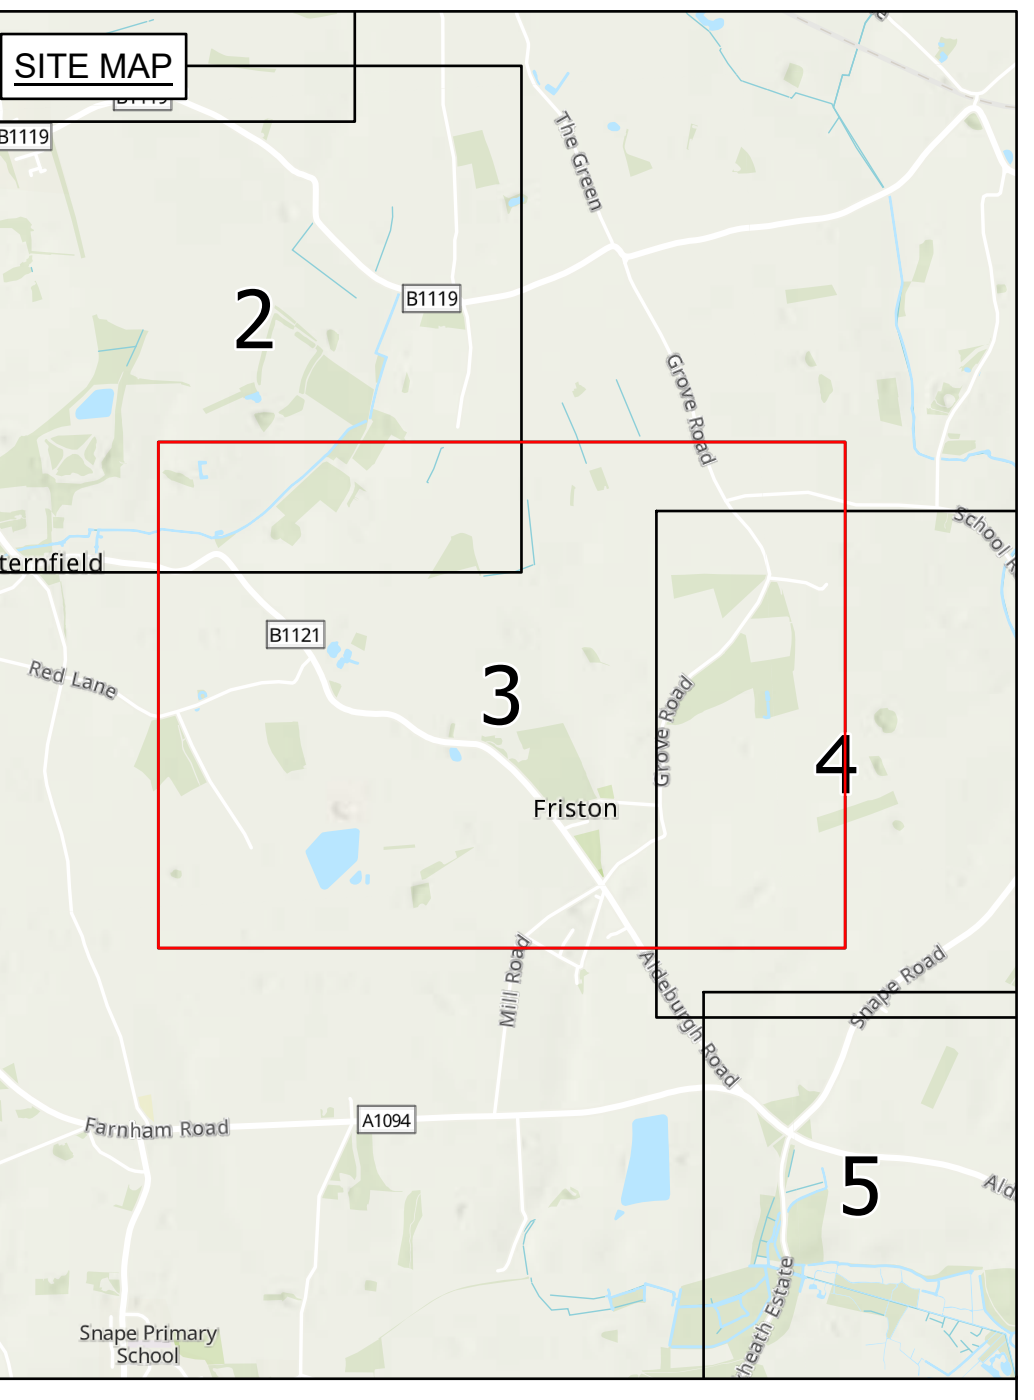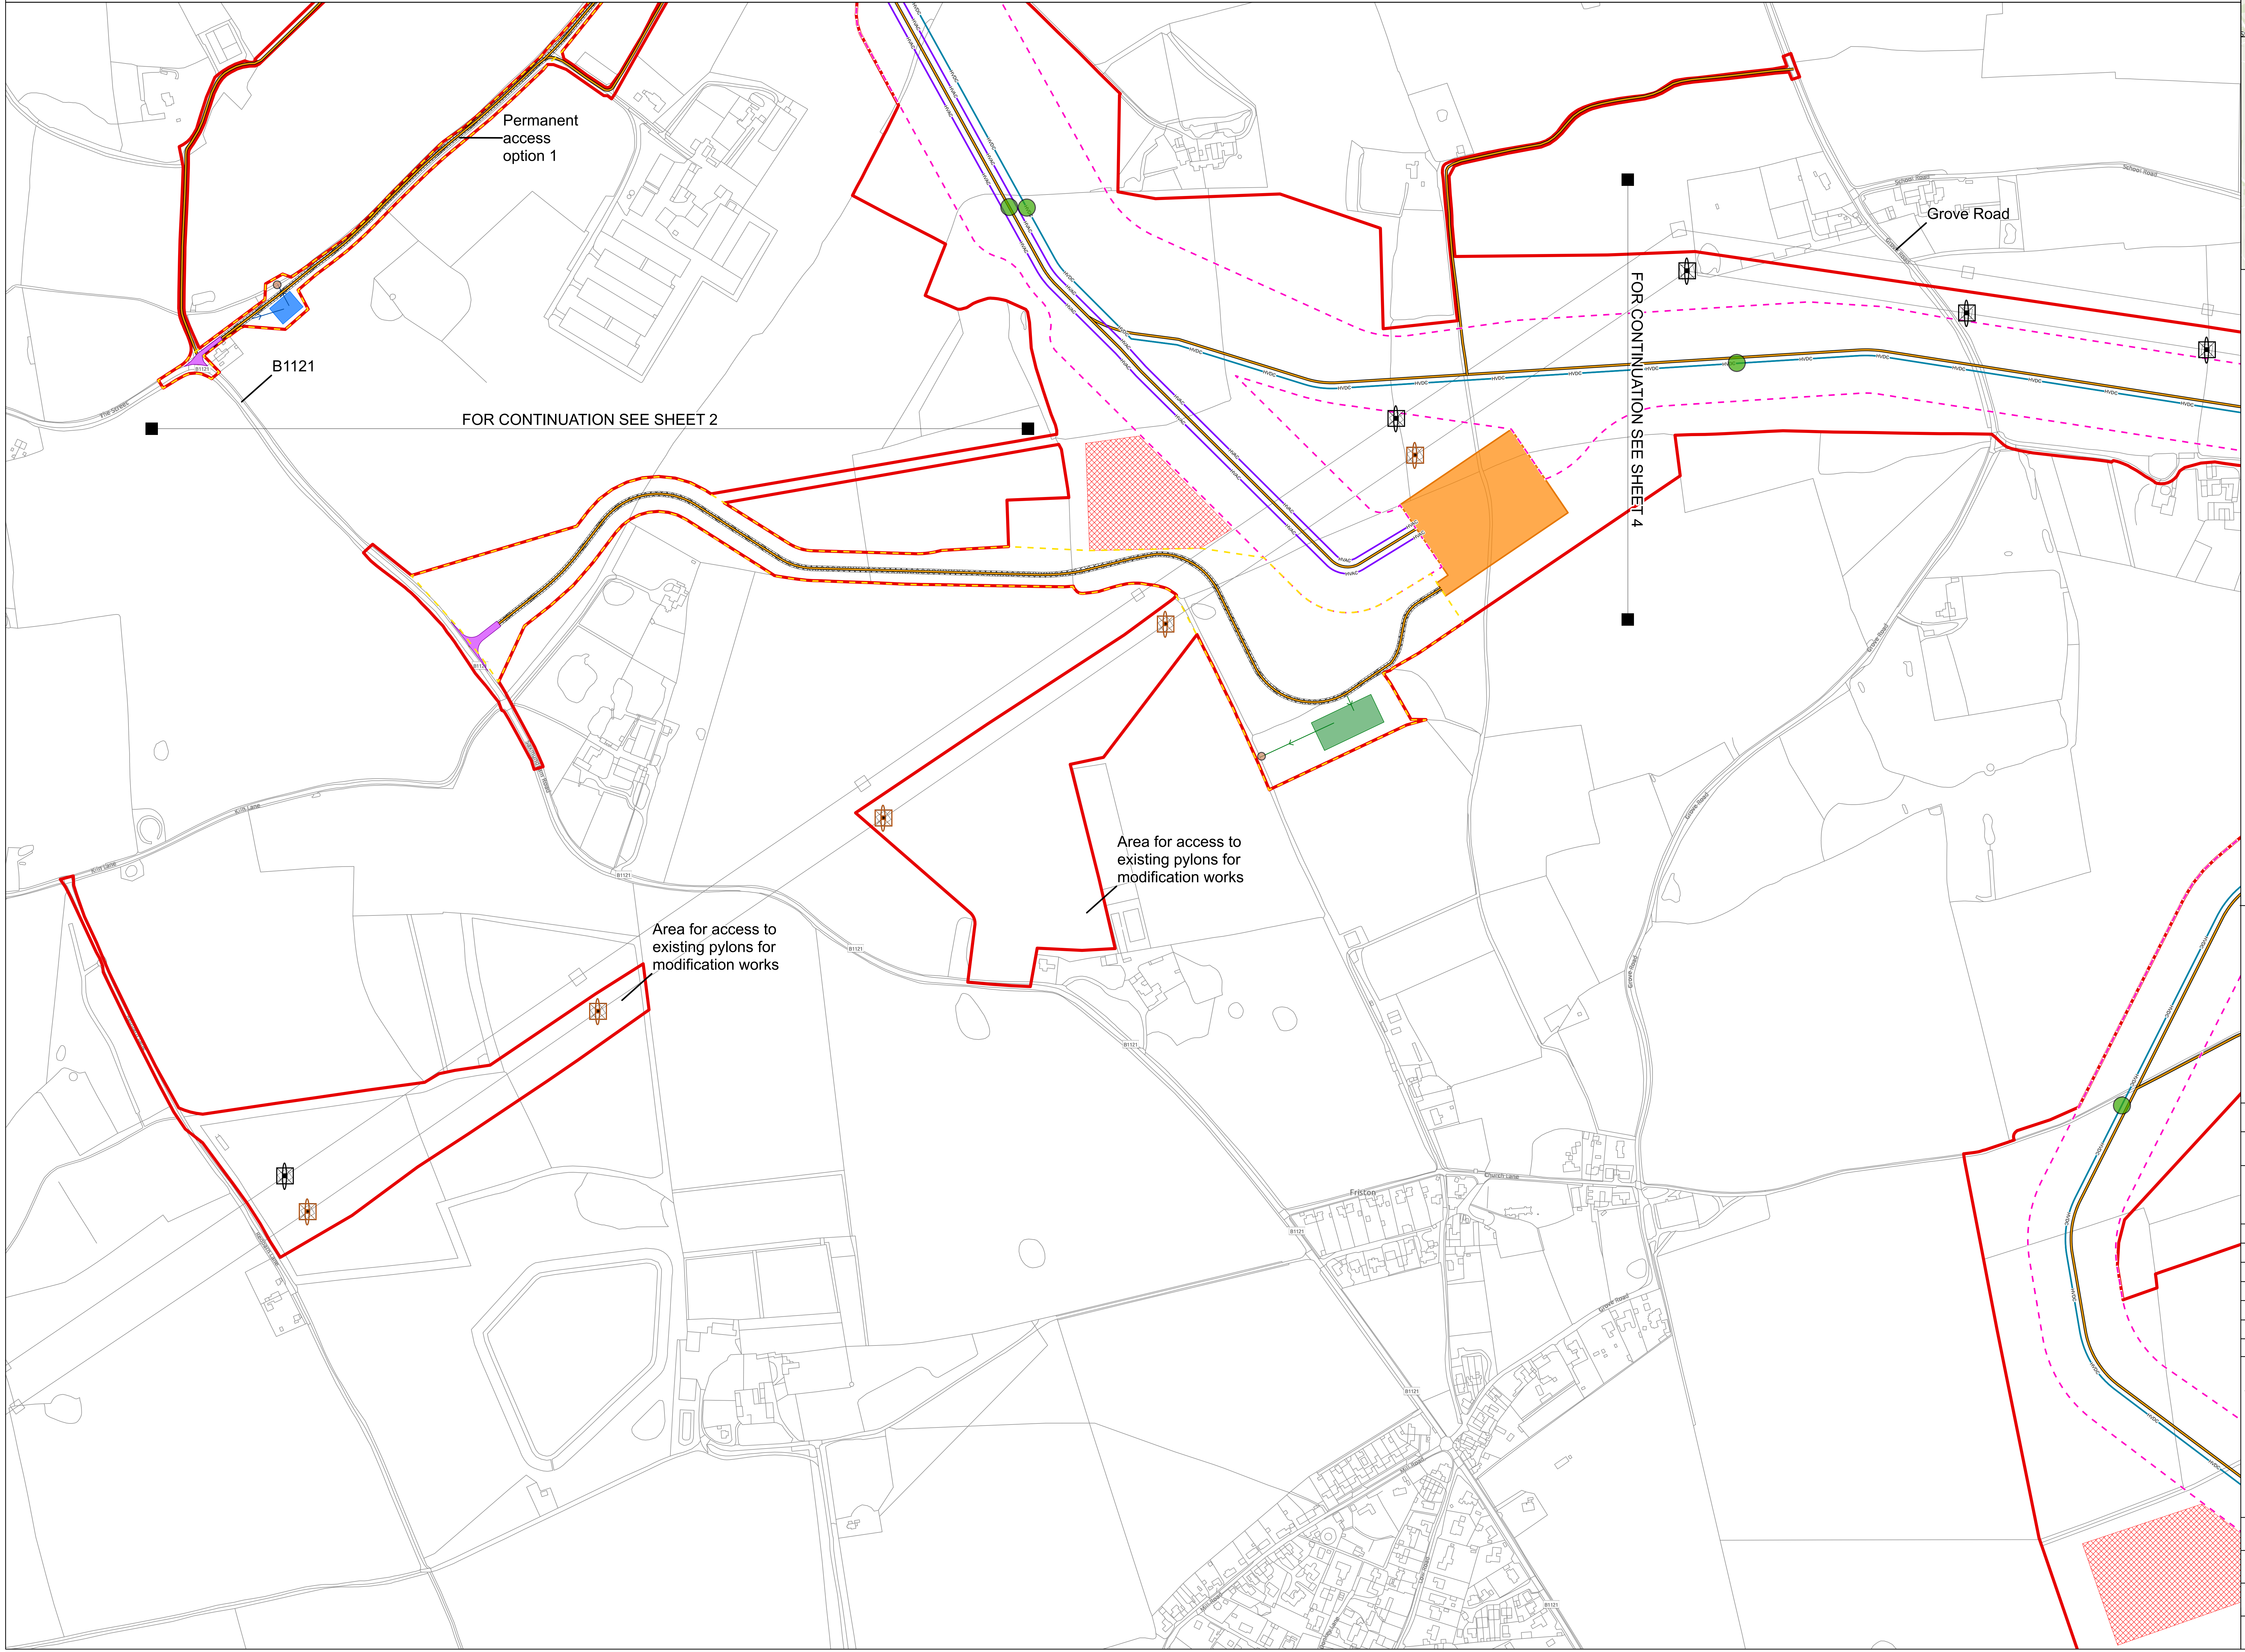

Legend

- Draft Order Limits
- - - Cable Limit of Deviation (LoD)
- - - Permanent access Limit of Deviation (LoD)
- Proposed permanent outfall
- Proposed joint bay
- Existing pylon
- Proposed pylon modification works
- Proposed access route
- Proposed High Voltage Alternating Current (HVAC) cable alignment
- Proposed High Voltage Direct Current (HVDC) cable alignment
- Proposed permanent attenuation outfall pipe
- Proposed permanent infiltration outfall pipe
- ▨ Proposed construction compound
- ▨ Proposed permanent access
- Proposed substation
- Proposed permanent bellmouth
- Proposed permanent attenuation pond (includes 5 metre buffer)
- Proposed permanent infiltration pond (includes 5 metre buffer)

Notes
For statutory consultation purposes only.
 1. This plan is scaled at paper size A0, therefore any prints taken at smaller sizes will affect accuracy of the measurement units and should not be scaled against.
 2. These plans show the Draft Order Limits and cable alignment and potential pylon locations. Due to the need for future flexibility, National Grid will be applying for Order Limits and Limits of Deviation within its Development Consent Order, within which any final alignment (including pylon locations) would lie. Therefore the cable alignment and pylon locations should be treated as indicative only. Further information is provided in our 'Guide to interacting with our consultation plans' document.
 3. The Permanent access LoD is only shown where permanent access routes fall outside of the Cable LoD.
 4. Access routes shown are a combination of primary construction accesses, mobilisation accesses, and monitoring and maintenance accesses.
 5. For further information on construction please refer to the construction section of the Preliminary Environmental Impact Report, Volume 1, Part 1, Chapter 4.

Coordinate System: British National Grid
 Sheet X Centroid Coordinate: 64089.25 Sheet Y Centroid Coordinate: 269928.59375

0 62.5 125 250 Metres

BACKGROUND MAPPING INFORMATION HAS BEEN REPRODUCED FROM THE ORDNANCE SURVEY BY PERMISSION OF ORDNANCE SURVEY OF THE CONTROLLER OF HIS MAJESTY'S STATIONERY OFFICE. CROWN COPYRIGHT ORDNANCE SURVEY © 100024241. BLUEKEY INTERNATIONAL LTD © NATIONAL GRID ELECTRICITY. ESRI COMMUNITY MAPS CONTRIBUTORS, ESRI UK, ESRI, HERE, GARMIN, FOUR SQUARE, GEOTECHNOLOGIES, INC, METINKSA, USGS




Issue	Date	Remarks	Drawn	Checked	Approved
A	31/08/23	Final	JF	SC	JW

THE NATIONAL GRID ELECTRICITY TRANSMISSION PLC (SEA LINK) ORDER
 GENERAL ARRANGEMENT PLAN SERIES FOR CONSULTATION
 SHEET 3 OF 7
 SUFFOLK

nationalgrid

Application Number: EN020026
 National Grid Drawing Reference: S42_S/IGA/PS/0003
 Scale: 1:2,500 Sheet Size: A0 Sheet: SHEET 3 OF 7 Issue: A

THE NATIONAL GRID ELECTRICITY TRANSMISSION PLC (SEA LINK) ORDER
 GENERAL ARRANGEMENT PLAN SERIES FOR CONSULTATION
 SHEET 4 OF 7
 SUFFOLK
 SUFFOLK COUNTY COUNCIL, EAST SUFFOLK DISTRICT COUNCIL

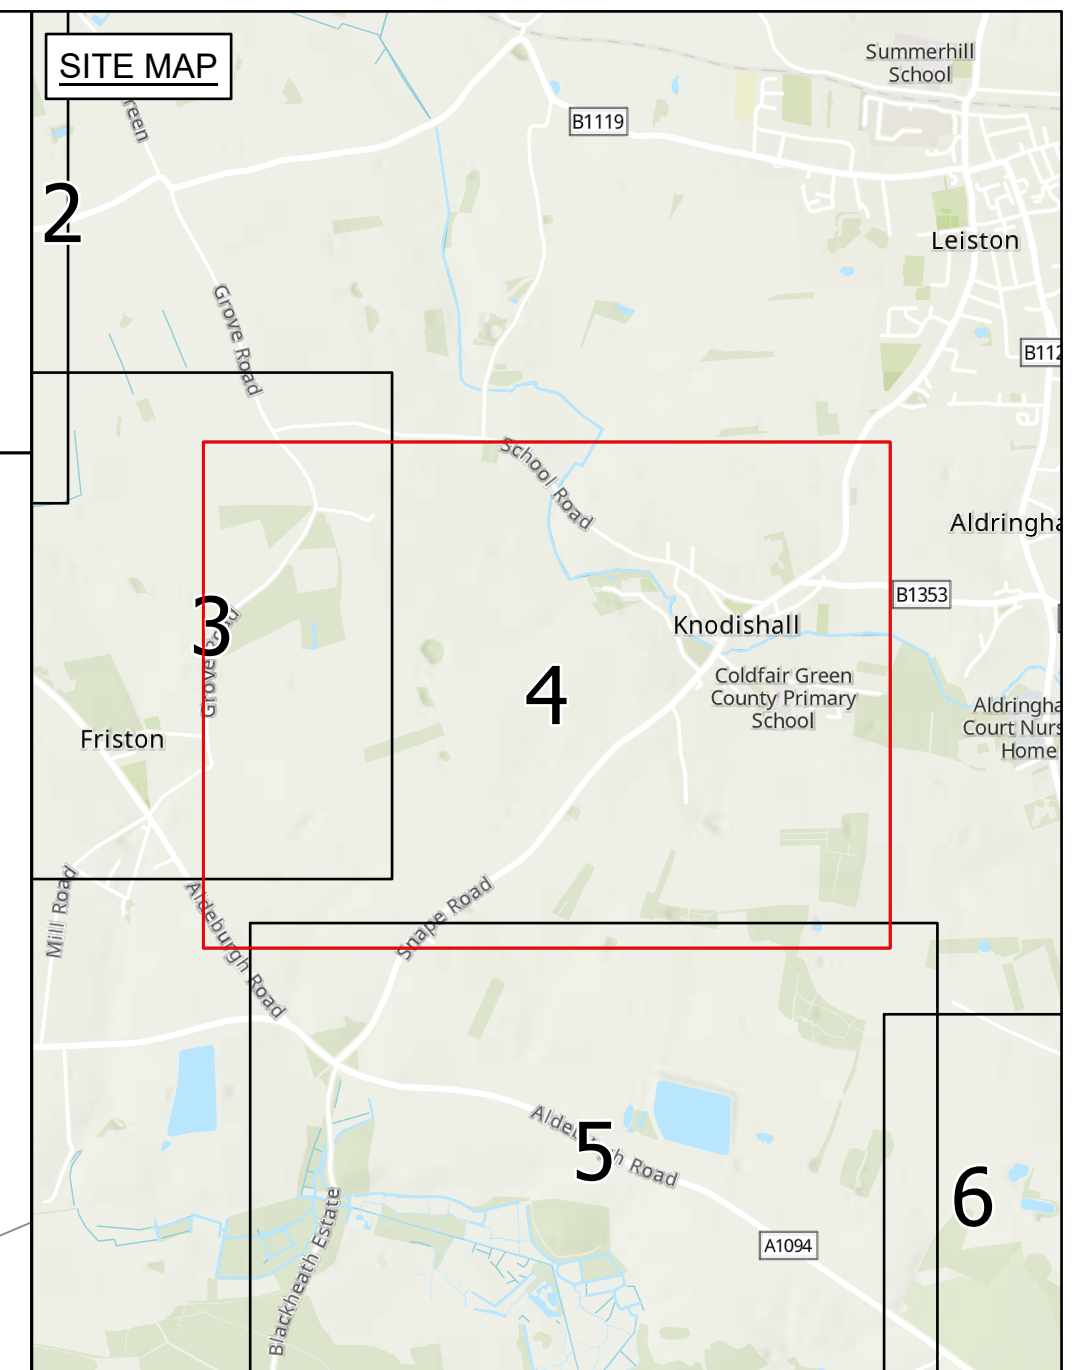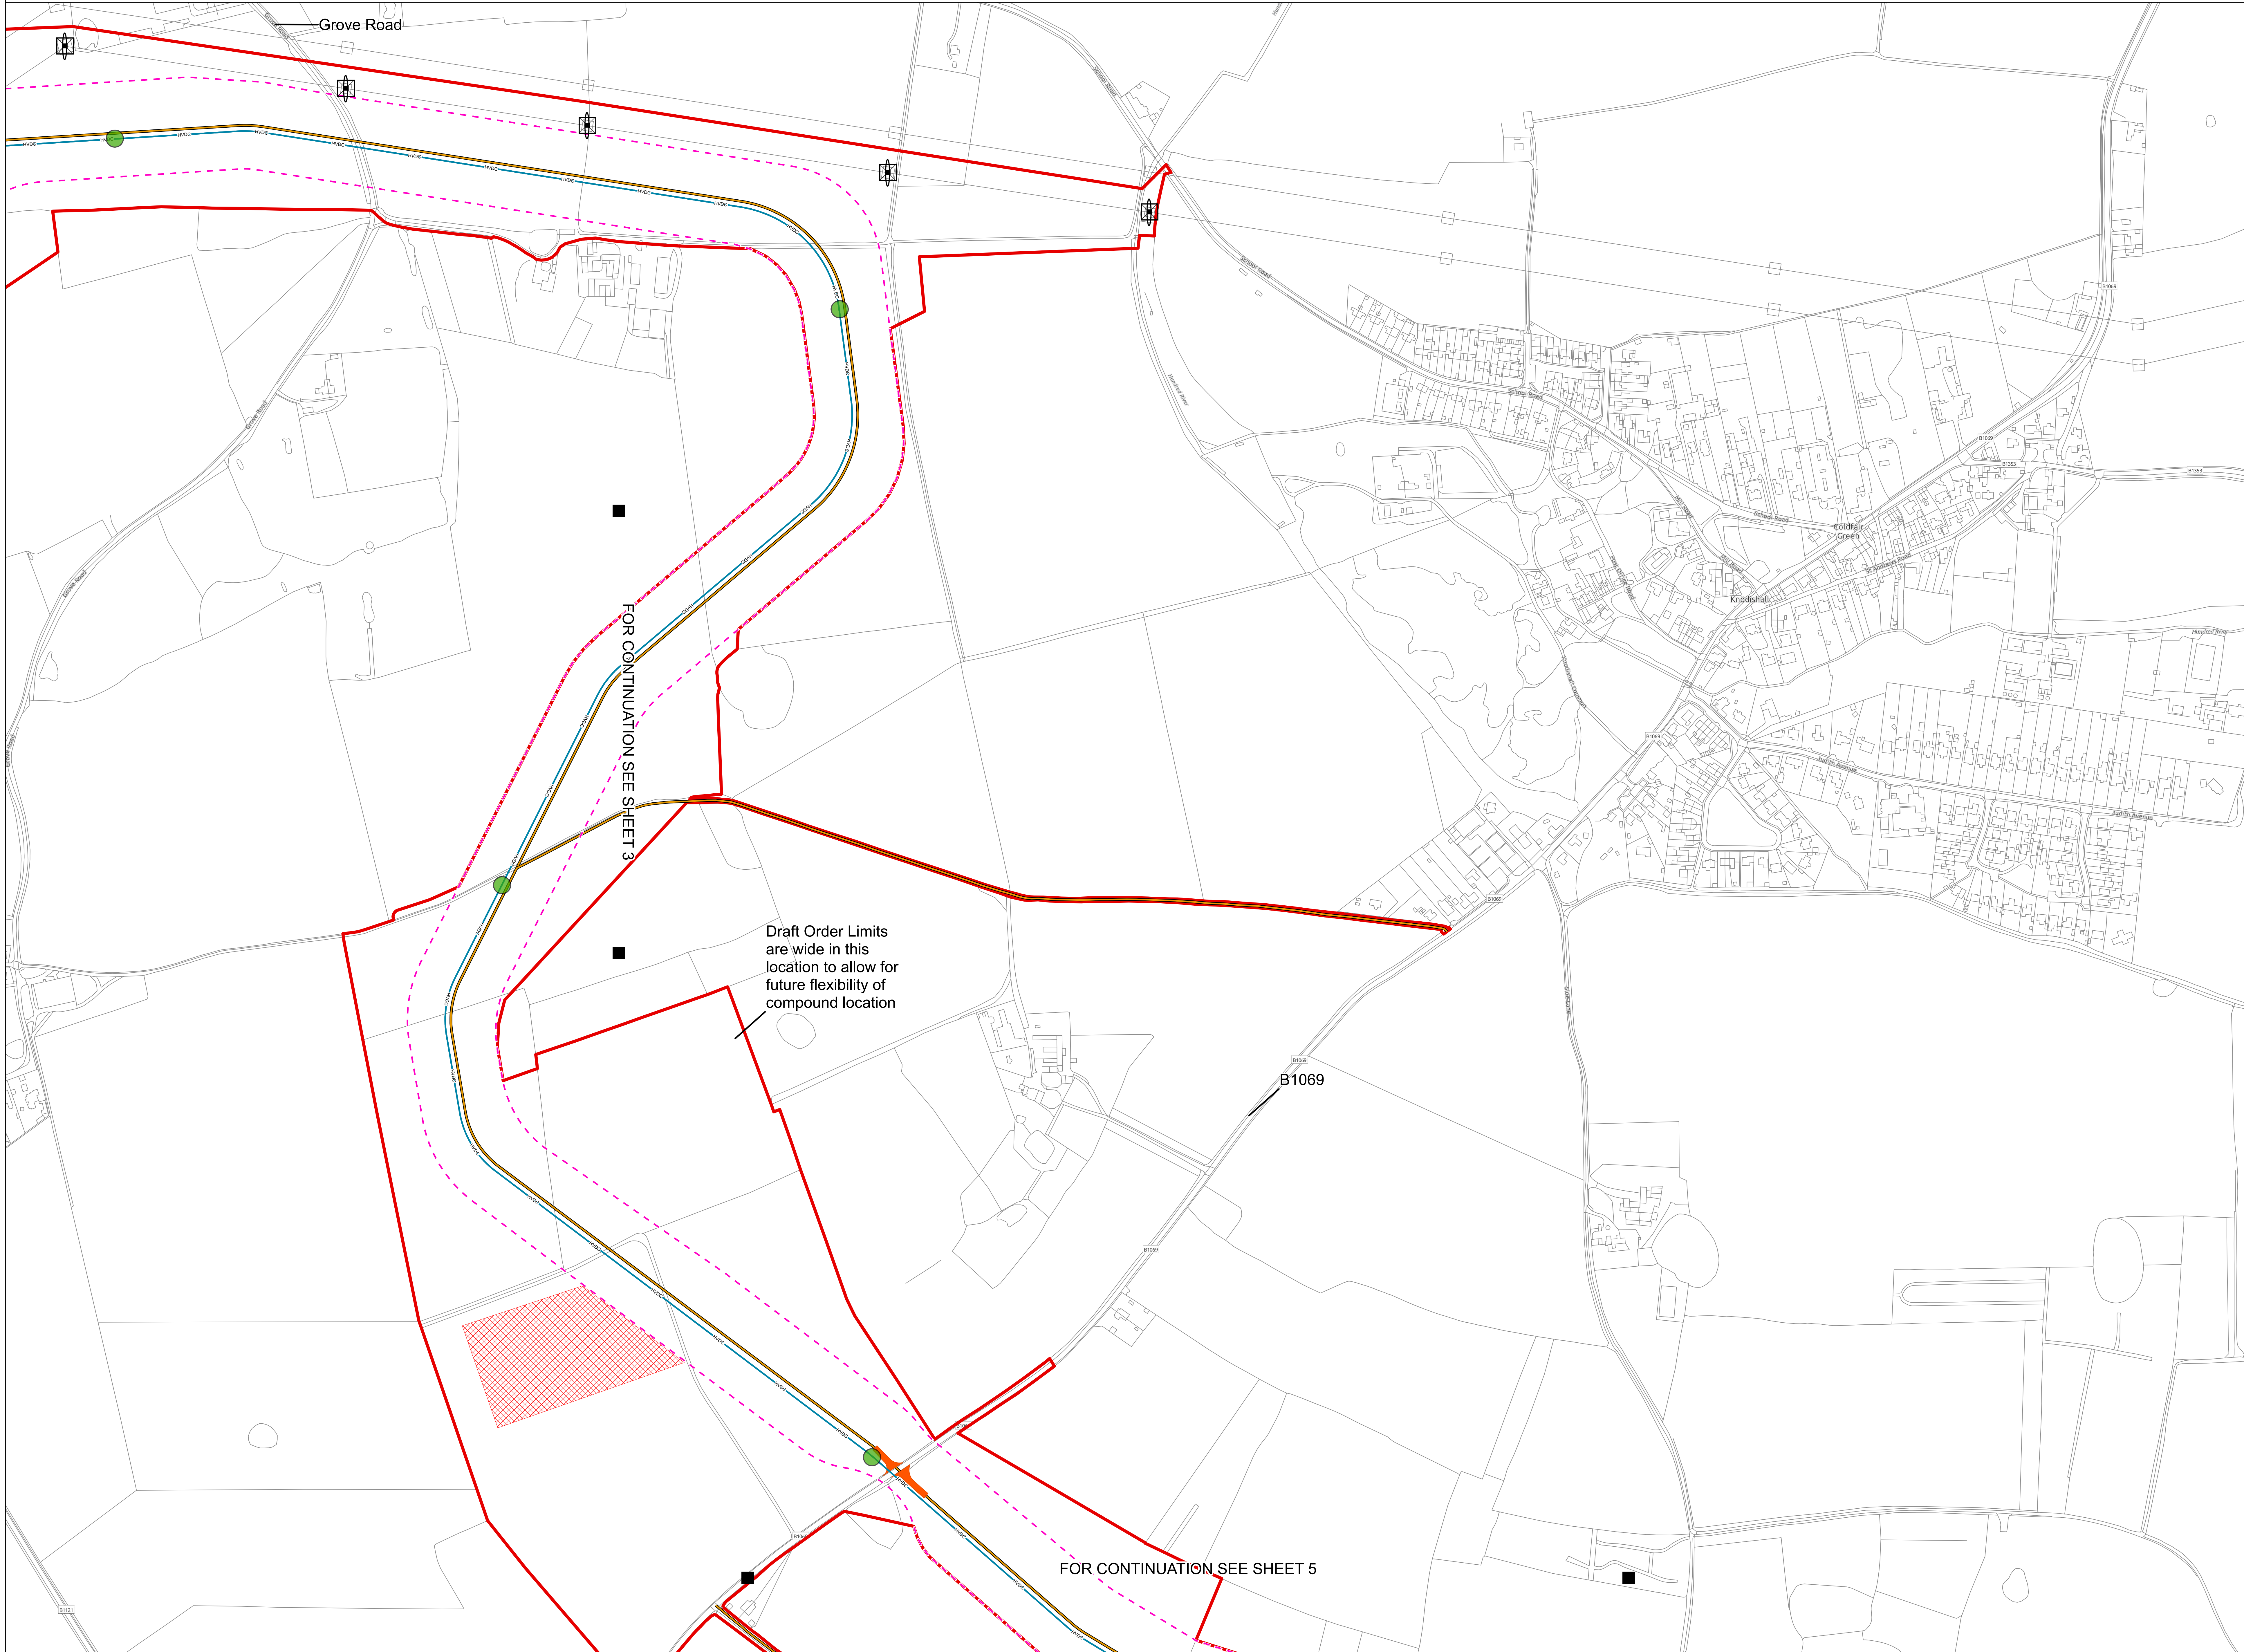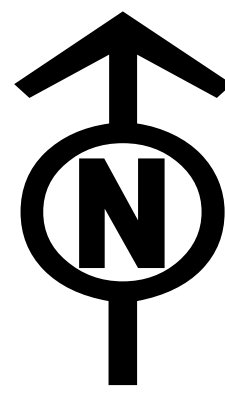

- Legend**
- ▭ Draft Order Limits
 - - - Cable Limit of Deviation (LoD)
 - Proposed joint bay
 - Existing pylon
 - Proposed access route
 - Proposed High Voltage Direct Current (HVDC) cable alignment
 - ▨ Proposed construction compound
 - ▭ Proposed temporary bellmouth

- Notes**
For statutory consultation purposes only.
1. This plan is scaled at paper size A0, therefore any prints taken at smaller sizes will affect accuracy of the measurement units and should not be scaled against.
 2. These plans show the Draft Order Limits and cable alignment and potential pylon locations. Due to the need for future flexibility, National Grid will be applying for Order Limits and Limits of Deviation within its Development Consent Order, within which any final alignment (including pylon locations) would lie. Therefore the cable alignment and pylon locations should be treated as indicative only. Further information is provided in our 'Guide to interacting with our consultation plans' document.
 3. The Permanent access LoD is only shown where permanent access routes fall outside of the Cable LoD.
 4. Access routes shown are a combination of primary construction accesses, mobilisation accesses, and monitoring and maintenance accesses.
 5. For further information on construction please refer to the construction section of the Preliminary Environmental Impact Report, Volume 1, Part 1, Chapter 4.

Coordinate System: British National Grid
 Sheet X Centroid Coordinate: 642755.4375 Sheet Y Centroid Coordinate: 260670.65625



BACKGROUND MAPPING INFORMATION HAS BEEN REPRODUCED FROM THE ORDNANCE SURVEY BY PERMISSION OF ORDNANCE SURVEY OF THE CONTROLLER OF HIS MAJESTY'S STATIONERY OFFICE. CROWN COPYRIGHT ORDNANCE SURVEY © 100024241. BLUEBERRY INTERNATIONAL LTD © NATIONAL GRID ELECTRICITY. ESRI COMMUNITY MAPS CONTRIBUTORS, ESRI UK, ESRI, HERE, GARMIN, FOUR SQUARE, GEOTECHNOLOGIES, INC, METIUNASA, USGS

Issue	Date	Remarks	Drawn	Checked	Approved
A	31/08/23	Final	JF	SC	JW


THE NATIONAL GRID ELECTRICITY TRANSMISSION PLC (SEA LINK) ORDER
 GENERAL ARRANGEMENT PLAN SERIES FOR CONSULTATION
 SHEET 4 OF 7
 SUFFOLK

nationalgrid



Application Number: EN020026

National Grid Drawing Reference: S42_S/IGA/PS/0004

Scale	Sheet Size	Sheet	Issue
1:2,500	A0	SHEET 4 OF 7	A

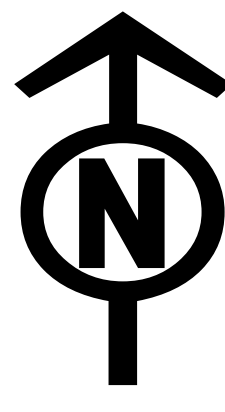

THE NATIONAL GRID ELECTRICITY TRANSMISSION PLC (SEA LINK) ORDER
 GENERAL ARRANGEMENT PLAN SERIES FOR CONSULTATION
 SHEET 5 OF 7
 SUFFOLK
 SUFFOLK COUNTY COUNCIL, EAST SUFFOLK DISTRICT COUNCIL

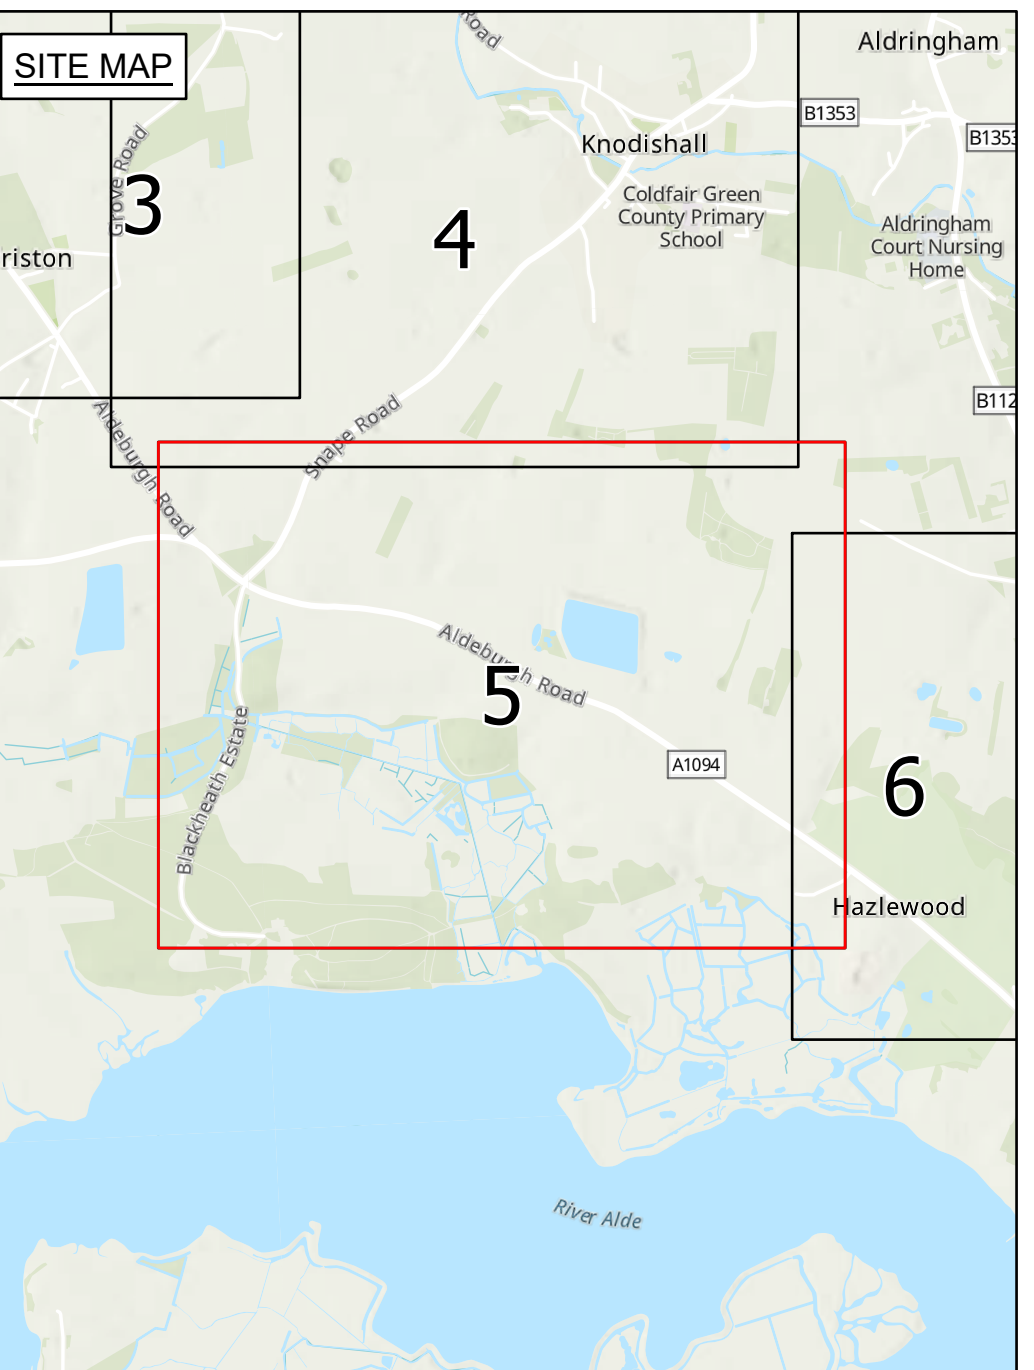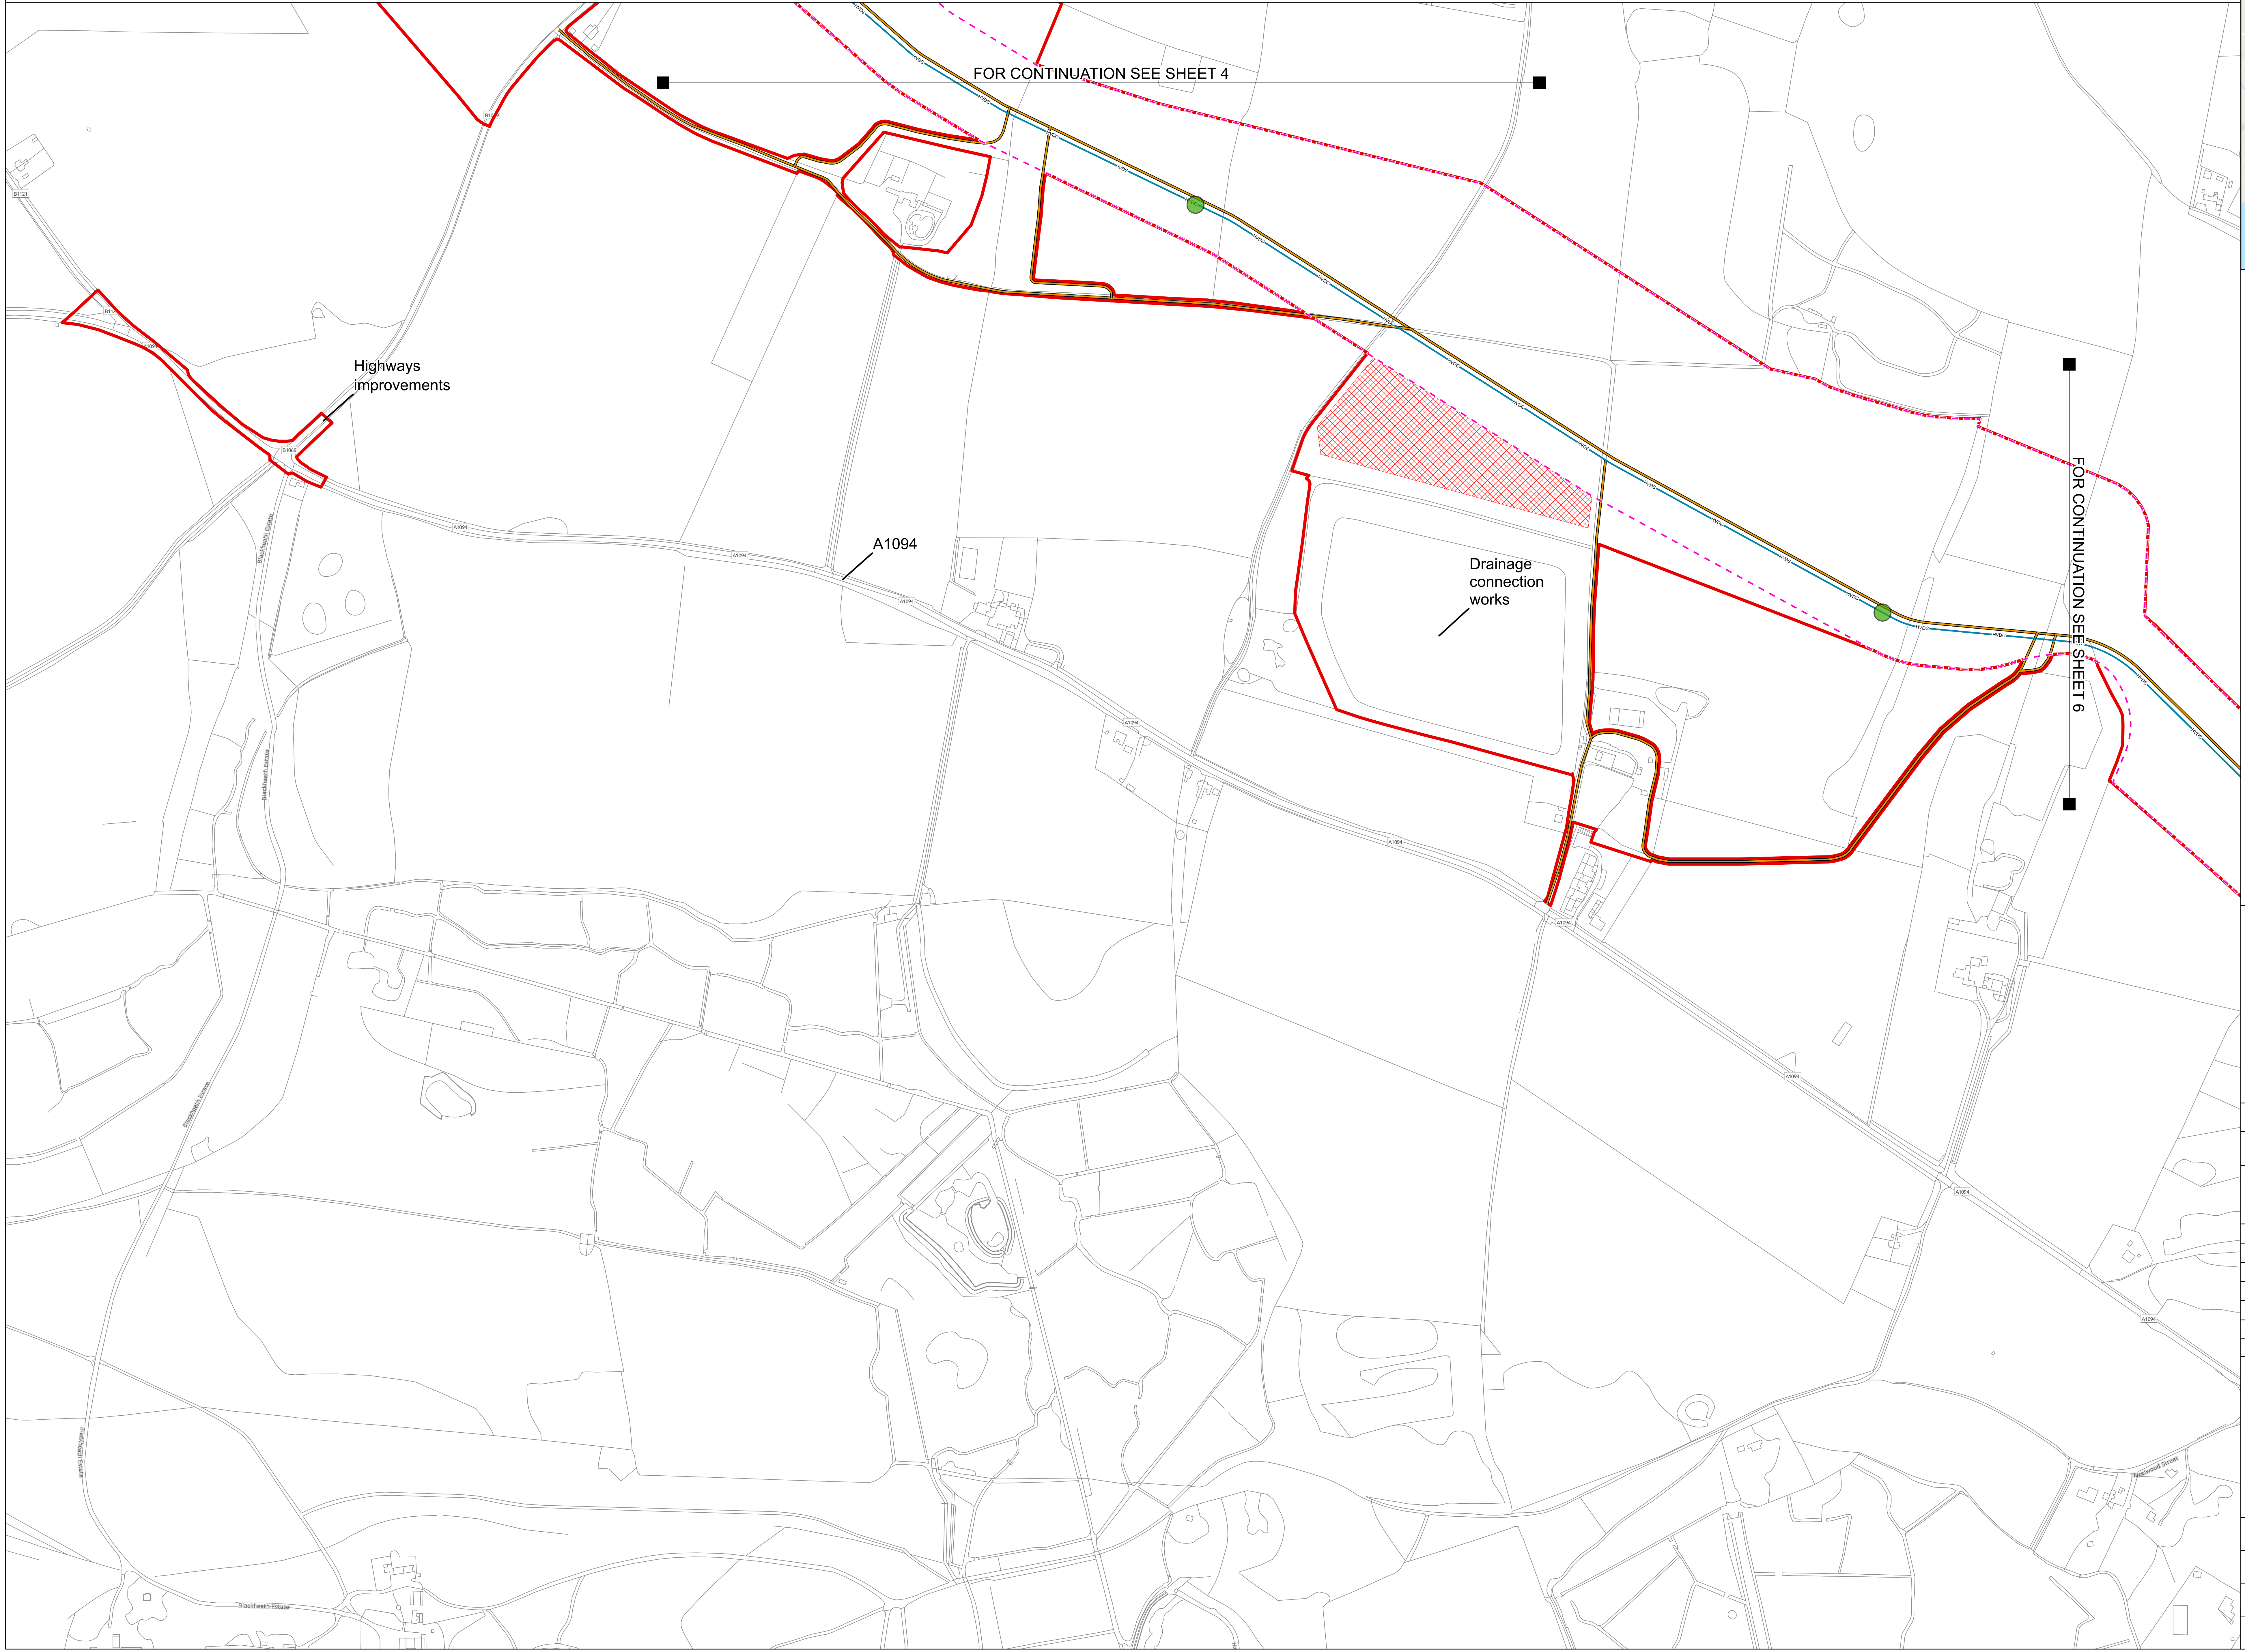

- Legend**
- ▬ Draft Order Limits
 - - - Cable Limit of Deviation (LoD)
 - Proposed joint bay
 - ▬ Proposed access route
 - ▬ Proposed High Voltage Direct Current (HVDC) cable alignment
 - ▨ Proposed construction compound

- Notes**
For statutory consultation purposes only.
1. This plan is scaled at paper size A0, therefore any prints taken at smaller sizes will affect accuracy of the measurement units and should not be scaled against.
 2. These plans show the Draft Order Limits and cable alignment and potential pylon locations. Due to the need for future flexibility, National Grid will be applying for Order Limits and Limits of Deviation within its Development Consent Order, within which any final alignment (including pylon locations) would lie. Therefore the cable alignment and pylon locations should be treated as indicative only. Further information is provided in our 'Guide to interacting with our consultation plans' document.
 3. The Permanent access LoD is only shown where permanent access routes fall outside of the Cable LoD.
 4. Access routes shown are a combination of primary construction accesses, mobilisation accesses, and monitoring and maintenance accesses.
 5. For further information on construction please refer to the construction section of the Preliminary Environmental Impact Report, Volume 1, Part 1, Chapter 4.

Coordinate System: British National Grid
 Sheet X Centroid Coordinate: 642931 Sheet Y Centroid Coordinate: 258875 42187



BACKGROUND MAPPING INFORMATION HAS BEEN REPRODUCED FROM THE ORDNANCE SURVEY BY PERMISSION OF ORDNANCE SURVEY OF THE CONTROLLER OF HIS MAJESTY'S STATIONERY OFFICE. CROWN COPYRIGHT ORDNANCE SURVEY © - 100024241. BLUESKY INTERNATIONAL LTD © NATIONAL GRID ELECTRICITY. ESRI COMMUNITY MAPS CONTRIBUTORS: ESRI UK, ESRI, HERE, GARMIN, FOUR SQUARE, GEOTECHNOLOGIES, INC, METINKSA, USGS

Issue	Date	Remarks	Drawn	Checked	Approved
A	31/08/23	Final	JF	SC	JW


THE NATIONAL GRID ELECTRICITY TRANSMISSION PLC (SEA LINK) ORDER
 GENERAL ARRANGEMENT PLAN SERIES FOR CONSULTATION
 SHEET 5 OF 7
 SUFFOLK

nationalgrid



Application Number: EN020026

National Grid Drawing Reference: S42_S/IGA/PS/0005

Scale	Sheet Size	Sheet	Issue
1:2,500	A0	SHEET 5 OF 7	A

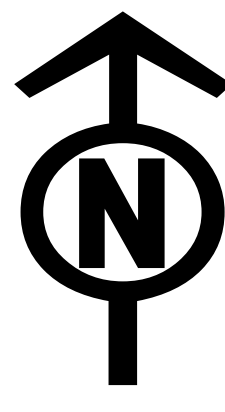

THE NATIONAL GRID ELECTRICITY TRANSMISSION PLC (SEA LINK) ORDER
 GENERAL ARRANGEMENT PLAN SERIES FOR CONSULTATION
 SHEET 6 OF 7
 SUFFOLK
 SUFFOLK COUNTY COUNCIL, EAST SUFFOLK DISTRICT COUNCIL

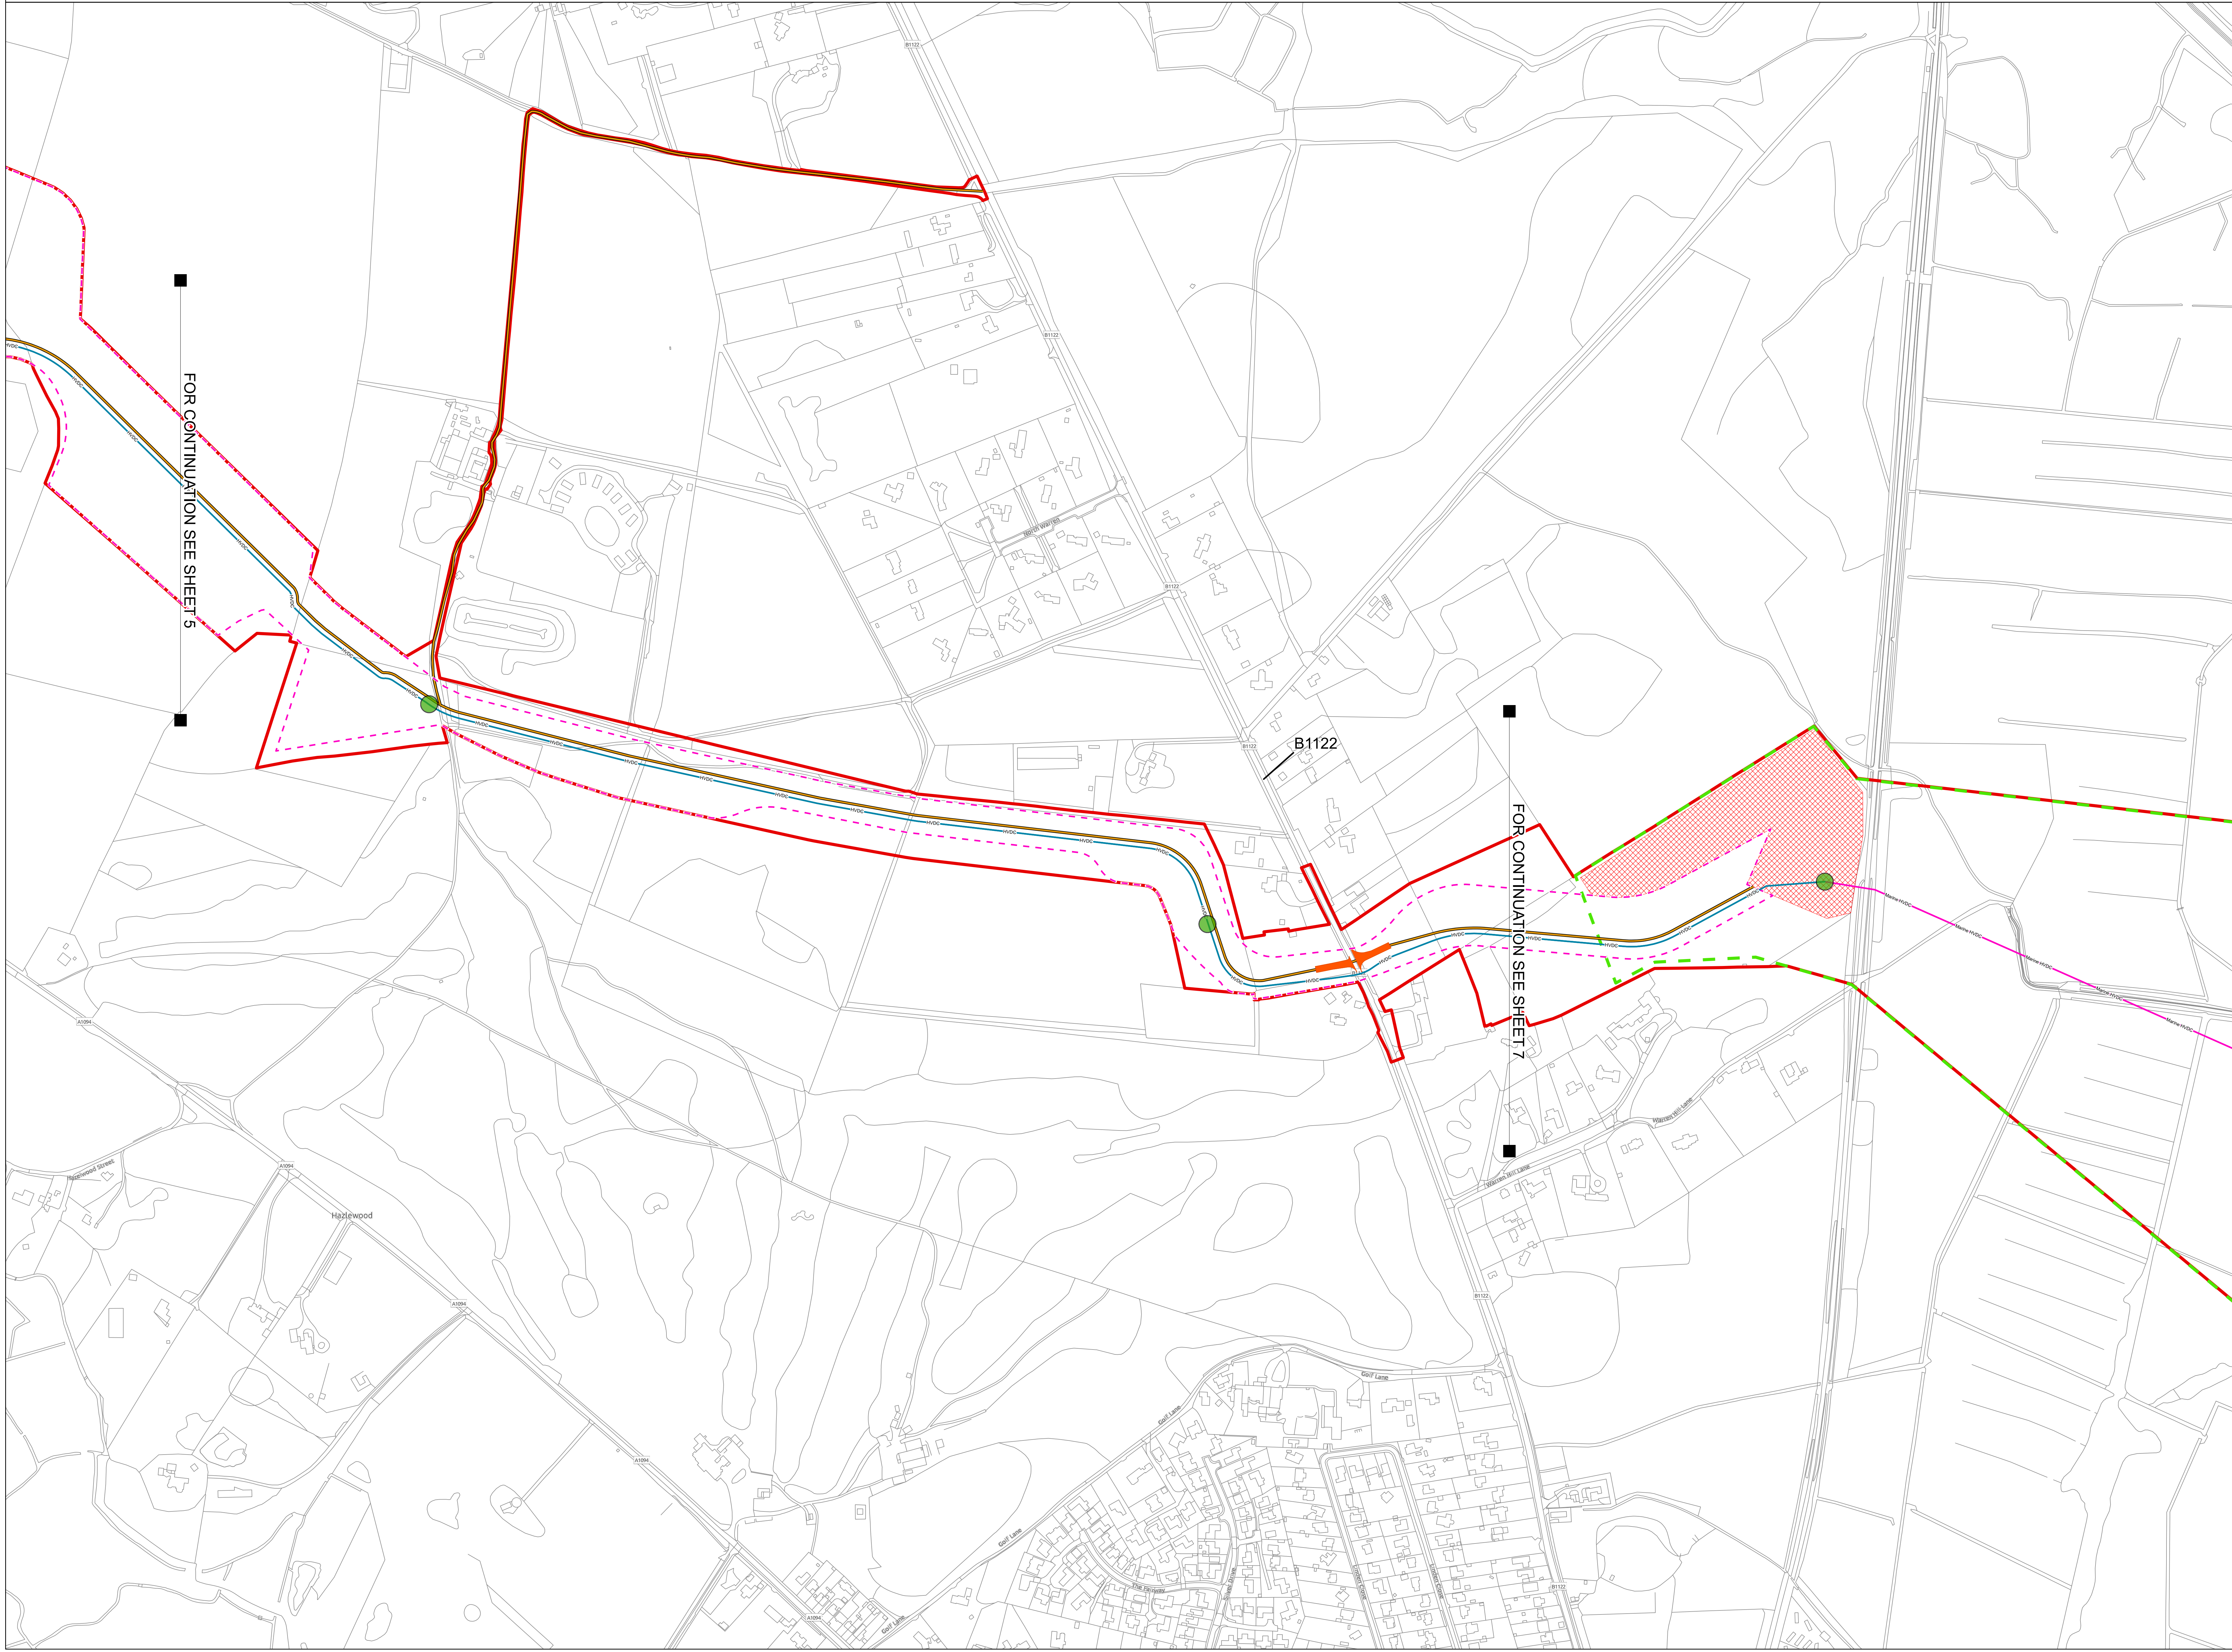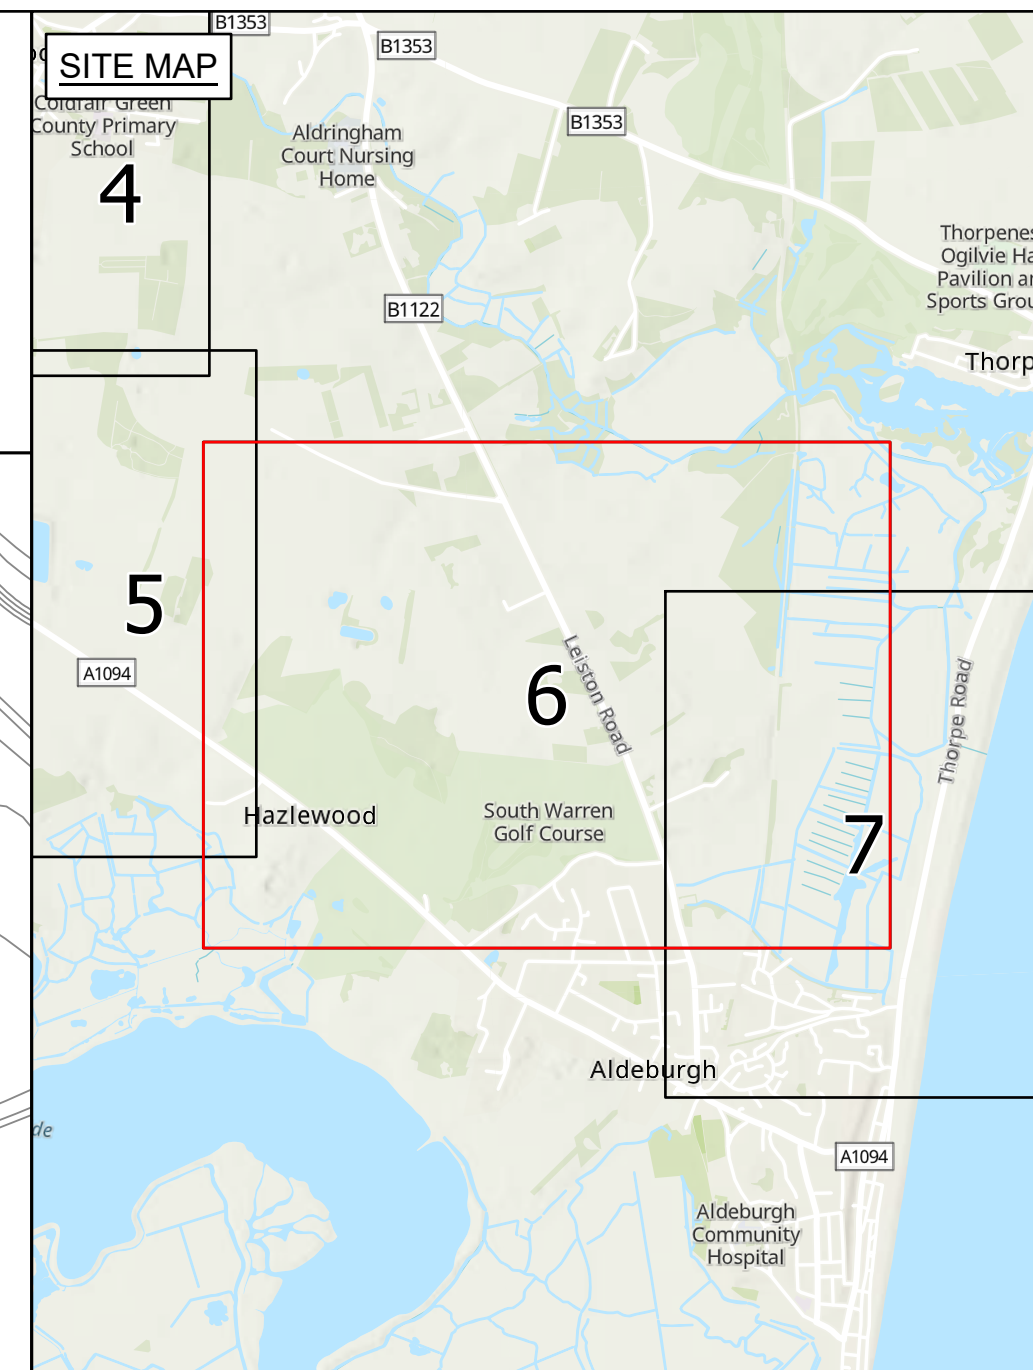

- Legend**
- Draft Order Limits
 - - - Cable Limit of Deviation (LoD)
 - - - Marine Limit of Deviation (LoD)
 - Proposed joint bay
 - Proposed access route
 - Proposed High Voltage Direct Current (HVDC) cable alignment
 - Proposed marine High Voltage Direct Current (HVDC) cable alignment
 - ▨ Proposed construction compound
 - ▨ Proposed temporary bellmouth

Notes
For statutory consultation purposes only.
 1. This plan is scaled at paper size A0, therefore any prints taken at smaller sizes will affect accuracy of the measurement units and should not be scaled against.
 2. These plans show the Draft Order Limits and cable alignment and potential pylon locations. Due to the need for future flexibility, National Grid will be applying for Order Limits and Limits of Deviation within its Development Consent Order, within which any final alignment (including pylon locations) would lie. Therefore the cable alignment and pylon locations should be treated as indicative only. Further information is provided in our 'Guide to interacting with our consultation plans' document.
 3. The Permanent access LoD is only shown where permanent access routes fall outside of the Cable LoD.
 4. Access routes shown are a combination of primary construction accesses, mobilisation accesses, and monitoring and maintenance accesses.
 5. For further information on construction please refer to the construction section of the Preliminary Environmental Impact Report, Volume 1, Part 1, Chapter 4.

Coordinate System: British National Grid
 Sheet X Centroid Coordinate: 645296.3125 Sheet Y Centroid Coordinate: 258534.9375



BACKGROUND MAPPING INFORMATION HAS BEEN REPRODUCED FROM THE ORDNANCE SURVEY BY PERMISSION OF ORDNANCE SURVEY OF THE CONTROLLER OF HIS MAJESTY'S STATIONERY OFFICE. CROWN COPYRIGHT ORDNANCE SURVEY © 100024241. BLUEBERRY INTERNATIONAL LTD © NATIONAL GRID ELECTRICITY. ESRI COMMUNITY MAPS CONTRIBUTORS: ESRI UK, ESRI, HERE, GARMIN, FOUR SQUARE, GEOTECHNOLOGIES, INC, METIUNASA, USGS

Issue	Date	Remarks	Drawn	Checked	Approved
A	31/08/23	Final	JF	SC	JW


THE NATIONAL GRID ELECTRICITY TRANSMISSION PLC
 (SEA LINK) ORDER
 GENERAL ARRANGEMENT PLAN SERIES
 FOR CONSULTATION
 SHEET 6 OF 7
 SUFFOLK

nationalgrid



Application Number: EN020026

National Grid Drawing Reference: S42_S/IGA/PS/0006

Scale	Sheet Size	Sheet	Issue
1:2,500	A0	SHEET 6 OF 7	A

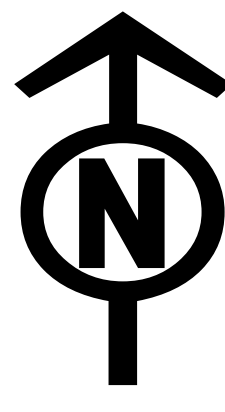

THE NATIONAL GRID ELECTRICITY TRANSMISSION PLC (SEA LINK) ORDER
 GENERAL ARRANGEMENT PLAN SERIES FOR CONSULTATION
 SHEET 7 OF 7
 SUFFOLK
 SUFFOLK COUNTY COUNCIL, EAST SUFFOLK DISTRICT COUNCIL

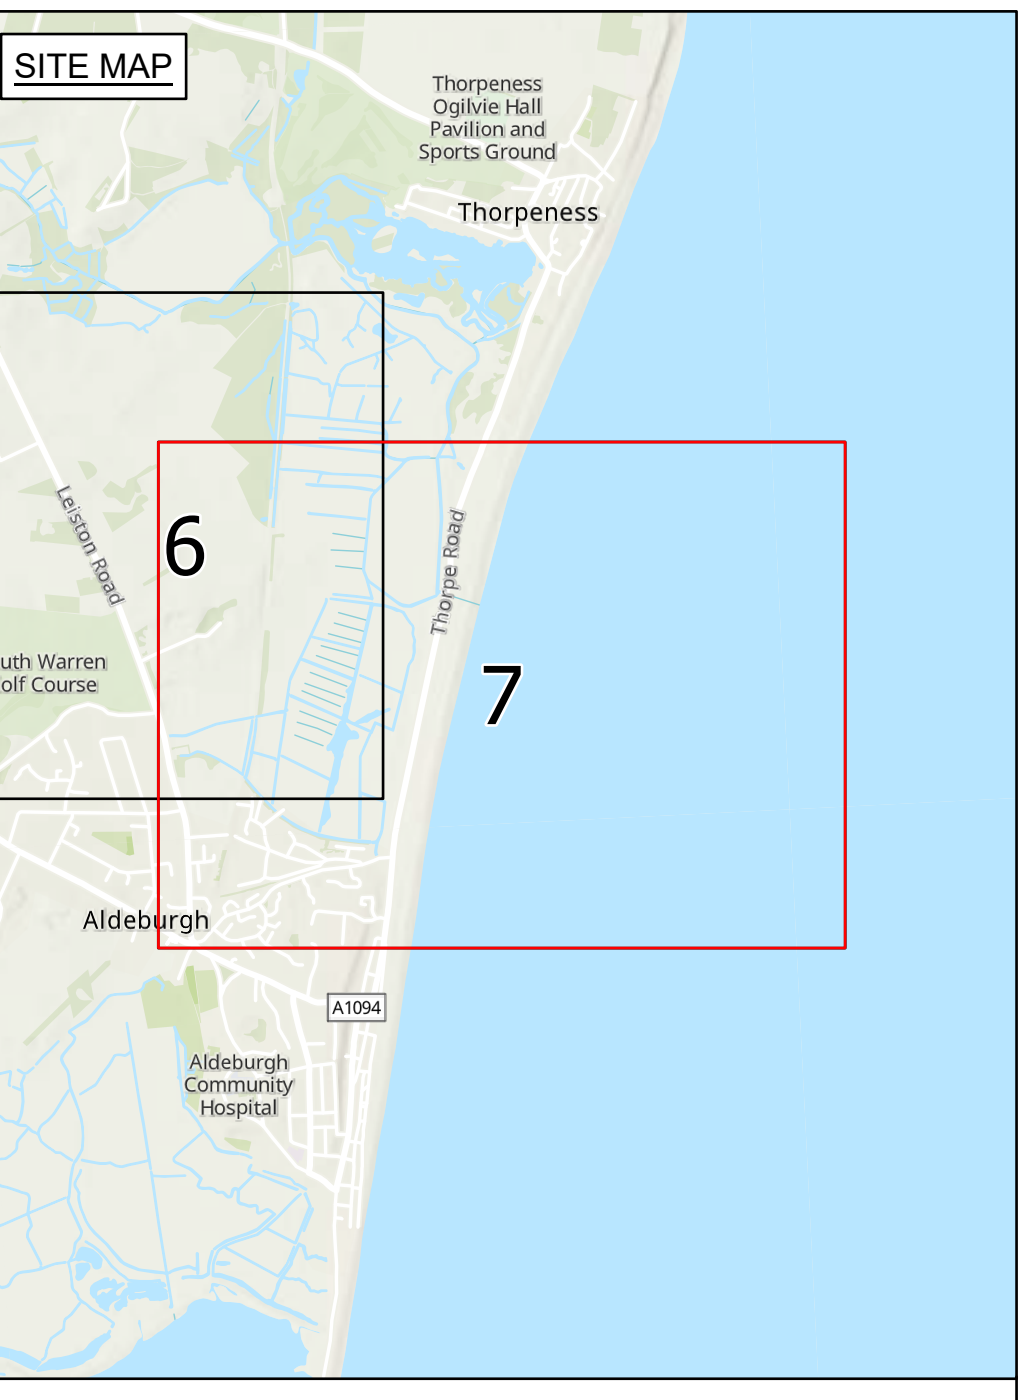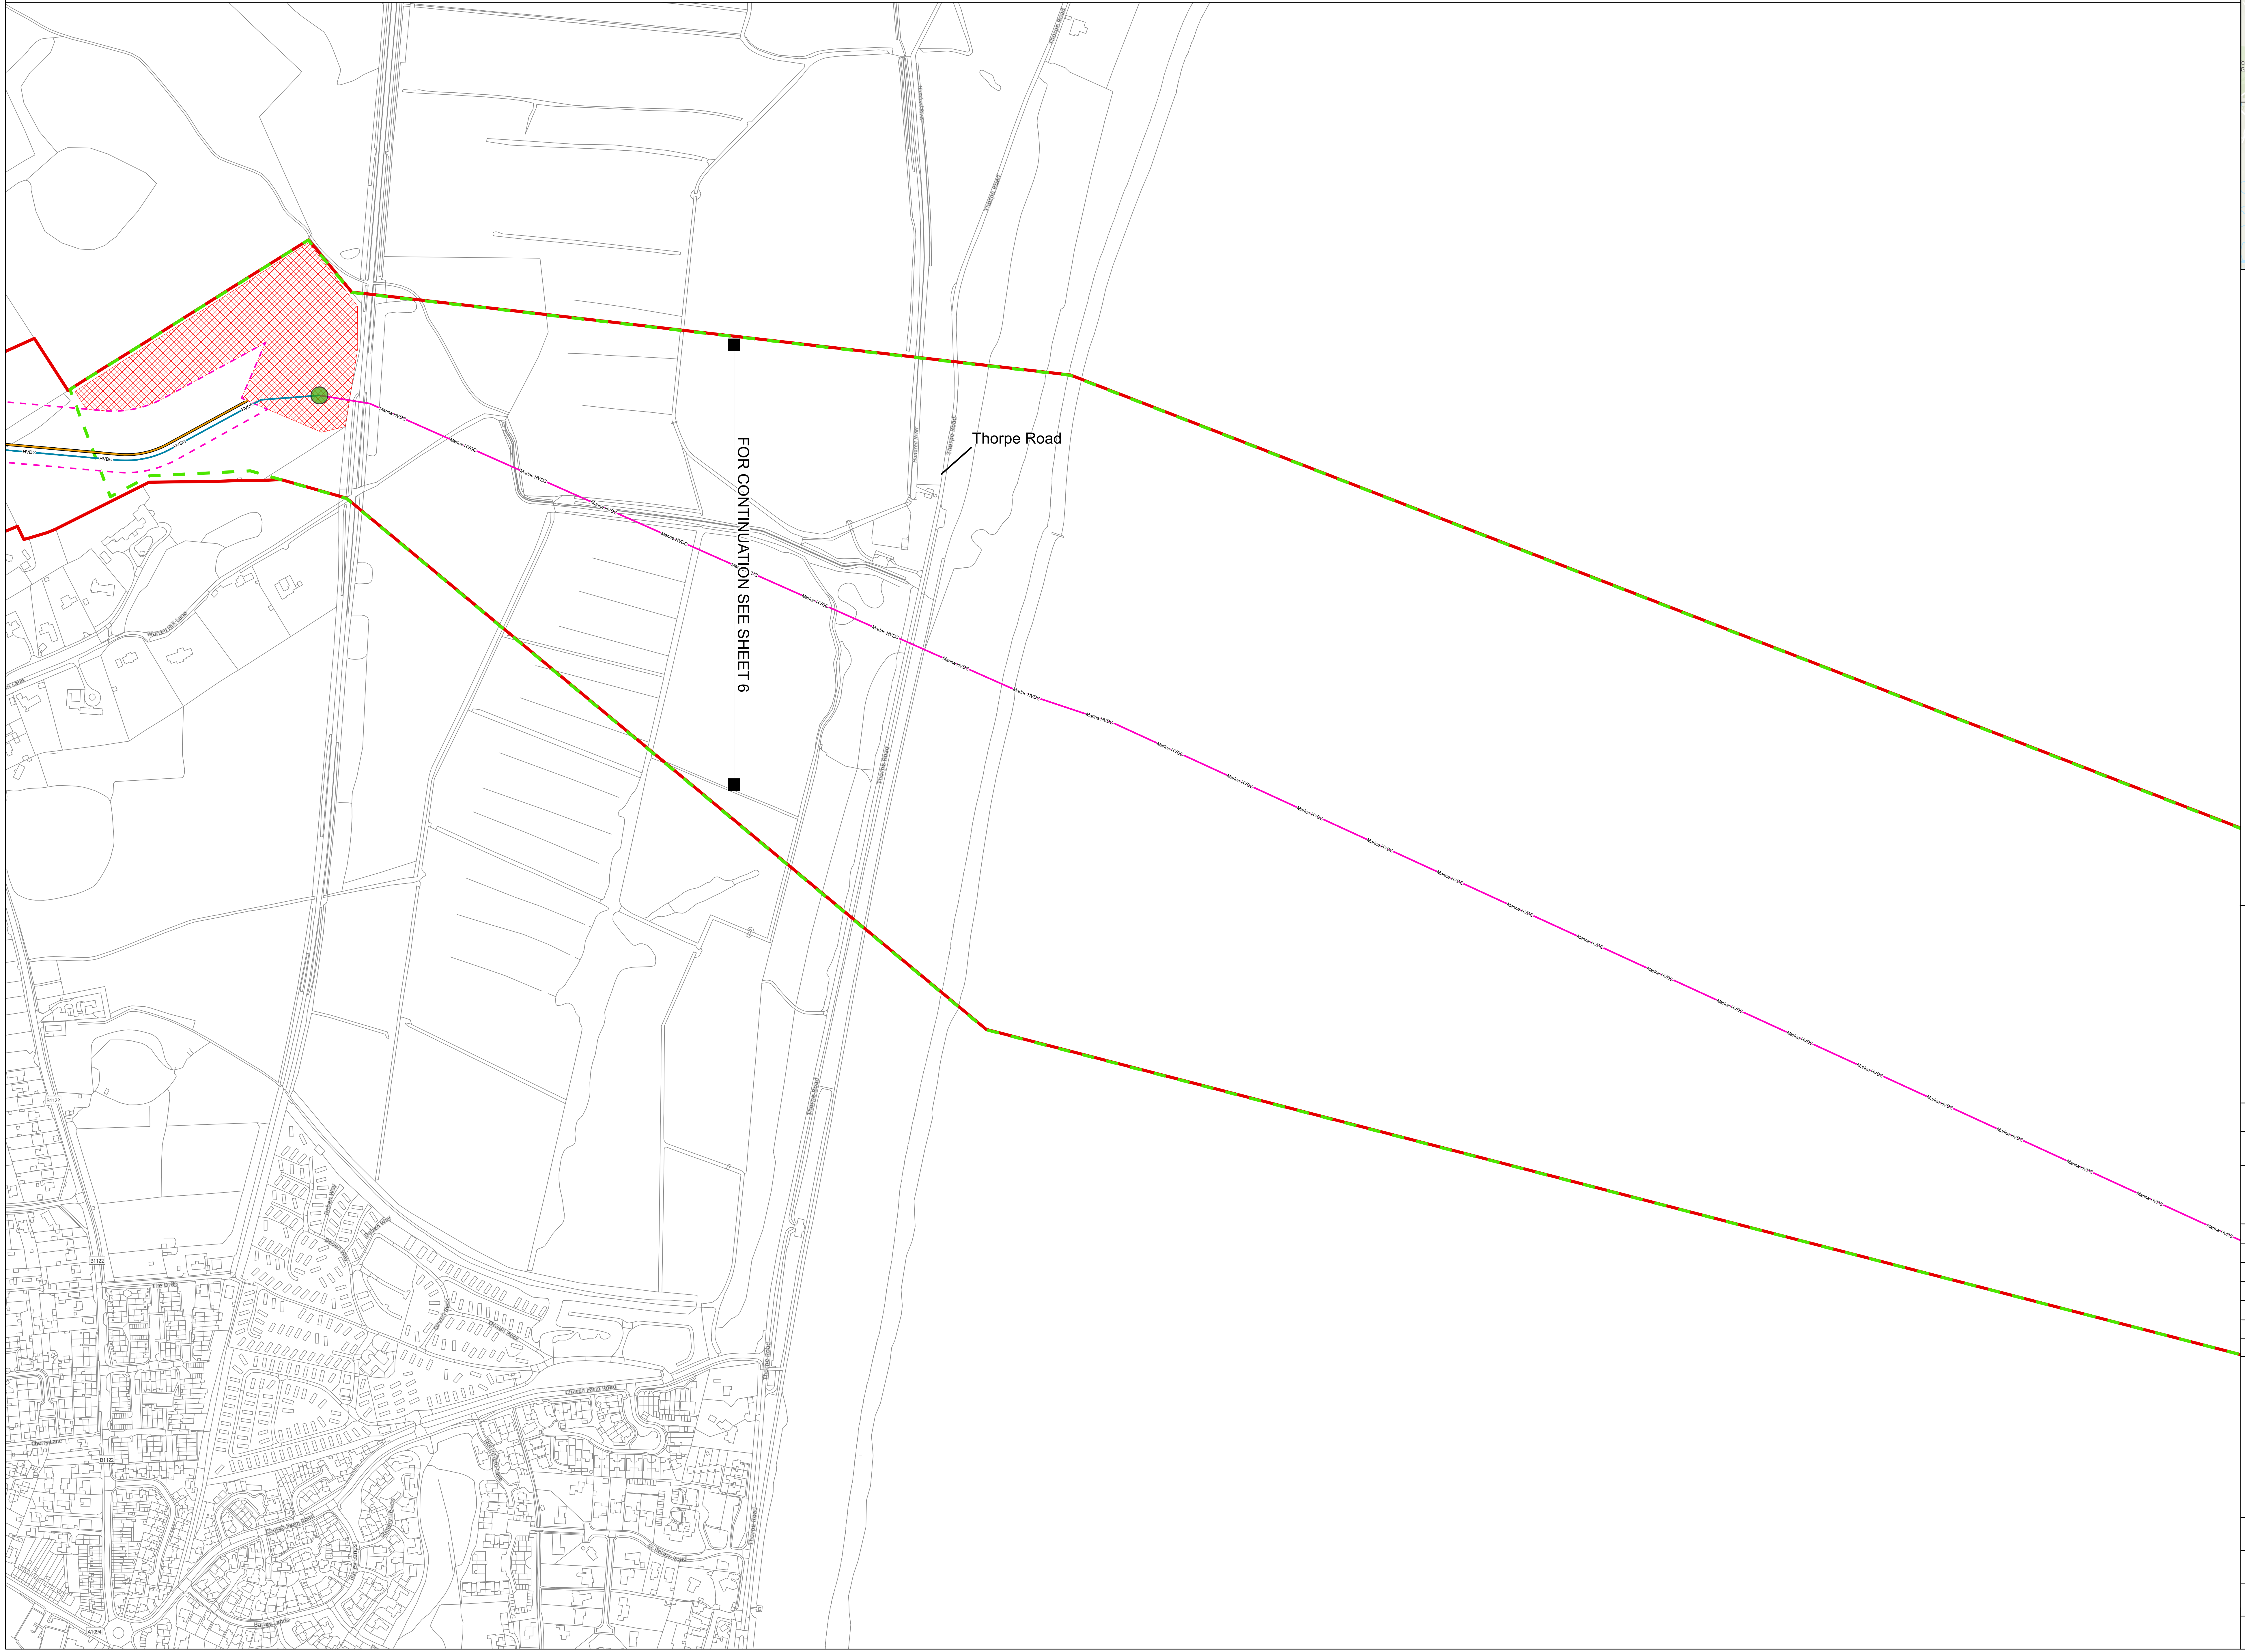

Legend

- ▭ Draft Order Limits
- - - Cable Limit of Deviation (LoD)
- - - Marine Limit of Deviation (LoD)
- Proposed joint bay
- Proposed access route
- Proposed High Voltage Direct Current (HVDC) cable alignment
- Proposed marine High Voltage Direct Current (HVDC) cable alignment
- ▨ Proposed construction compound

Notes
For statutory consultation purposes only.

- This plan is scaled at paper size A0, therefore any prints taken at smaller sizes will affect accuracy of the measurement units and should not be scaled against.
- These plans show the Draft Order Limits and cable alignment and potential pylon locations. Due to the need for future flexibility, National Grid will be applying for Order Limits and Limits of Deviation within its Development Consent Order, within which any final alignment (including pylon locations) would lie. Therefore the cable alignment and pylon locations should be treated as indicative only. Further information is provided in our 'Guide to interacting with our consultation plans' document.
- The Permanent access LoD is only shown where permanent access routes fall outside of the Cable LoD.
- Access routes shown are a combination of primary construction accesses, mobilisation accesses, and monitoring and maintenance accesses.
- For further information on construction please refer to the construction section of the Preliminary Environmental Impact Report, Volume 1, Part 1, Chapter 4.

Coordinate System: British National Grid
 Sheet X Centroid Coordinate: 647021.1675 Sheet Y Centroid Coordinate: 257977.79687



BACKGROUND MAPPING INFORMATION HAS BEEN REPRODUCED FROM THE ORDNANCE SURVEY BY PERMISSION OF ORDNANCE SURVEY OF THE CONTROLLER OF HIS MAJESTY'S STATIONERY OFFICE. CROWN COPYRIGHT ORDNANCE SURVEY © - 100024241. BLUEBERRY INTERNATIONAL LTD © NATIONAL GRID ELECTRICITY. ESRI COMMUNITY MAPS CONTRIBUTORS, ESRI UK, ESRI, HERE, GARMIN, COURTSQUARE, GEOTECHNOLOGIES, INC, METINKASA, USGS

Issue	Date	Remarks	Drawn	Checked	Approved
A	31/08/23	Final	JF	SC	JW

Title
 THE NATIONAL GRID ELECTRICITY TRANSMISSION PLC (SEA LINK) ORDER
 GENERAL ARRANGEMENT PLAN SERIES FOR CONSULTATION
 SHEET 7 OF 7
 SUFFOLK




Application Number: EN020026
 National Grid Drawing Reference: S42_S/IGA/PS/0007

Scale	Sheet Size	Sheet	Issue
1:2,500	A0	SHEET 7 OF 7	A



03. Suffolk Onshore Scheme – Converter colocation

Section	Scheme	Plan Type/ Drawing Numbers
03	Suffolk Onshore Scheme – Converter colocation	General Arrangement Plan – Colocation: S42_S/IGA/SS/0008

To assist with understanding these plans please see the **Guide to Interacting with the Consultation Plans and Drawings**

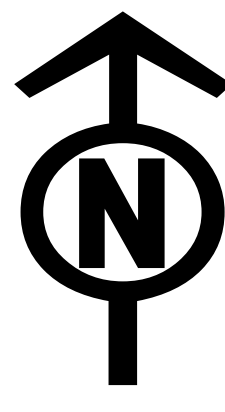

THE NATIONAL GRID ELECTRICITY TRANSMISSION PLC (SEA LINK) ORDER
 GENERAL ARRANGEMENT PLAN FOR CONSULTATION
 SHEET 1 OF 1
 SUFFOLK COLOCATION OF CONVERTER STATIONS
 SUFFOLK COUNTY COUNCIL, EAST SUFFOLK DISTRICT COUNCIL

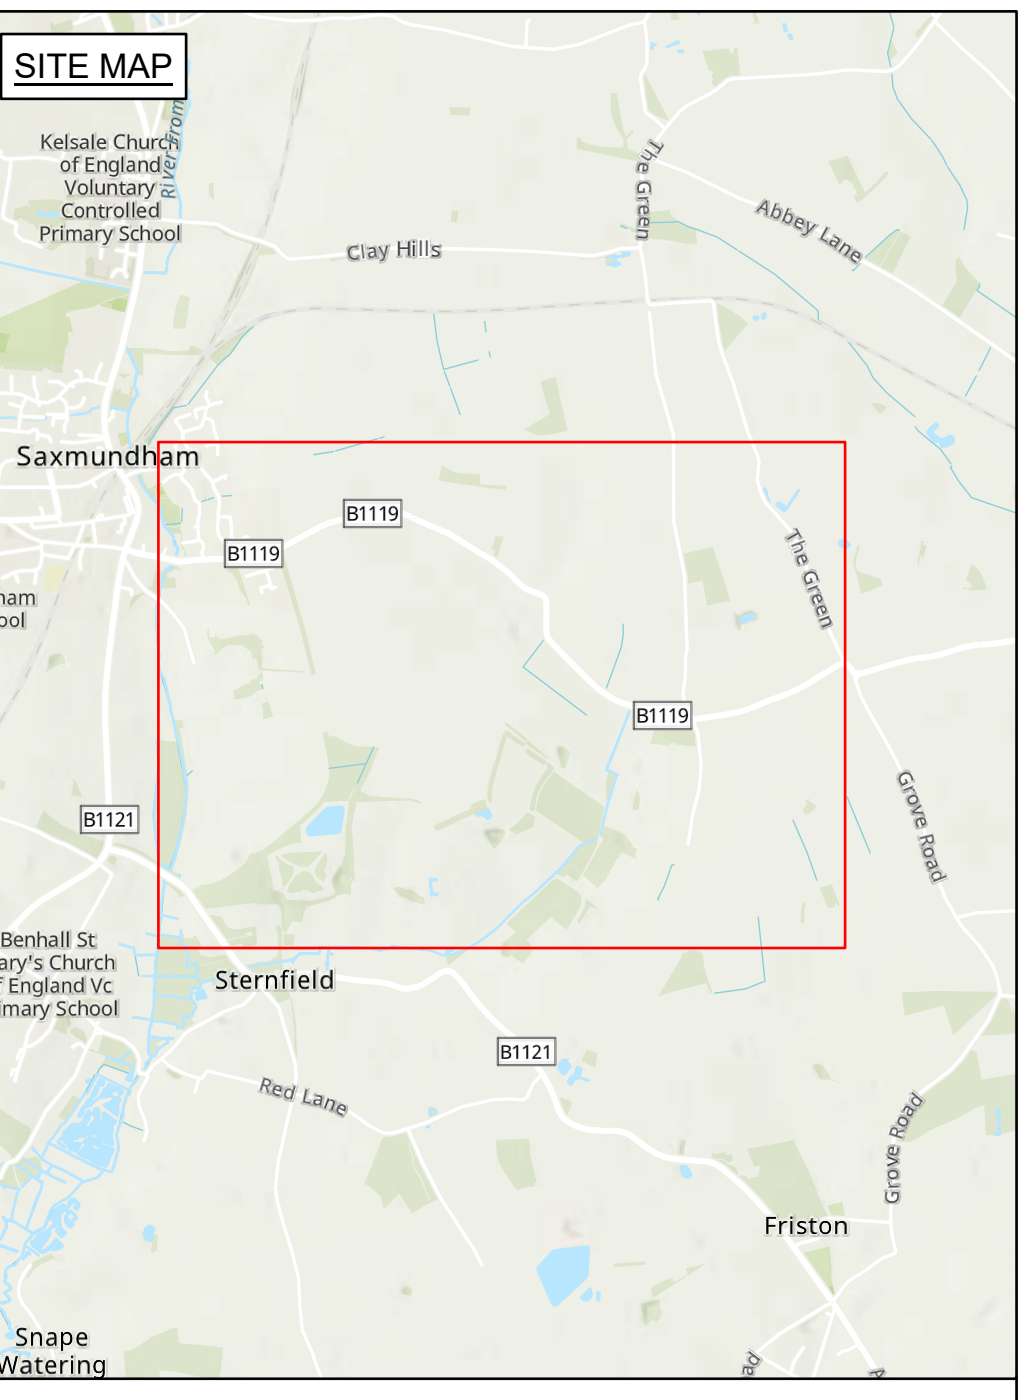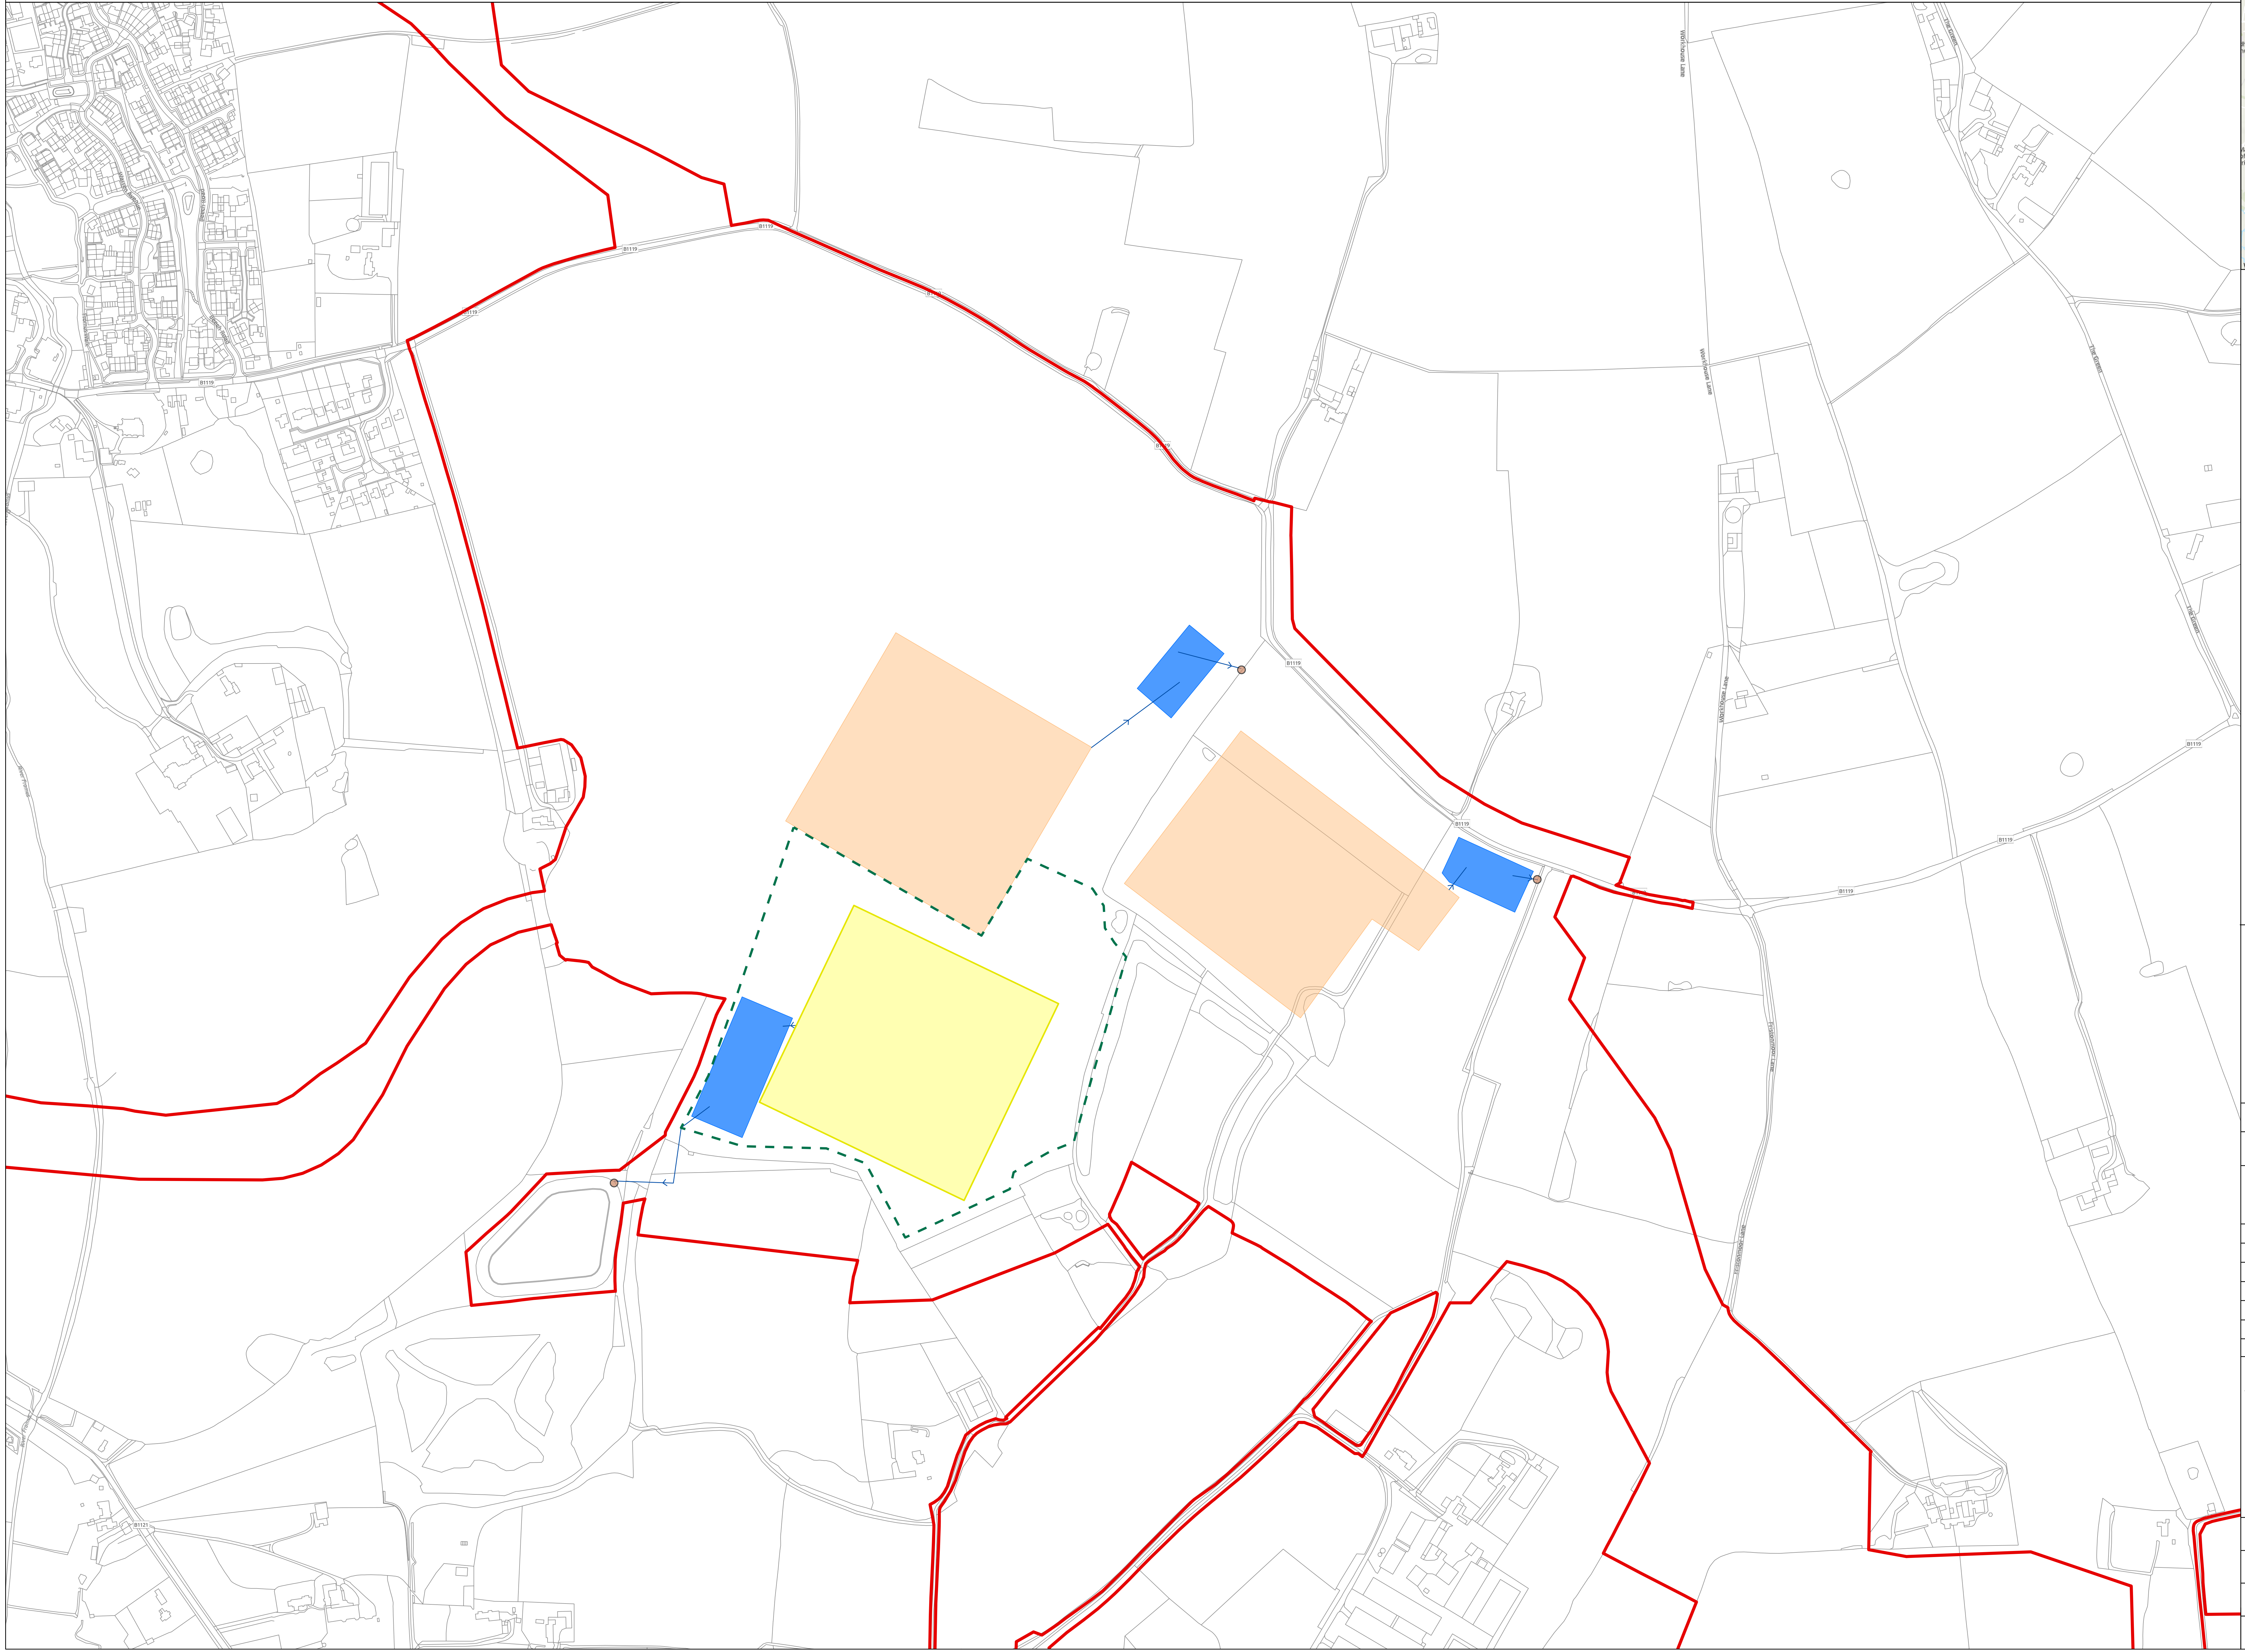

- Legend**
- ▬ Draft Order Limits
 - ▬ Sea Link - Proposed converter station Limit of Deviation (LoD)
 - Collocation - Proposed permanent outfall
 - ▬ Collocation - Proposed permanent attenuation outfall pipe
 - Sea Link - Proposed converter station
 - Collocation - Proposed converter station options
 - Collocation - Proposed permanent attenuation pond (includes 5 metre buffer)

Notes
For statutory consultation purposes only.

1. This plan is scaled at paper size A0, therefore any prints taken at smaller sizes will affect accuracy of the measurement units and should not be scaled against.
2. These plans show the Draft Order Limits and cable alignment and potential pylon locations. Due to the need for future flexibility, National Grid will be applying for Order Limits and Limits of Deviation within its Development Consent Order, within which any final alignment (including pylon locations) would lie. Therefore the cable alignment and pylon locations should be treated as indicative only. Further information is provided in our 'Guide to interacting with our consultation plans' document.
3. For further information on construction please refer to the construction section of the Preliminary Environmental Impact Report, Volume 1, Part 1, Chapter 4.
4. Sea Link - Proposed converter station Limit of Deviation (LoD) is illustrative only.

Coordinate System: British National Grid
 Sheet X Centroid Coordinate: 640035.93 Sheet Y Centroid Coordinate: 262464.40



BACKGROUND MAPPING INFORMATION HAS BEEN REPRODUCED FROM THE ORDNANCE SURVEY BY PERMISSION OF ORDNANCE SURVEY OF THE CONTROLLER OF HIS MAJESTY'S STATIONERY OFFICE. CROWN COPYRIGHT ORDNANCE SURVEY © 100024241. BLUEBERRY INTERNATIONAL LTD © NATIONAL GRID ELECTRICITY. ESRI COMMUNITY MAPS CONTRIBUTORS, ESRI UK, ESRI, HERE, GARMIN, FOUR SQUARE, GEOTECHNOLOGIES, INC, METIUNASA, USGS

Issue	Date	Remarks	Drawn	Checked	Approved
A	31/08/23	Final	JF	SC	JW

THE NATIONAL GRID ELECTRICITY TRANSMISSION PLC
 (SEA LINK) ORDER
 GENERAL ARRANGEMENT PLAN
 FOR CONSULTATION
 SHEET 1 OF 1
 SUFFOLK COLOCATION OF CONVERTER STATIONS

nationalgrid

Application Number: EN020026


National Grid Drawing Reference: S42_S/IGA/SS/0008

Scale	Sheet Size	Sheet	Issue
1:2,500	A0	SHEET 1 OF 1	A

04. Kent Onshore Scheme

Section	Scheme	Plan Type/ Drawing Numbers
04	Kent Onshore Scheme	Location Plan: S42_K/OLP/SS/2001 Key Plan: S42_K/MKP/SS/2001 General Arrangement Plans: S42_K/IGA/PS/2001 S42_K/IGA/PS/2002 S42_K/IGA/PS/2003 S42_K/IGA/PS/2004

To assist with understanding these plans please see the **Guide to Interacting with the Consultation Plans and Drawings**

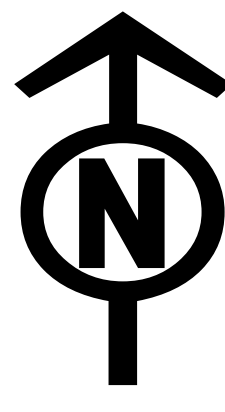

THE NATIONAL GRID ELECTRICITY TRANSMISSION PLC (SEA LINK) ORDER
 LOCATION PLAN FOR CONSULTATION
 SHEET 1 OF 1
 KENT
 KENT COUNTY COUNCIL, DOVER DISTRICT COUNCIL, THANET DISTRICT COUNCIL

SITE MAP



Legend

Draft Order Limits

Notes
For statutory consultation purposes only.

1. This plan is scaled at paper size A0, therefore any prints taken at smaller sizes will affect accuracy of the measurement units and should not be scaled against.
2. These plans show the Draft Order Limits and cable alignment and potential pylon locations. Due to the need for future flexibility, National Grid will be applying for Order Limits and Limits of Deviation within its Development Consent Order, within which any final alignment (including pylon locations) would lie. Therefore the cable alignment and pylon locations should be treated as indicative only. Further information is provided in our 'Guide to interacting with our consultation plans' document.
3. For further information on construction please refer to the construction section of the Preliminary Environmental Impact Report, Volume 1, Part 1, Chapter 4.

Coordinate System: British National Grid
 Sheet X Centroid Coordinate: N/A Sheet Y Centroid Coordinate: N/A



BACKGROUND MAPPING INFORMATION HAS BEEN REPRODUCED FROM THE ORDINANCE SURVEY BY PERMISSION OF ORDINANCE SURVEY OF THE CONTROLLER OF HIS MAJESTY'S STATIONERY OFFICE. CROWN COPYRIGHT ORDINANCE SURVEY © - 100024241. BLUEBERRY INTERNATIONAL LTD © NATIONAL GRID ELECTRICITY. ESRI COMMUNITY MAPS CONTRIBUTORS, ESRI UK, ESRI, HERE, GARMIN, FOUR SQUARE, GEOTECHNOLOGIES, INC, METIUNESA, USGS

Issue	Date	Remarks	Drawn	Checked	Approved
A	29/08/23	Final	JF	SC	KJ


THE NATIONAL GRID ELECTRICITY TRANSMISSION PLC
 (SEA LINK) ORDER
 LOCATION PLAN FOR CONSULTATION
 SHEET 1 OF 1
 KENT





Application Number: EN020026

National Grid Drawing Reference: S42_K/OLP/SS/2001

Scale	Sheet Size	Sheet	Issue
1:15,000	A0	SHEET 1 OF 1	A

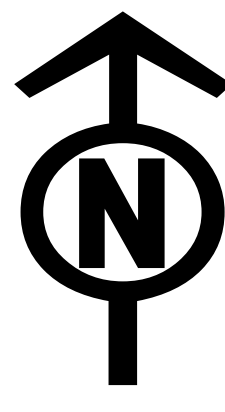

THE NATIONAL GRID ELECTRICITY TRANSMISSION PLC (SEA LINK) ORDER
 MASTER KEY PLAN FOR CONSULTATION
 SHEET 1 OF 1
 KENT
 KENT COUNTY COUNCIL, DOVER DISTRICT COUNCIL, THANET DISTRICT COUNCIL

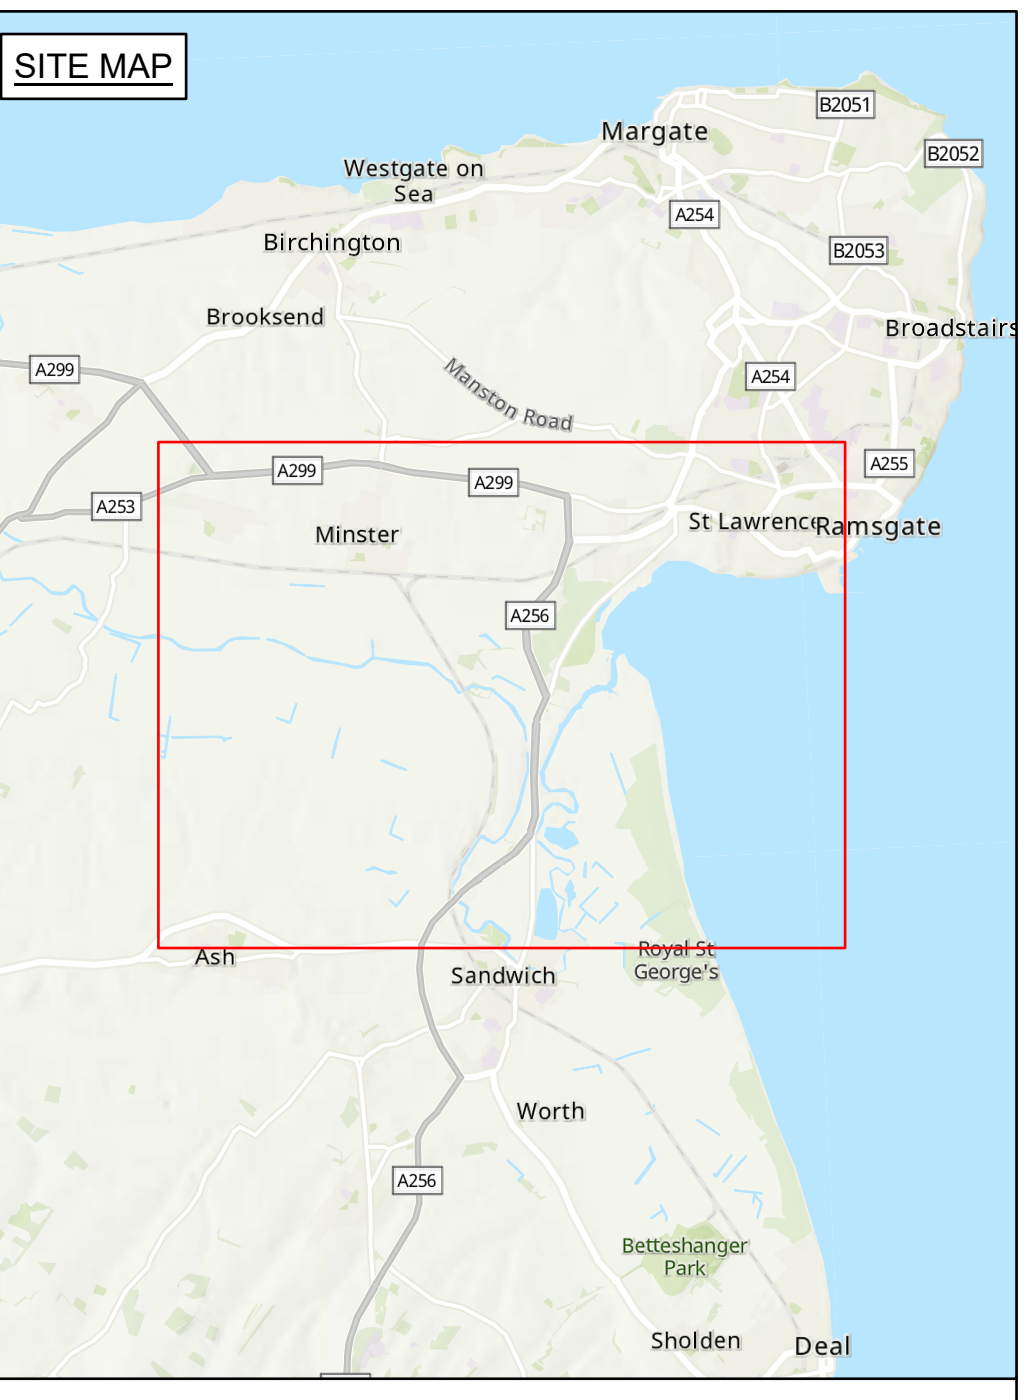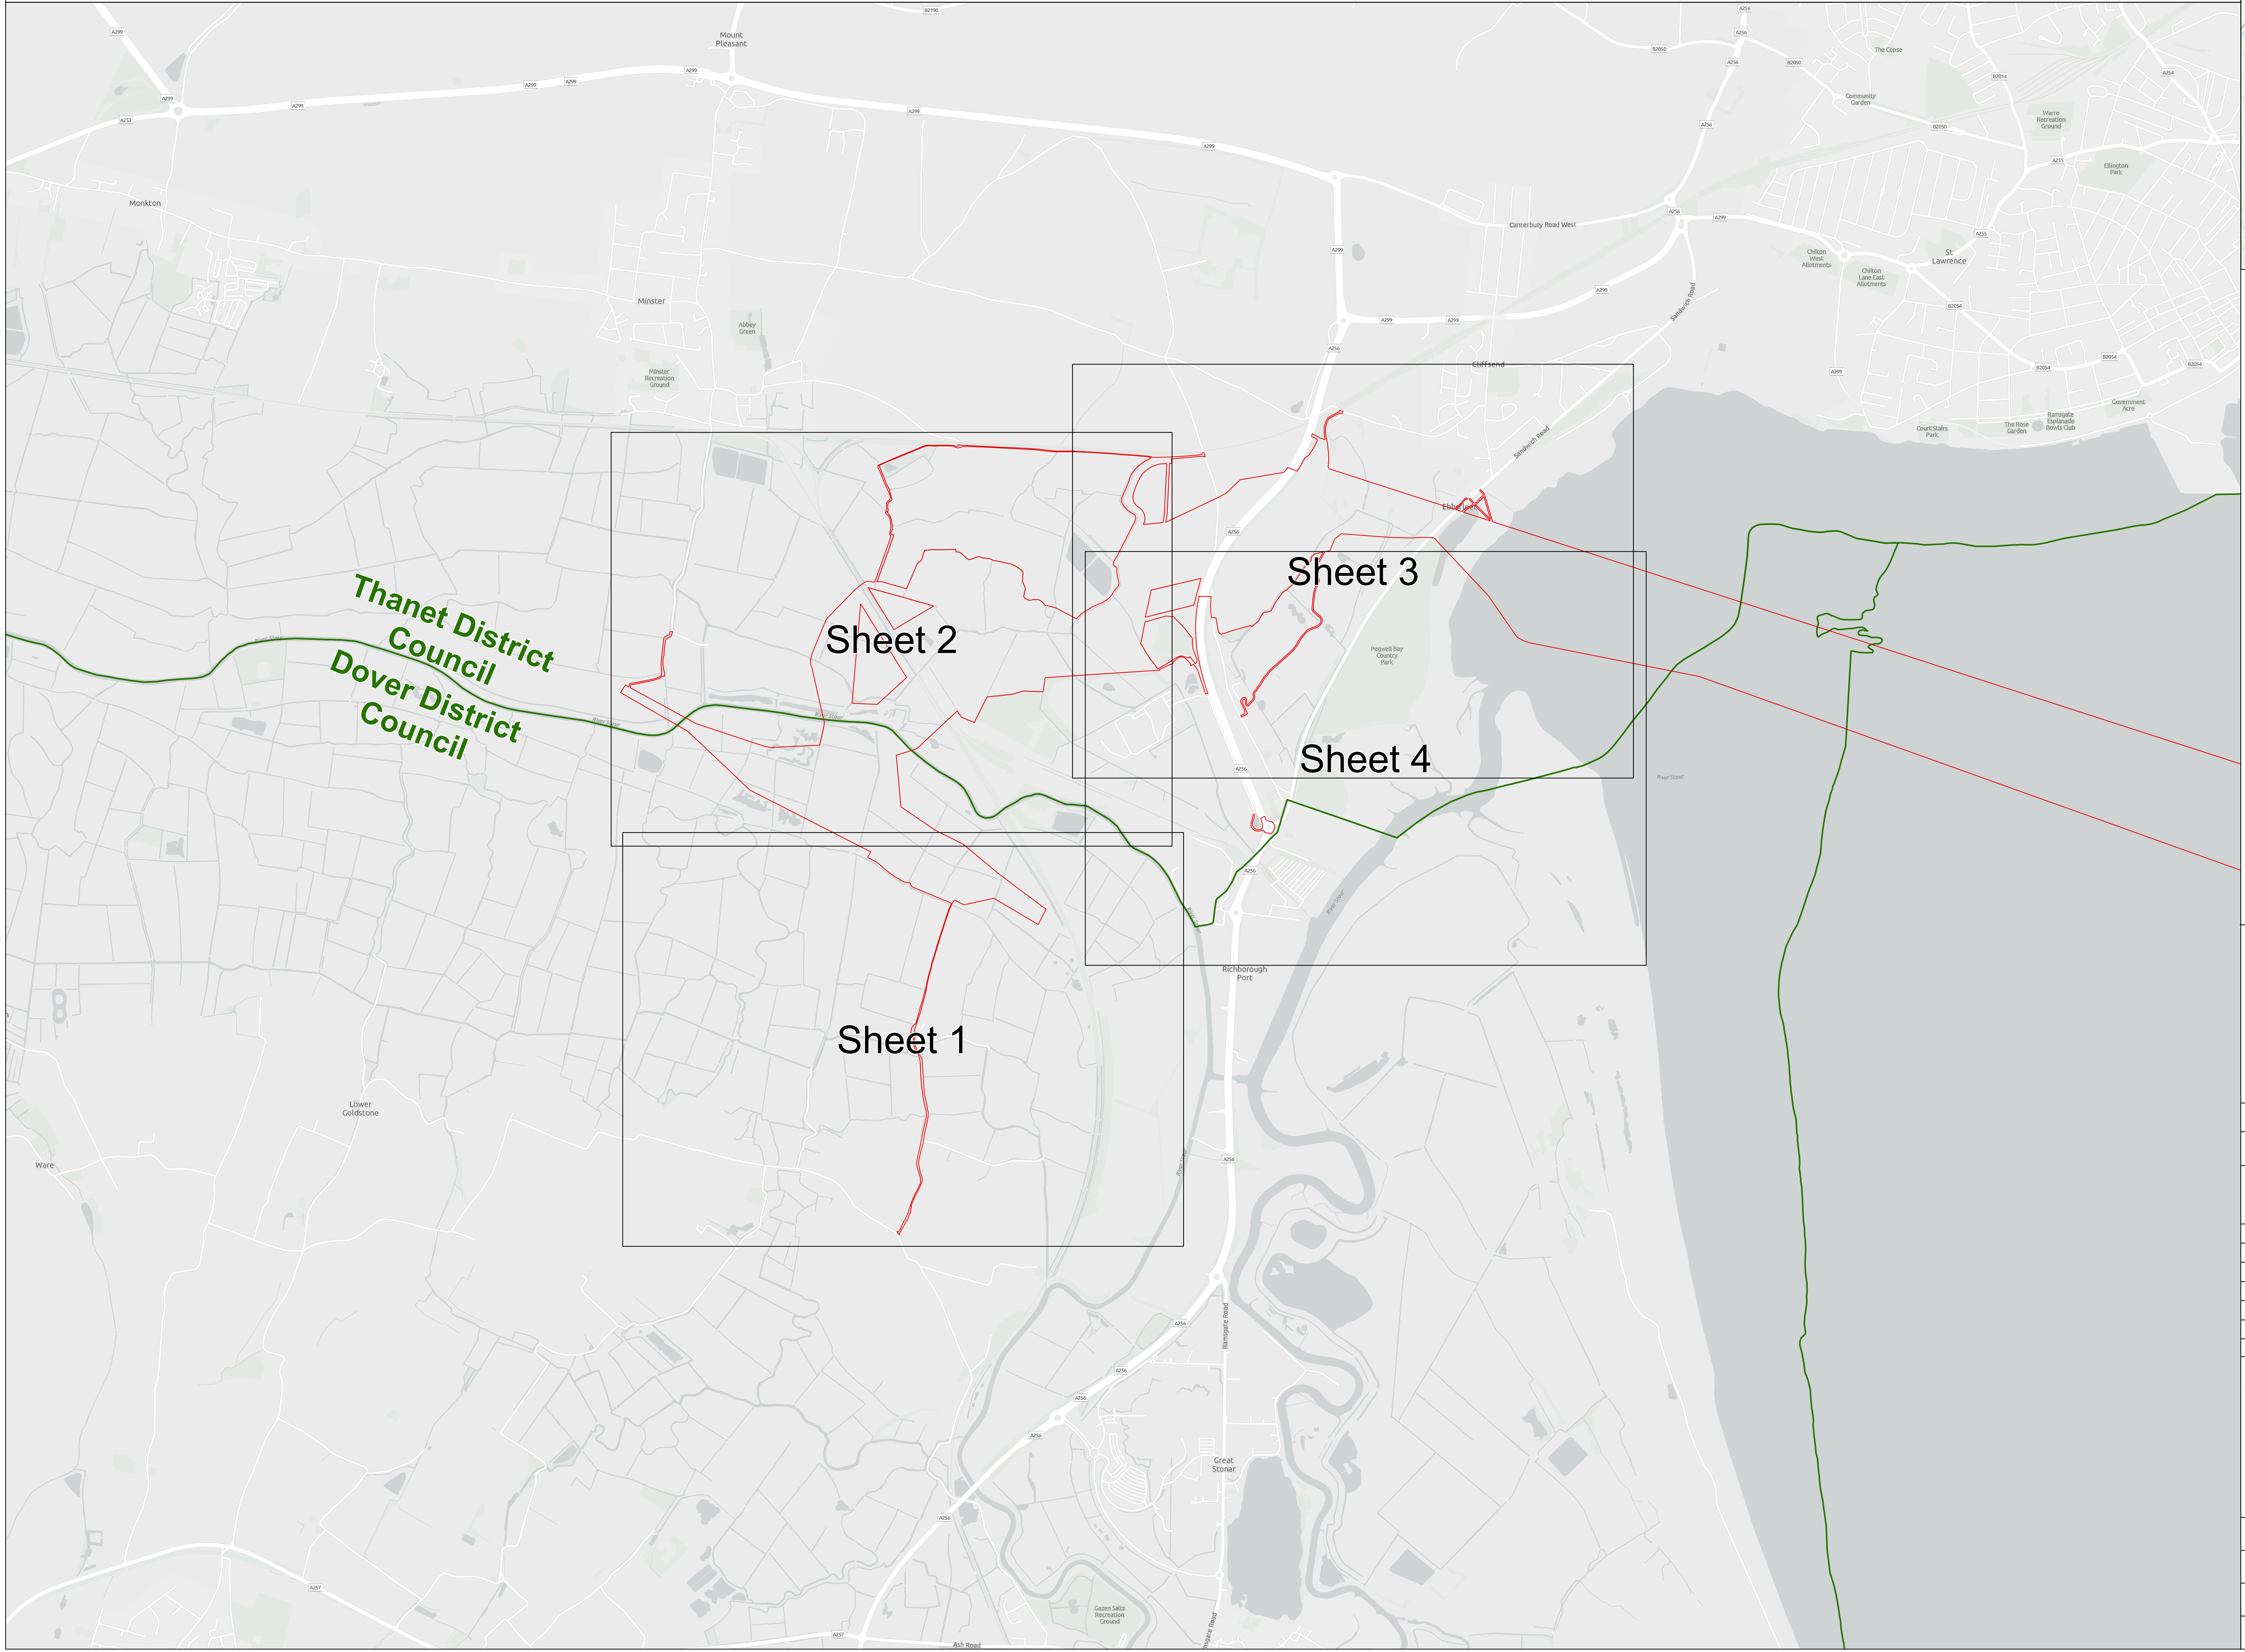

- Legend**
- ▬ Draft Order Limits
 - ▬ District Council boundary
 - Detailed sheet

Thanet District Council
Dover District Council

Sheet 2

Sheet 3

Sheet 4

Sheet 1

Notes
For statutory consultation purposes only.

1. This plan is scaled at paper size A0, therefore any prints taken at smaller sizes will affect accuracy of the measurement units and should not be scaled against.
2. These plans show the Draft Order Limits and cable alignment and potential pylon locations. Due to the need for future flexibility, National Grid will be applying for Order Limits and Limits of Deviation within its Development Consent Order, within which any final alignment (including pylon locations) would lie. Therefore the cable alignment and pylon locations should be treated as indicative only. Further information is provided in our 'Guide to interacting with our consultation plans' document.
3. For further information on construction please refer to the construction section of the Preliminary Environmental Impact Report, Volume 1, Part 1, Chapter 4.

Coordinate System: British National Grid
 Sheet X Centroid Coordinate: NA Sheet Y Centroid Coordinate: NA




BACKGROUND MAPPING INFORMATION HAS BEEN REPRODUCED FROM THE ORDNANCE SURVEY BY PERMISSION OF ORDNANCE SURVEY OF THE CONTROLLER OF HIS MAJESTY'S STATIONERY OFFICE. CROWN COPYRIGHT ORDNANCE SURVEY © - 100024241. BLUESKY INTERNATIONAL LTD © NATIONAL GRID ELECTRICITY. ESRI COMMUNITY MAPS CONTRIBUTORS: ESRI UK, ESRI, HERE, GARMIN, FOUR SQUARE, GEOTECHNOLOGIES, INC, METUNISA, USGS

Issue	Date	Remarks	Drawn	Checked	Approved
A	29/08/23	Final	JF	SC	KJ


THE NATIONAL GRID ELECTRICITY TRANSMISSION PLC (SEA LINK) ORDER
 MASTER KEY PLAN FOR CONSULTATION
 SHEET 1 OF 1
 KENT



Application Number		EN020026	
National Grid Drawing Reference			
S42_K/MKP/SS/2001			
Scale	Sheet Size	Sheet	Issue
1:10,000	A0	SHEET 1 OF 1	A

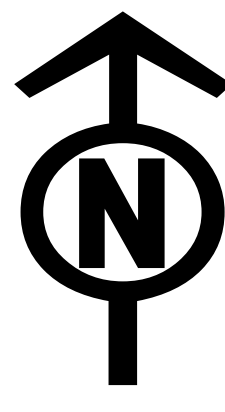

THE NATIONAL GRID ELECTRICITY TRANSMISSION PLC (SEA LINK) ORDER
 GENERAL ARRANGEMENT PLAN SERIES FOR CONSULTATION
 SHEET 1 OF 4
 KENT
 KENT COUNTY COUNCIL, DOVER DISTRICT COUNCIL, THANET DISTRICT COUNCIL

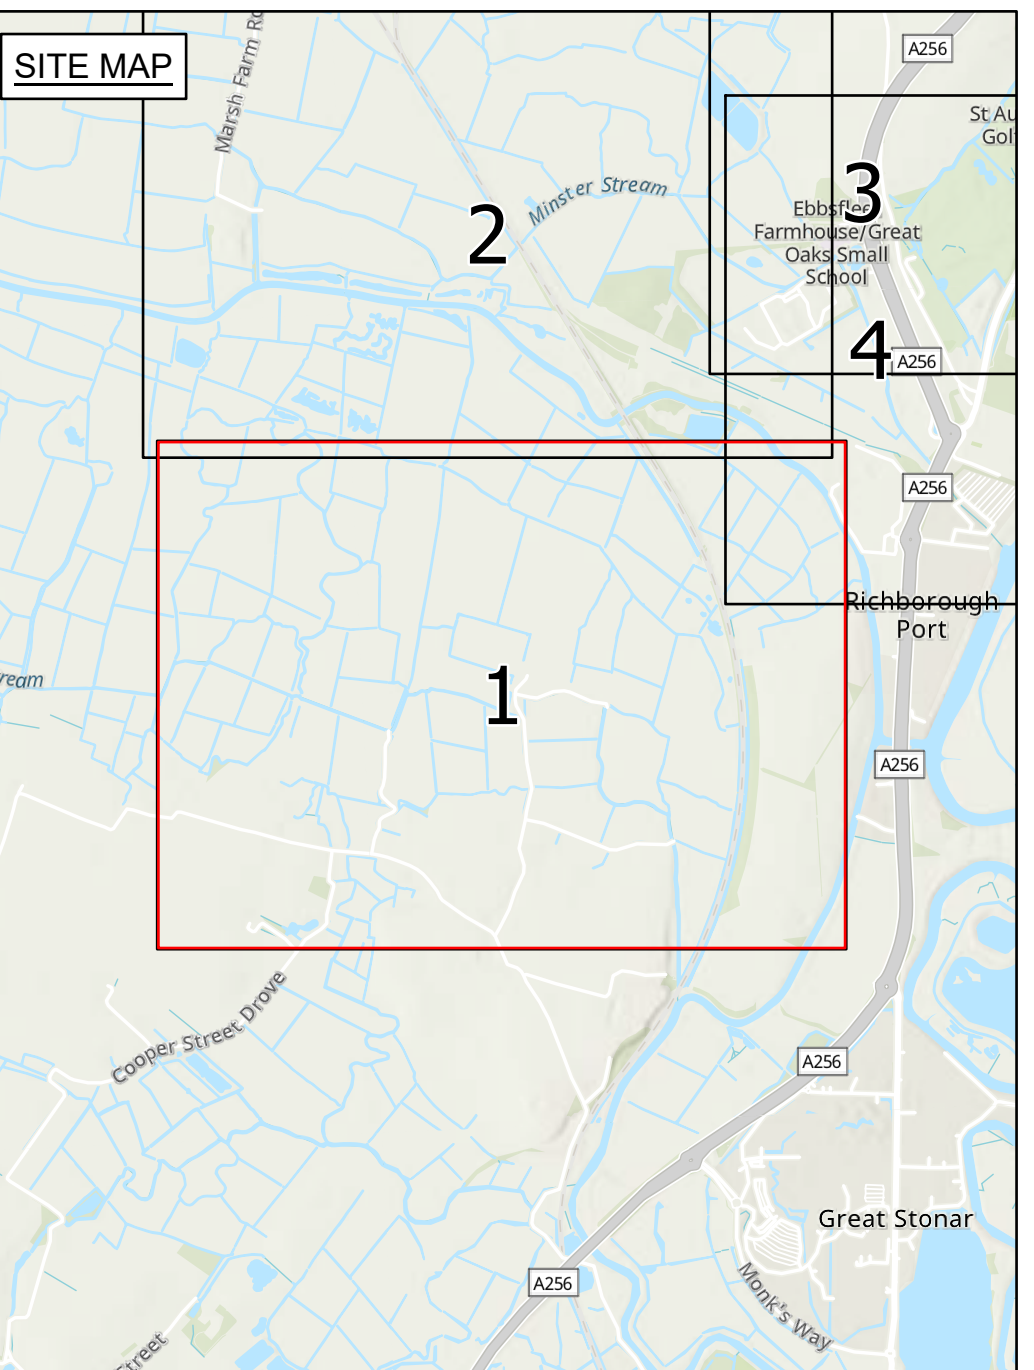

- Legend**
- Draft Order Limits
 - Over Head Line (OHL) Limit of Deviation (LoD)
 - Existing pylon
 - Proposed pylon removal
 - Proposed pylon modification works
 - Proposed pylon
 - Proposed Over Head Line (OHL)
 - Proposed access route

- Notes**
For statutory consultation purposes only.
1. This plan is scaled at paper size A0, therefore any prints taken at smaller sizes will affect accuracy of the measurement units and should not be scaled against.
 2. These plans show the Draft Order Limits and cable alignment and potential pylon locations. Due to the need for future flexibility, National Grid will be applying for Order Limits and Limits of Deviation within its Development Consent Order, within which any final alignment (including pylon locations) would lie. Therefore the cable alignment and pylon locations should be treated as indicative only. Further information is provided in our 'Guide to interacting with our consultation plans' document.
 3. The Permanent access LoD is only shown where permanent access routes fall outside of the Cable LoD.
 4. Access routes shown are a combination of primary construction accesses, mobilisation accesses, and monitoring and maintenance accesses.
 5. For further information on construction please refer to the construction section of the Preliminary Environmental Impact Report, Volume 1, Part 1, Chapter 4.

Coordinate System: British National Grid
 Sheet X Centroid Coordinate: 631915 Sheet Y Centroid Coordinate: 161337.59375



BACKGROUND MAPPING INFORMATION HAS BEEN REPRODUCED FROM THE ORDINANCE SURVEY BY PERMISSION OF ORDINANCE SURVEY OF THE CONTROLLER OF HIS MAJESTY'S STATIONERY OFFICE. CROWN COPYRIGHT ORDINANCE SURVEY © - 100024241. BLUEKEY INTERNATIONAL LTD ©. NATIONAL GRID ELECTRICITY. ESRI COMMUNITY MAPS CONTRIBUTORS, ESRI UK, ESRI, HERE, GARMIN, FOUR SQUARE, GEOTECHNOLOGIES, INC, METIUNISA, USGS

Issue	Date	Remarks	Drawn	Checked	Approved
A	31/08/23	Final	JF	SC	JW


THE NATIONAL GRID ELECTRICITY TRANSMISSION PLC (SEA LINK) ORDER
 GENERAL ARRANGEMENT PLAN SERIES FOR CONSULTATION
 SHEET 1 OF 4
 KENT

nationalgrid



Application Number: EN020026

National Grid Drawing Reference: S42_K/IGA/PS/2001

Scale	Sheet Size	Sheet	Issue
1:2,500	A0	SHEET 1 OF 4	A

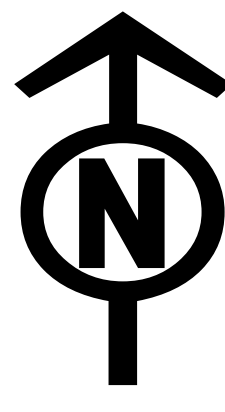

THE NATIONAL GRID ELECTRICITY TRANSMISSION PLC (SEA LINK) ORDER
 GENERAL ARRANGEMENT PLAN SERIES FOR CONSULTATION
 SHEET 2 OF 4
 KENT
 KENT COUNTY COUNCIL, DOVER DISTRICT COUNCIL, THANET DISTRICT COUNCIL

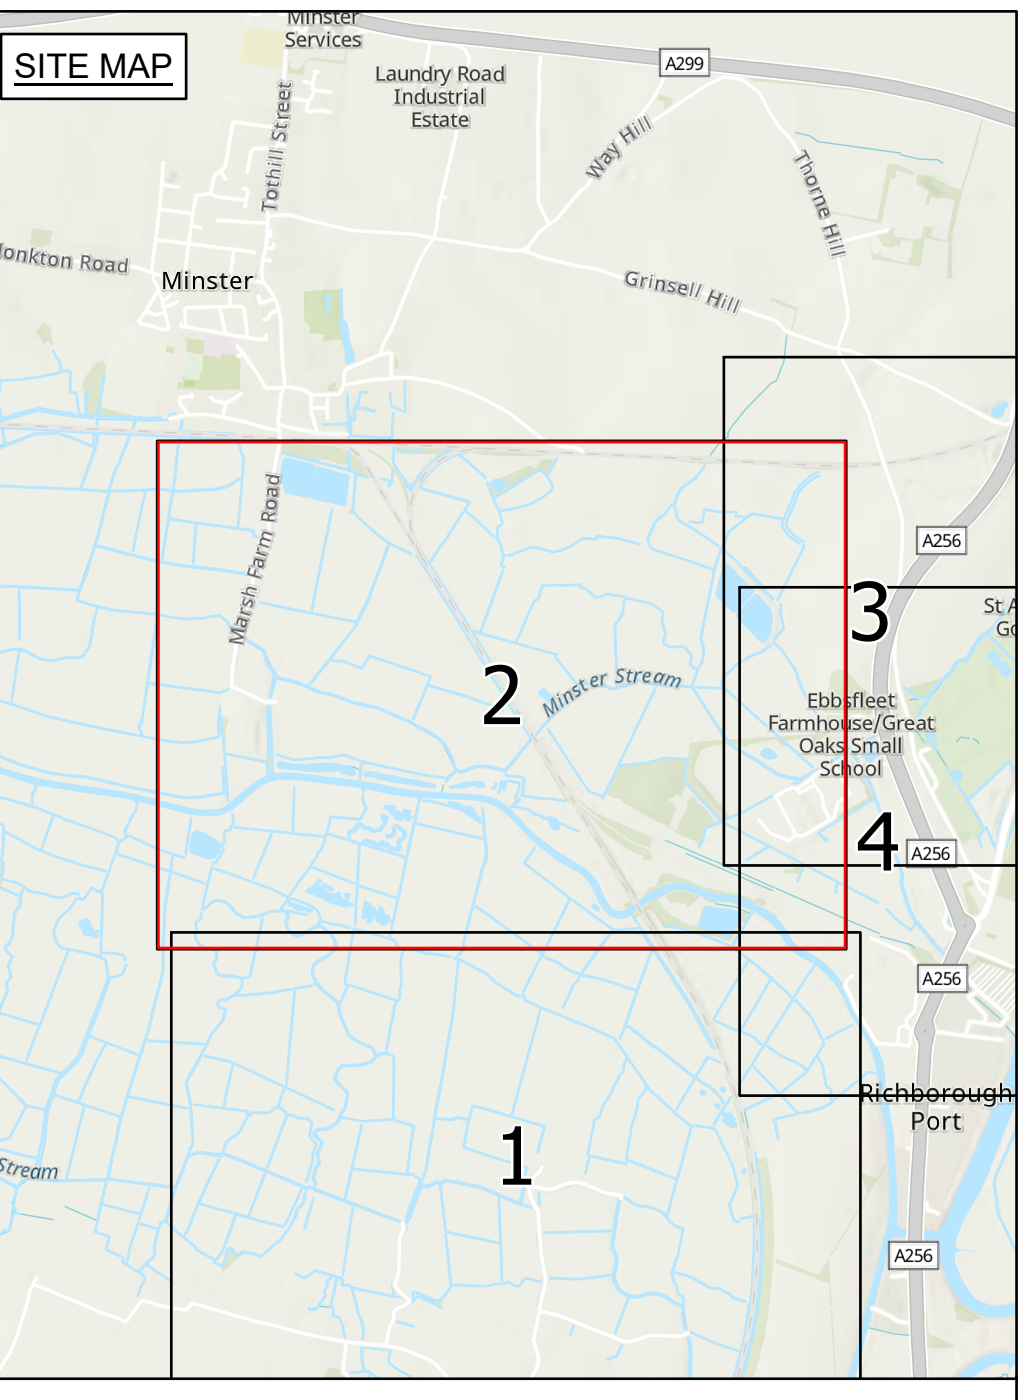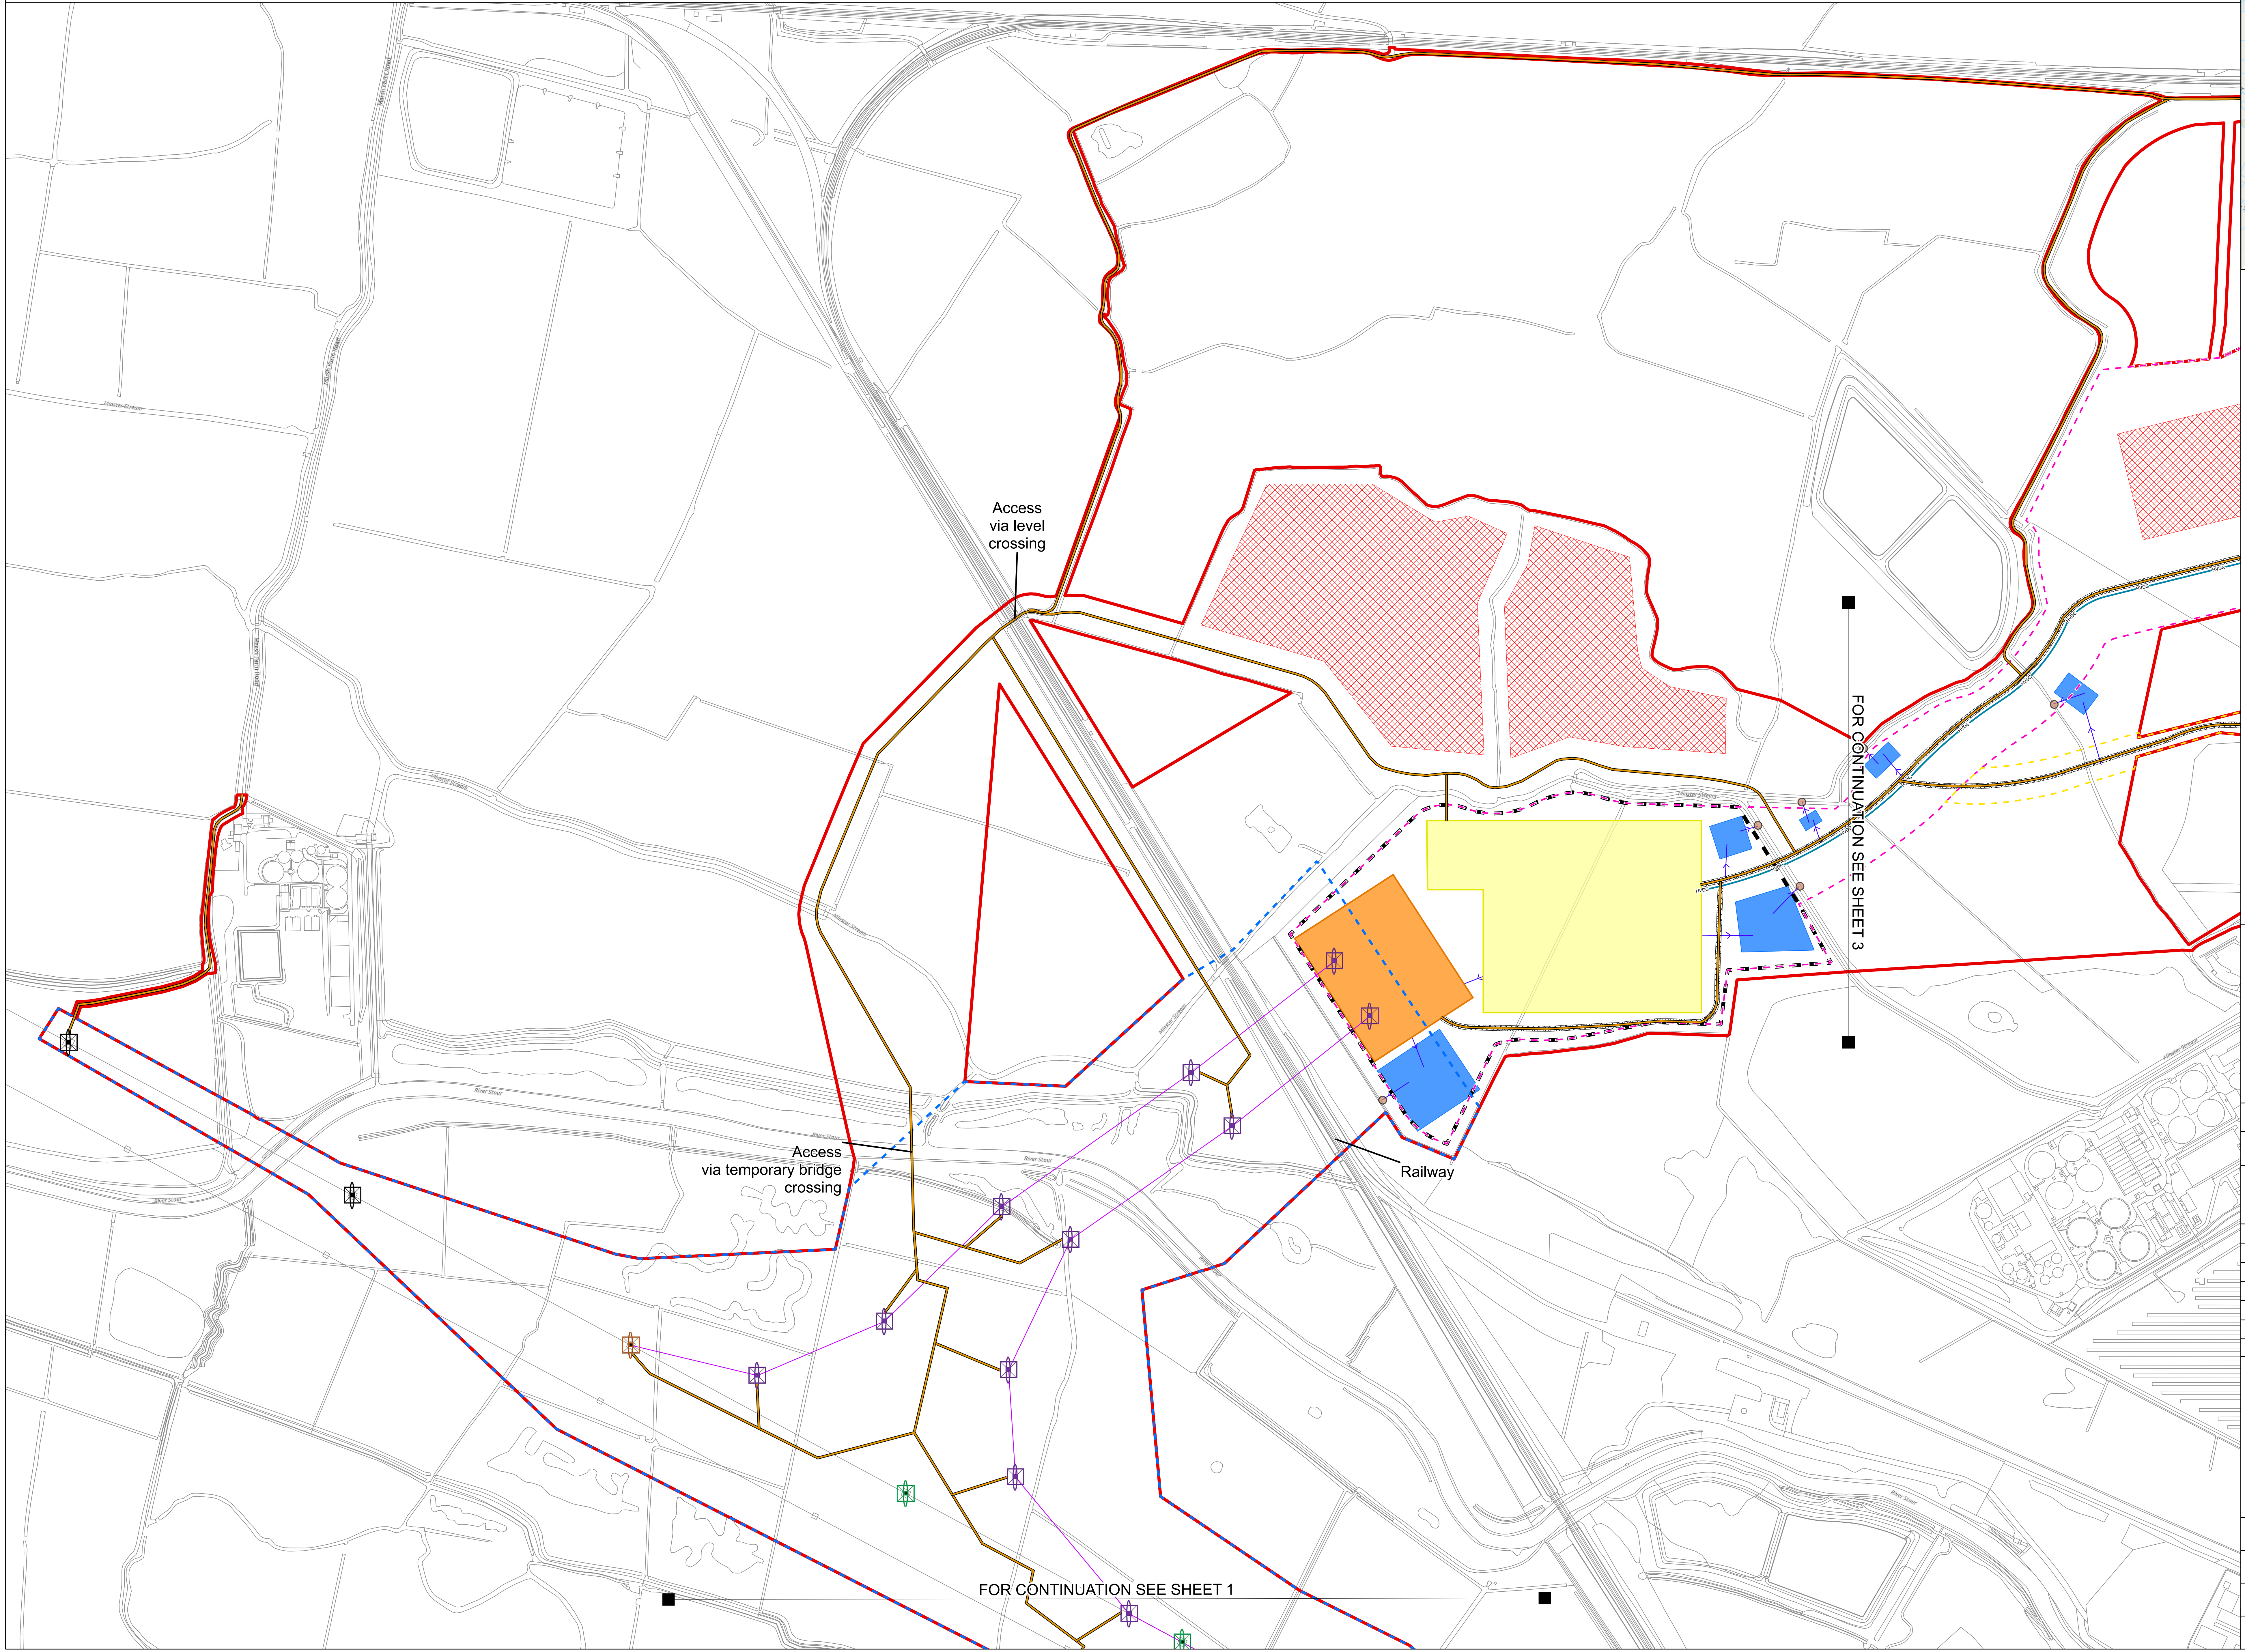


Legend

- Draft Order Limits
- - - Over Head Line (OHL) Limit of Deviation (LoD)
- - - Cable Limit of Deviation (LoD)
- - - Permanent access Limit of Deviation (LoD)
- - - Converter station Limit of Deviation (LoD)
- Proposed permanent outfall
- Existing pylon
- Proposed pylon removal
- Proposed pylon modification works
- Proposed pylon
- Proposed Over Head Line (OHL)
- Proposed access route
- Proposed High Voltage Direct Current (HVDC) cable alignment
- Proposed permanent attenuation outfall pipe
- ▨ Proposed construction compound
- ▨ Proposed permanent access
- ▨ Proposed substation
- ▨ Proposed converter station
- ▨ Proposed permanent attenuation pond (includes 5 metre buffer)

Notes
For statutory consultation purposes only.
 1. This plan is scaled at paper size A0, therefore any prints taken at smaller sizes will affect accuracy of the measurement units and should not be scaled against.
 2. These plans show the Draft Order Limits and cable alignment and potential pylon locations. Due to the need for future flexibility, National Grid will be applying for Order Limits and Limits of Deviation within its Development Consent Order, within which any final alignment (including pylon locations) would lie. Therefore the cable alignment and pylon locations should be treated as indicative only. Further information is provided in our 'Guide to interacting with our consultation plans' document.
 3. The Permanent access LoD is only shown where permanent access routes fall outside of the Cable LoD.
 4. Access routes shown are a combination of primary construction accesses, mobilisation accesses, and monitoring and maintenance accesses.
 5. For further information on construction please refer to the construction section of the Preliminary Environmental Impact Report, Volume 1, Part 1, Chapter 4.

Coordinate System: British National Grid
 Sheet X Centroid Coordinate: 631861.9375 Sheet Y Centroid Coordinate: 163171.65625

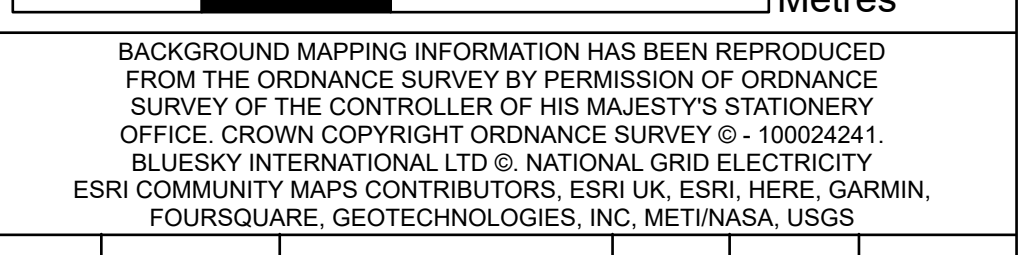


BACKGROUND MAPPING INFORMATION HAS BEEN REPRODUCED FROM THE ORDINANCE SURVEY BY PERMISSION OF ORDINANCE SURVEY OF THE CONTROLLER OF HIS MAJESTY'S STATIONERY OFFICE. CROWN COPYRIGHT ORDNANCE SURVEY © - 100024241. BLUESKY INTERNATIONAL LTD © NATIONAL GRID ELECTRICITY. ESRI COMMUNITY MAPS CONTRIBUTORS, ESRI UK, ESRI, HERE, GARMIN, FOUR SQUARE, GEOTECHNOLOGIES, INC, METIUNSA, USGS



Issue	Date	Remarks	Drawn	Checked	Approved
A	31/08/23	Final	JF	SC	JW

THE NATIONAL GRID ELECTRICITY TRANSMISSION PLC (SEA LINK) ORDER
 GENERAL ARRANGEMENT PLAN SERIES
 FOR CONSULTATION
 SHEET 2 OF 4
 KENT

Application Number		EN020026	
National Grid Drawing Reference			
S42_K/GA/PS/2002			
Scale	Sheet Size	Sheet	Issue
1:2,500	A0	SHEET 2 OF 4	A

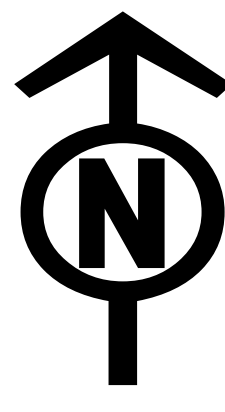

THE NATIONAL GRID ELECTRICITY TRANSMISSION PLC (SEA LINK) ORDER
 GENERAL ARRANGEMENT PLAN SERIES FOR CONSULTATION
 SHEET 3 OF 4
 KENT
 KENT COUNTY COUNCIL, DOVER DISTRICT COUNCIL, THANET DISTRICT COUNCIL

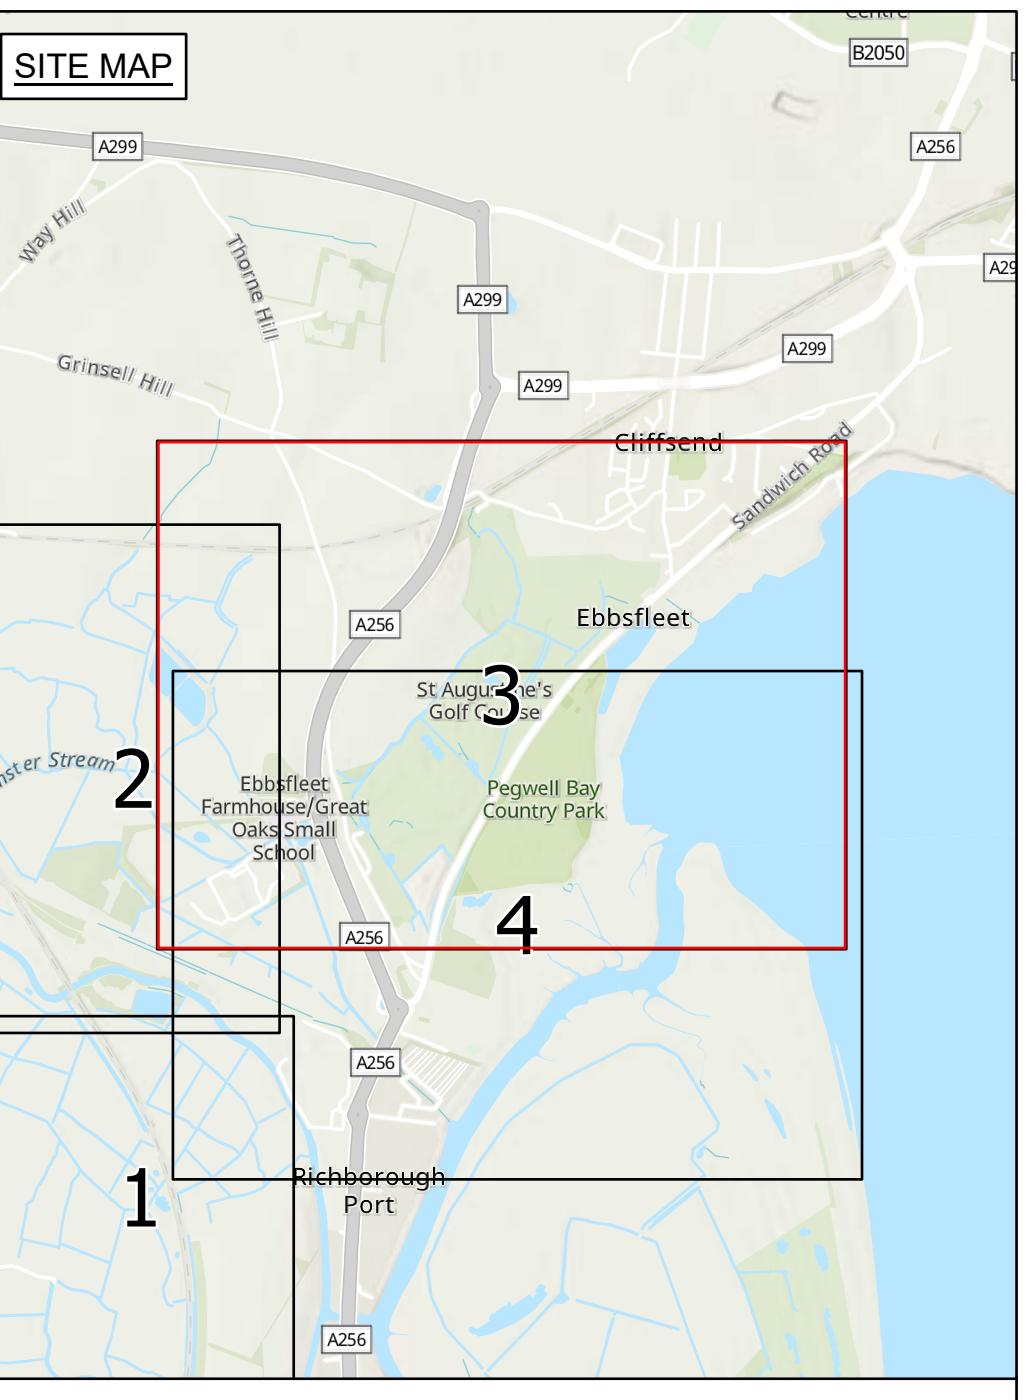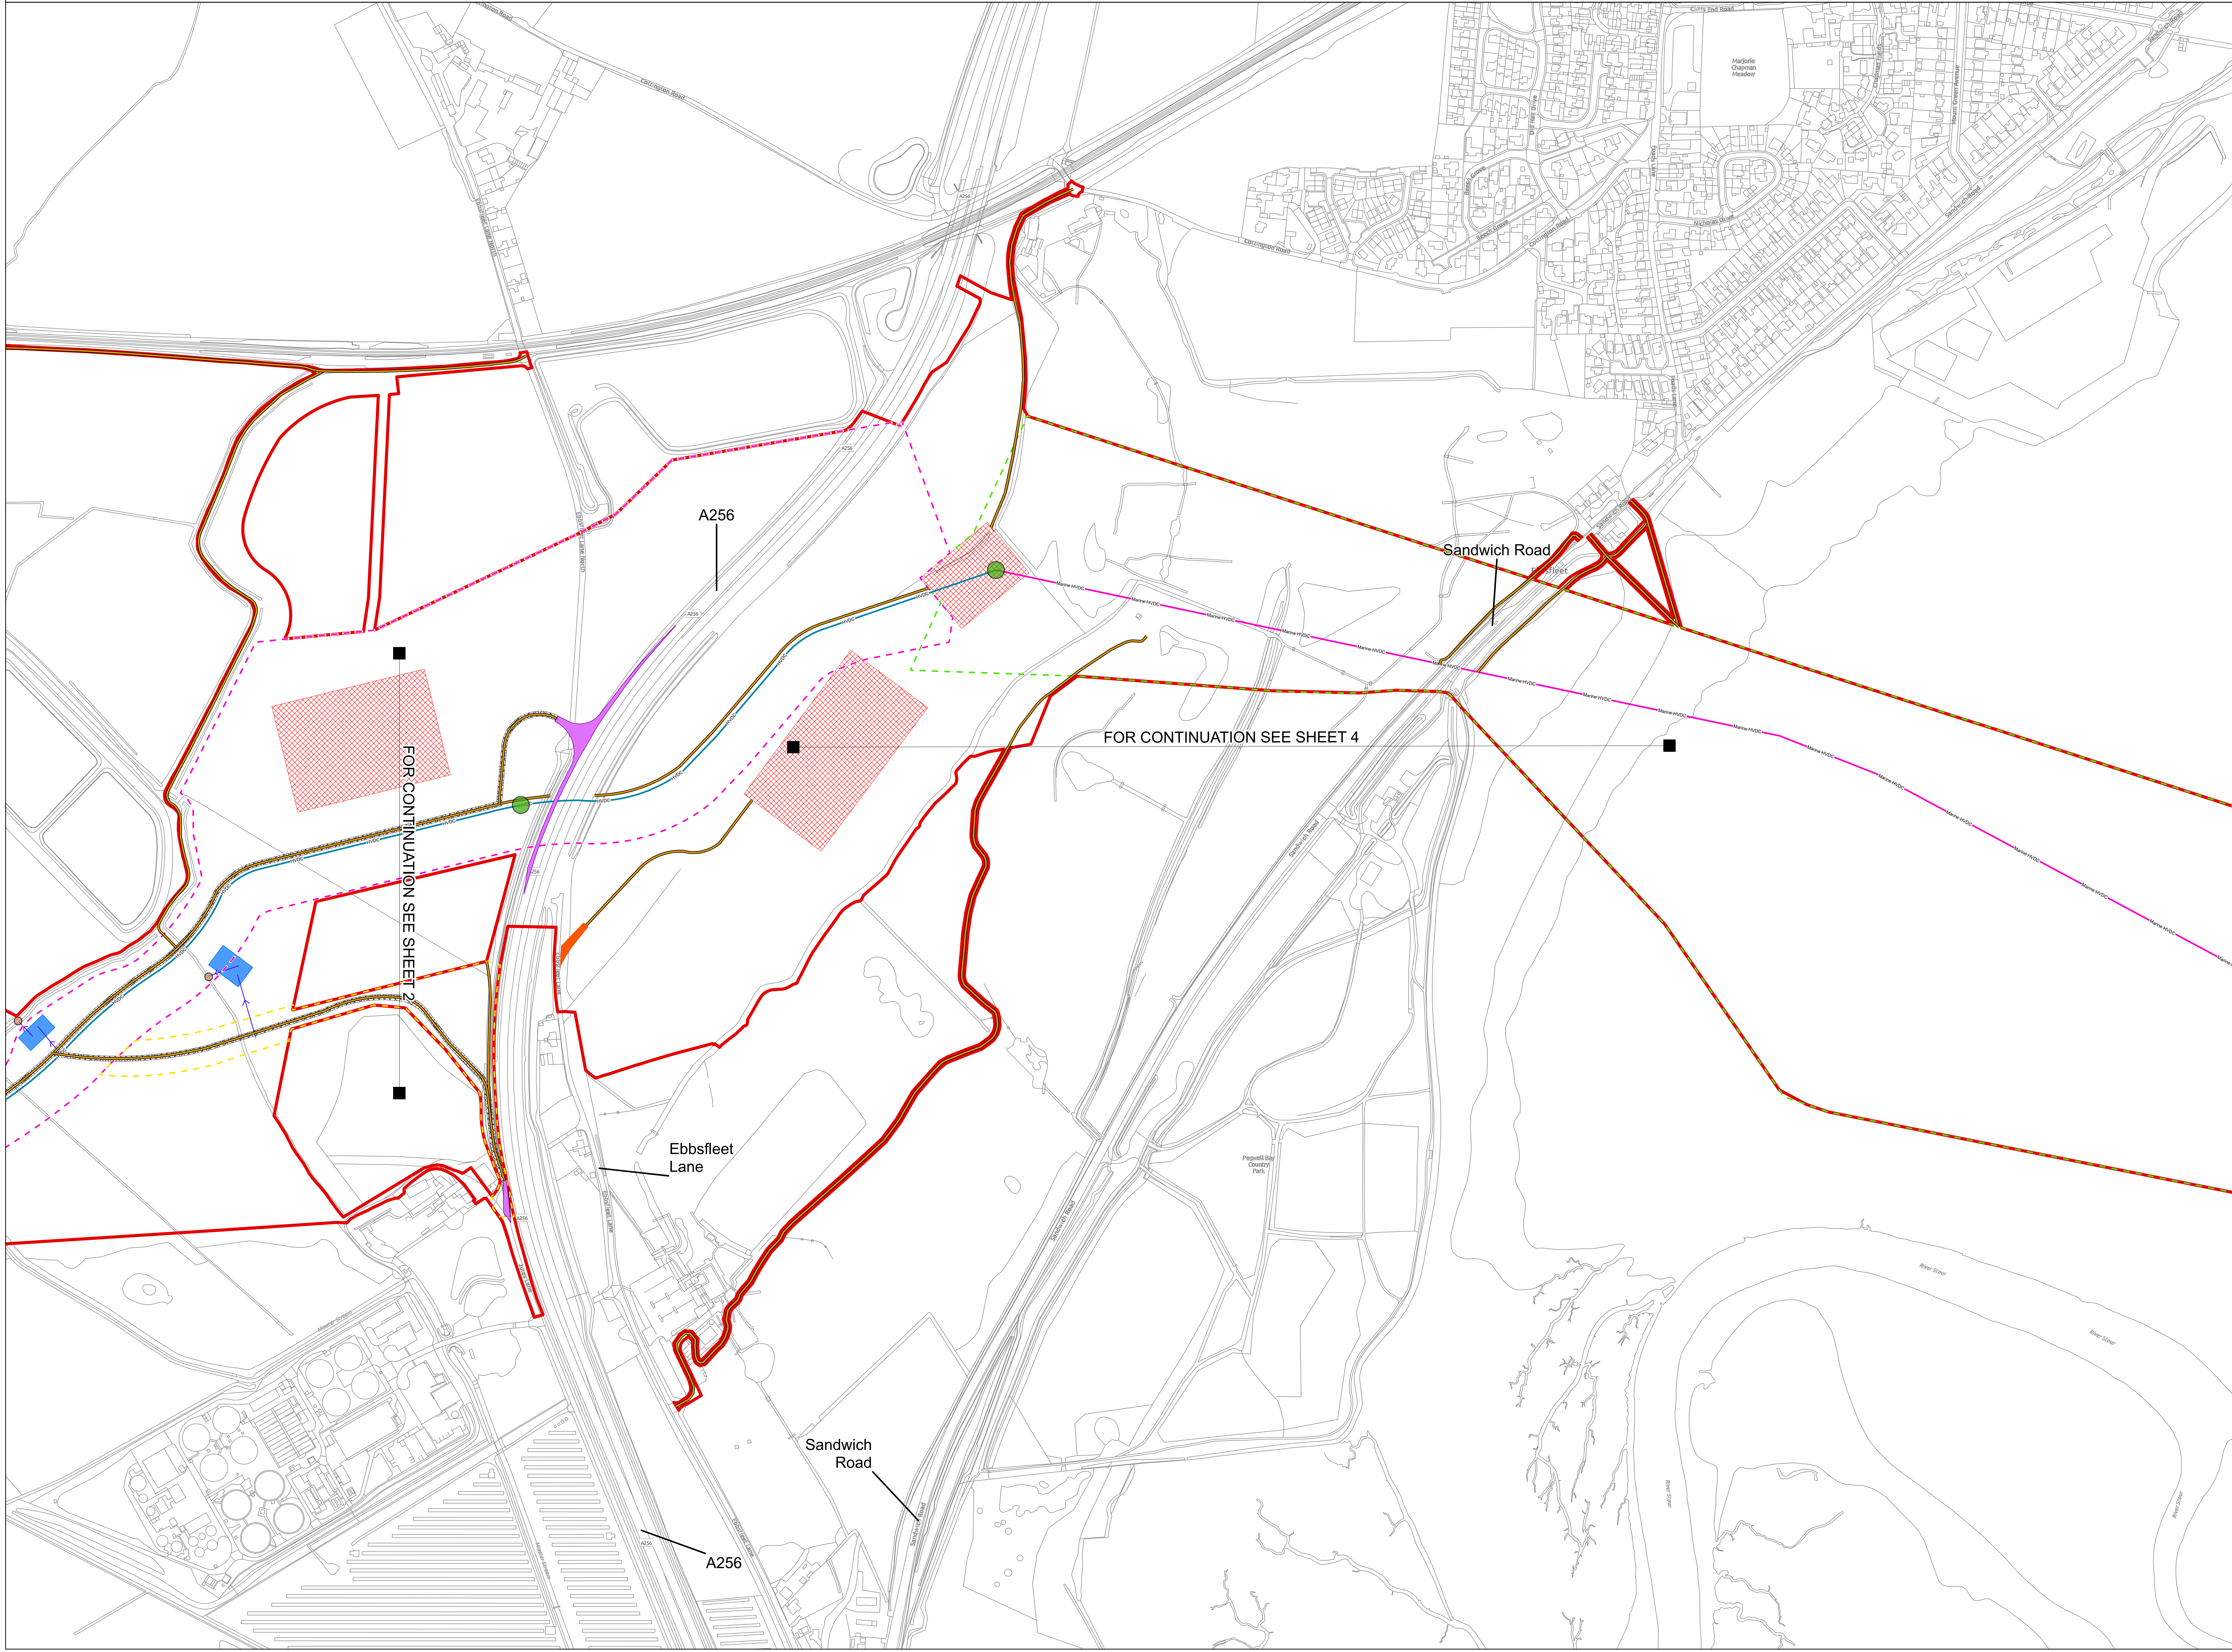

- Legend**
- Draft Order Limits
 - - - Cable Limit of Deviation (LoD)
 - - - Marine Limit of Deviation (LoD)
 - - - Permanent access Limit of Deviation (LoD)
 - Proposed permanent outfall
 - Proposed joint bay
 - Proposed access route
 - Proposed High Voltage Direct Current (HVDC) cable alignment
 - Proposed marine High Voltage Direct Current (HVDC) cable alignment
 - Proposed permanent attenuation outfall pipe
 - ▨ Proposed construction compound
 - ▨ Proposed permanent access
 - ▨ Proposed permanent bellmouth
 - ▨ Proposed temporary bellmouth
 - ▨ Proposed permanent attenuation pond (includes 5 metre buffer)

Notes
 For statutory consultation purposes only.

1. This plan is scaled at paper size A0, therefore any prints taken at smaller sizes will affect accuracy of the measurement units and should not be scaled against.
2. These plans show the Draft Order Limits and cable alignment and potential pylon locations. Due to the need for future flexibility, National Grid will be applying for Order Limits and Limits of Deviation within its Development Consent Order, within which any final alignment (including pylon locations) would lie. Therefore the cable alignment and pylon locations should be treated as indicative only. Further information is provided in our 'Guide to interacting with our consultation plans' document.
3. The Permanent access LoD is only shown where permanent access routes fall outside of the Cable LoD.
4. Access routes shown are a combination of primary construction accesses, mobilisation accesses, and monitoring and maintenance accesses.
5. For further information on construction please refer to the construction section of the Preliminary Environmental Impact Report, Volume 1, Part 1, Chapter 4.

Coordinate System: British National Grid
 Sheet X Centroid Coordinate: 634385.75 Sheet Y Centroid Coordinate: 163315.64028



BACKGROUND MAPPING INFORMATION HAS BEEN REPRODUCED FROM THE ORDINANCE SURVEY BY PERMISSION OF ORDINANCE SURVEY OF THE CONTROLLER OF HIS MAJESTY'S STATIONERY OFFICE. CROWN COPYRIGHT ORDNANCE SURVEY © - 100024241. BLUEKEY INTERNATIONAL LTD © NATIONAL GRID ELECTRICITY. ESRI COMMUNITY MAPS CONTRIBUTORS, ESRI UK, ESRI, HERE, GARMIN, FOUR SQUARE, GEOTECHNOLOGIES, INC, METIUNSA, USGS



Issue	Date	Remarks	Drawn	Checked	Approved
A	31/08/23	Final	JF	SC	JW

THE NATIONAL GRID ELECTRICITY TRANSMISSION PLC (SEA LINK) ORDER
 GENERAL ARRANGEMENT PLAN SERIES
 FOR CONSULTATION
 SHEET 3 OF 4
 KENT

Application Number		EN020026	
National Grid Drawing Reference			
S42_K/IGA/PS/2003			
Scale	Sheet Size	Sheet	Issue
1:2,500	A0	SHEET 3 OF 4	A



THE NATIONAL GRID ELECTRICITY TRANSMISSION PLC (SEA LINK) ORDER
 GENERAL ARRANGEMENT PLAN SERIES FOR CONSULTATION
 SHEET 4 OF 4
 KENT
 KENT COUNTY COUNCIL, DOVER DISTRICT COUNCIL, THANET DISTRICT COUNCIL

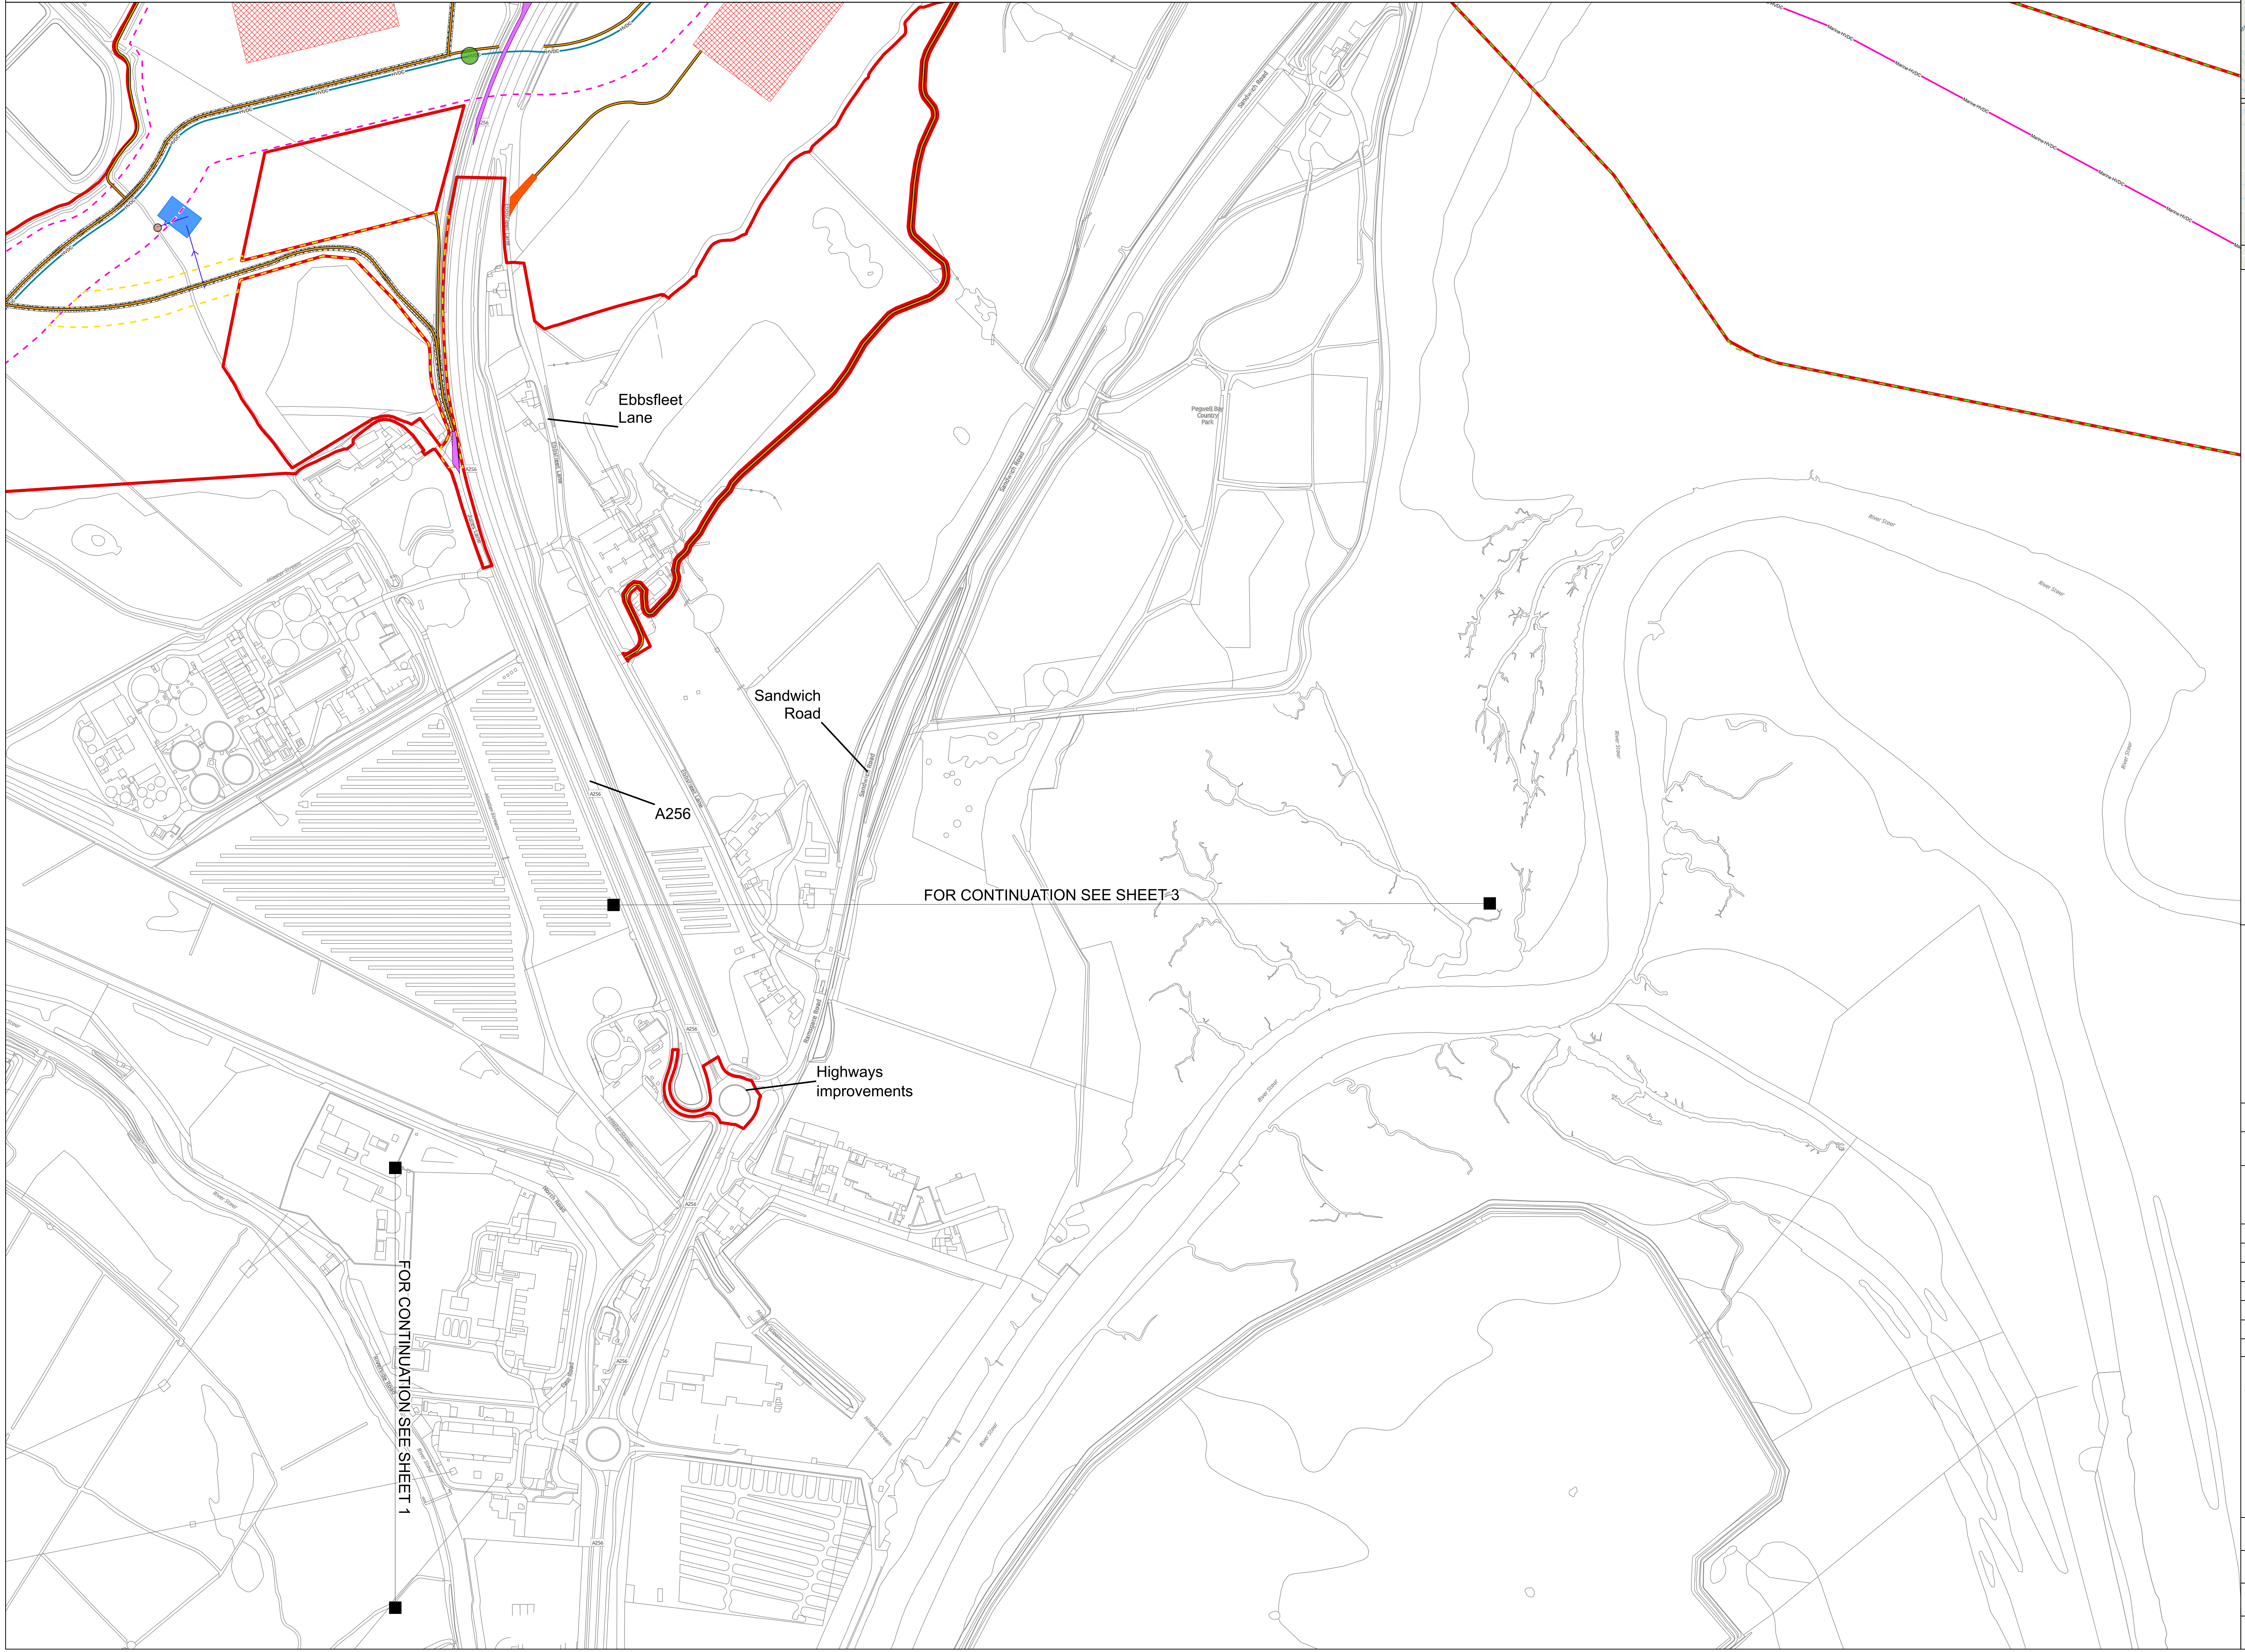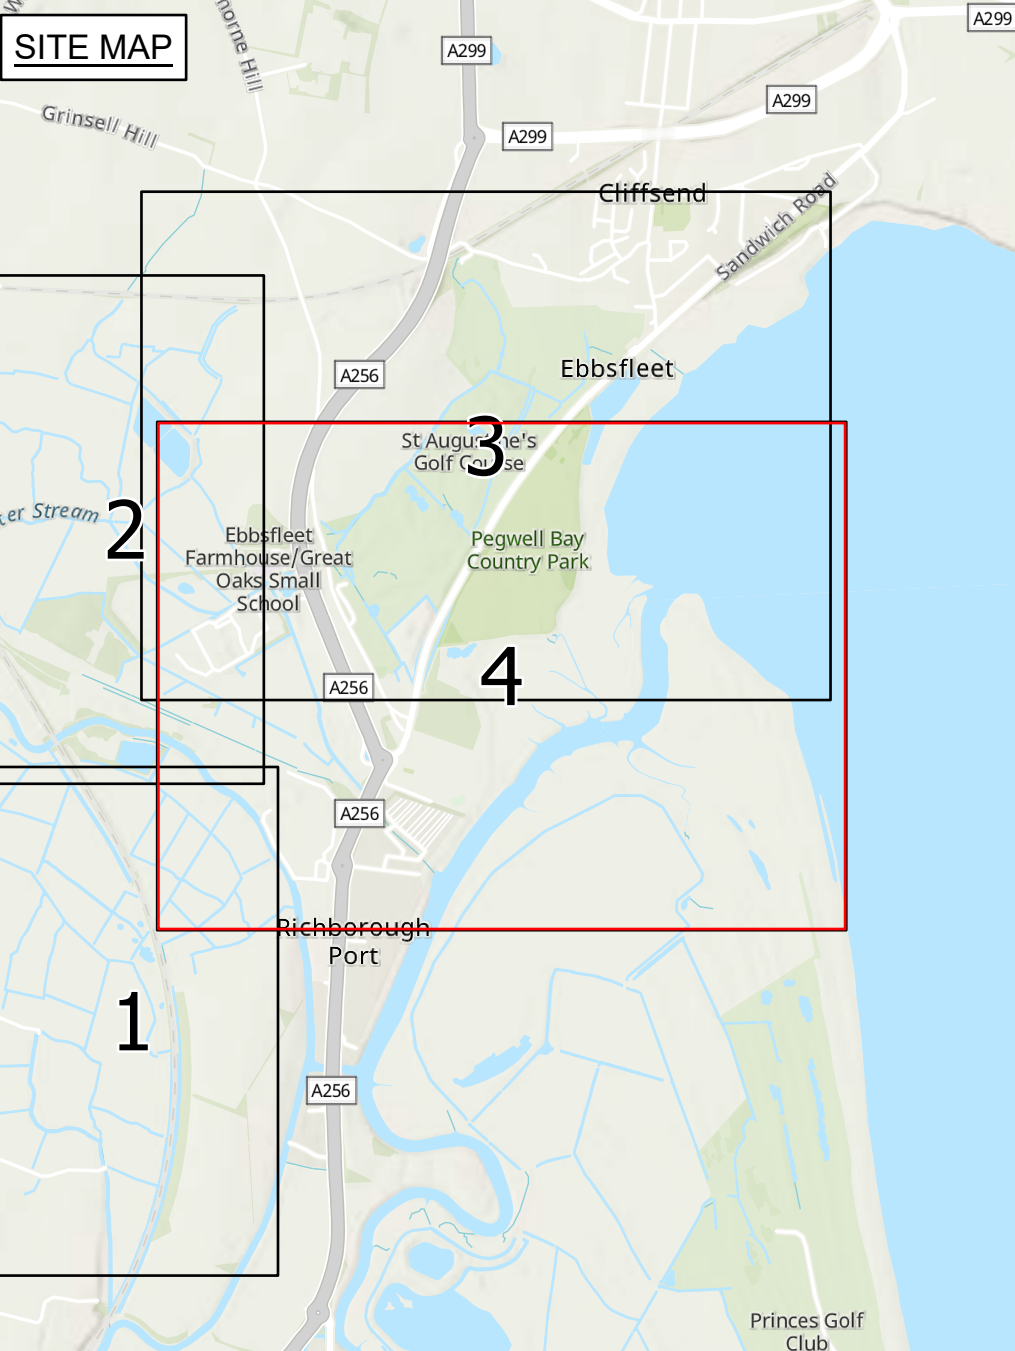

- Legend**
- Draft Order Limits
 - Cable Limit of Deviation (LoD)
 - Marine Limit of Deviation (LoD)
 - Permanent access Limit of Deviation (LoD)
 - Proposed permanent outfall
 - Proposed joint bay
 - Proposed access route
 - Proposed High Voltage Direct Current (HVDC) cable alignment
 - Proposed marine High Voltage Direct Current (HVDC) cable alignment
 - Proposed permanent attenuation outfall pipe
 - ▨ Proposed construction compound
 - ▨ Proposed permanent access
 - ▨ Proposed permanent bellmouth
 - ▨ Proposed temporary bellmouth
 - ▨ Proposed permanent attenuation pond (includes 5 metre buffer)

Notes
For statutory consultation purposes only.
 1. This plan is scaled at paper size A0, therefore any prints taken at smaller sizes will affect accuracy of the measurement units and should not be scaled against.
 2. These plans show the Draft Order Limits and cable alignment and potential pylon locations. Due to the need for future flexibility, National Grid will be applying for Order Limits and Limits of Deviation within its Development Consent Order, within which any final alignment (including pylon locations) would lie. Therefore the cable alignment and pylon locations should be treated as indicative only. Further information is provided in our 'Guide to interacting with our consultation plans' document.
 3. The Permanent access LoD is only shown where permanent access routes fall outside of the Cable LoD.
 4. Access routes shown are a combination of primary construction accesses, mobilisation accesses, and monitoring and maintenance accesses.
 5. For further information on construction please refer to the construction section of the Preliminary Environmental Impact Report, Volume 1, Part 1, Chapter 4.

Coordinate System: British National Grid
 Sheet X Centroid Coordinate: 634385.75 Sheet Y Centroid Coordinate: 161481.59375



BACKGROUND MAPPING INFORMATION HAS BEEN REPRODUCED FROM THE ORDINANCE SURVEY BY PERMISSION OF ORDINANCE SURVEY OF THE CONTROLLER OF HIS MAJESTY'S STATIONERY OFFICE. CROWN COPYRIGHT ORDNANCE SURVEY © - 100024241. BLUEBERRY INTERNATIONAL LTD © NATIONAL GRID ELECTRICITY. ESRI COMMUNITY MAPS CONTRIBUTORS, ESRI UK, ESRI, HERE, GARMIN, FOUR SQUARE, GEOTECHNOLOGIES, INC, METI/NSA, USGS

Issue	Date	Remarks	Drawn	Checked	Approved
A	31/08/23	Final	JF	SC	JW

THE NATIONAL GRID ELECTRICITY TRANSMISSION PLC (SEA LINK) ORDER
 GENERAL ARRANGEMENT PLAN SERIES FOR CONSULTATION
 SHEET 4 OF 4
 KENT

nationalgrid

Application Number: EN020026


National Grid Drawing Reference: S42_K/IGA/PS/2004

Scale	Sheet Size	Sheet	Issue
1:2,500	A0	SHEET 4 OF 4	A

05. Offshore Scheme


Section	Scheme	Plan Type/ Drawing Numbers
05	Offshore Scheme	Key Plan: S42_M/MKP/SS/1001 General Arrangement Plans: S42_M/IGA/PS/1001 S42_M/IGA/PS/1002 S42_M/IGA/PS/1003

To assist with understanding these plans please see the **Guide to Interacting with the Consultation Plans and Drawings**

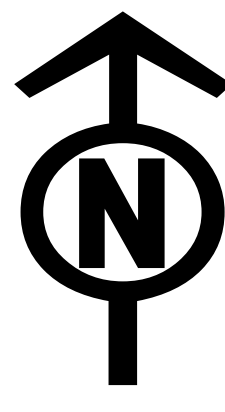

THE NATIONAL GRID ELECTRICITY TRANSMISSION PLC (SEA LINK) ORDER
 MASTER KEY PLAN FOR CONSULTATION
 SHEET 1 OF 1
 MARINE

SUFFOLK COUNTY COUNCIL, EAST SUFFOLK DISTRICT COUNCIL, KENT COUNTY COUNCIL, DOVER DISTRICT COUNCIL, THANET DISTRICT COUNCIL

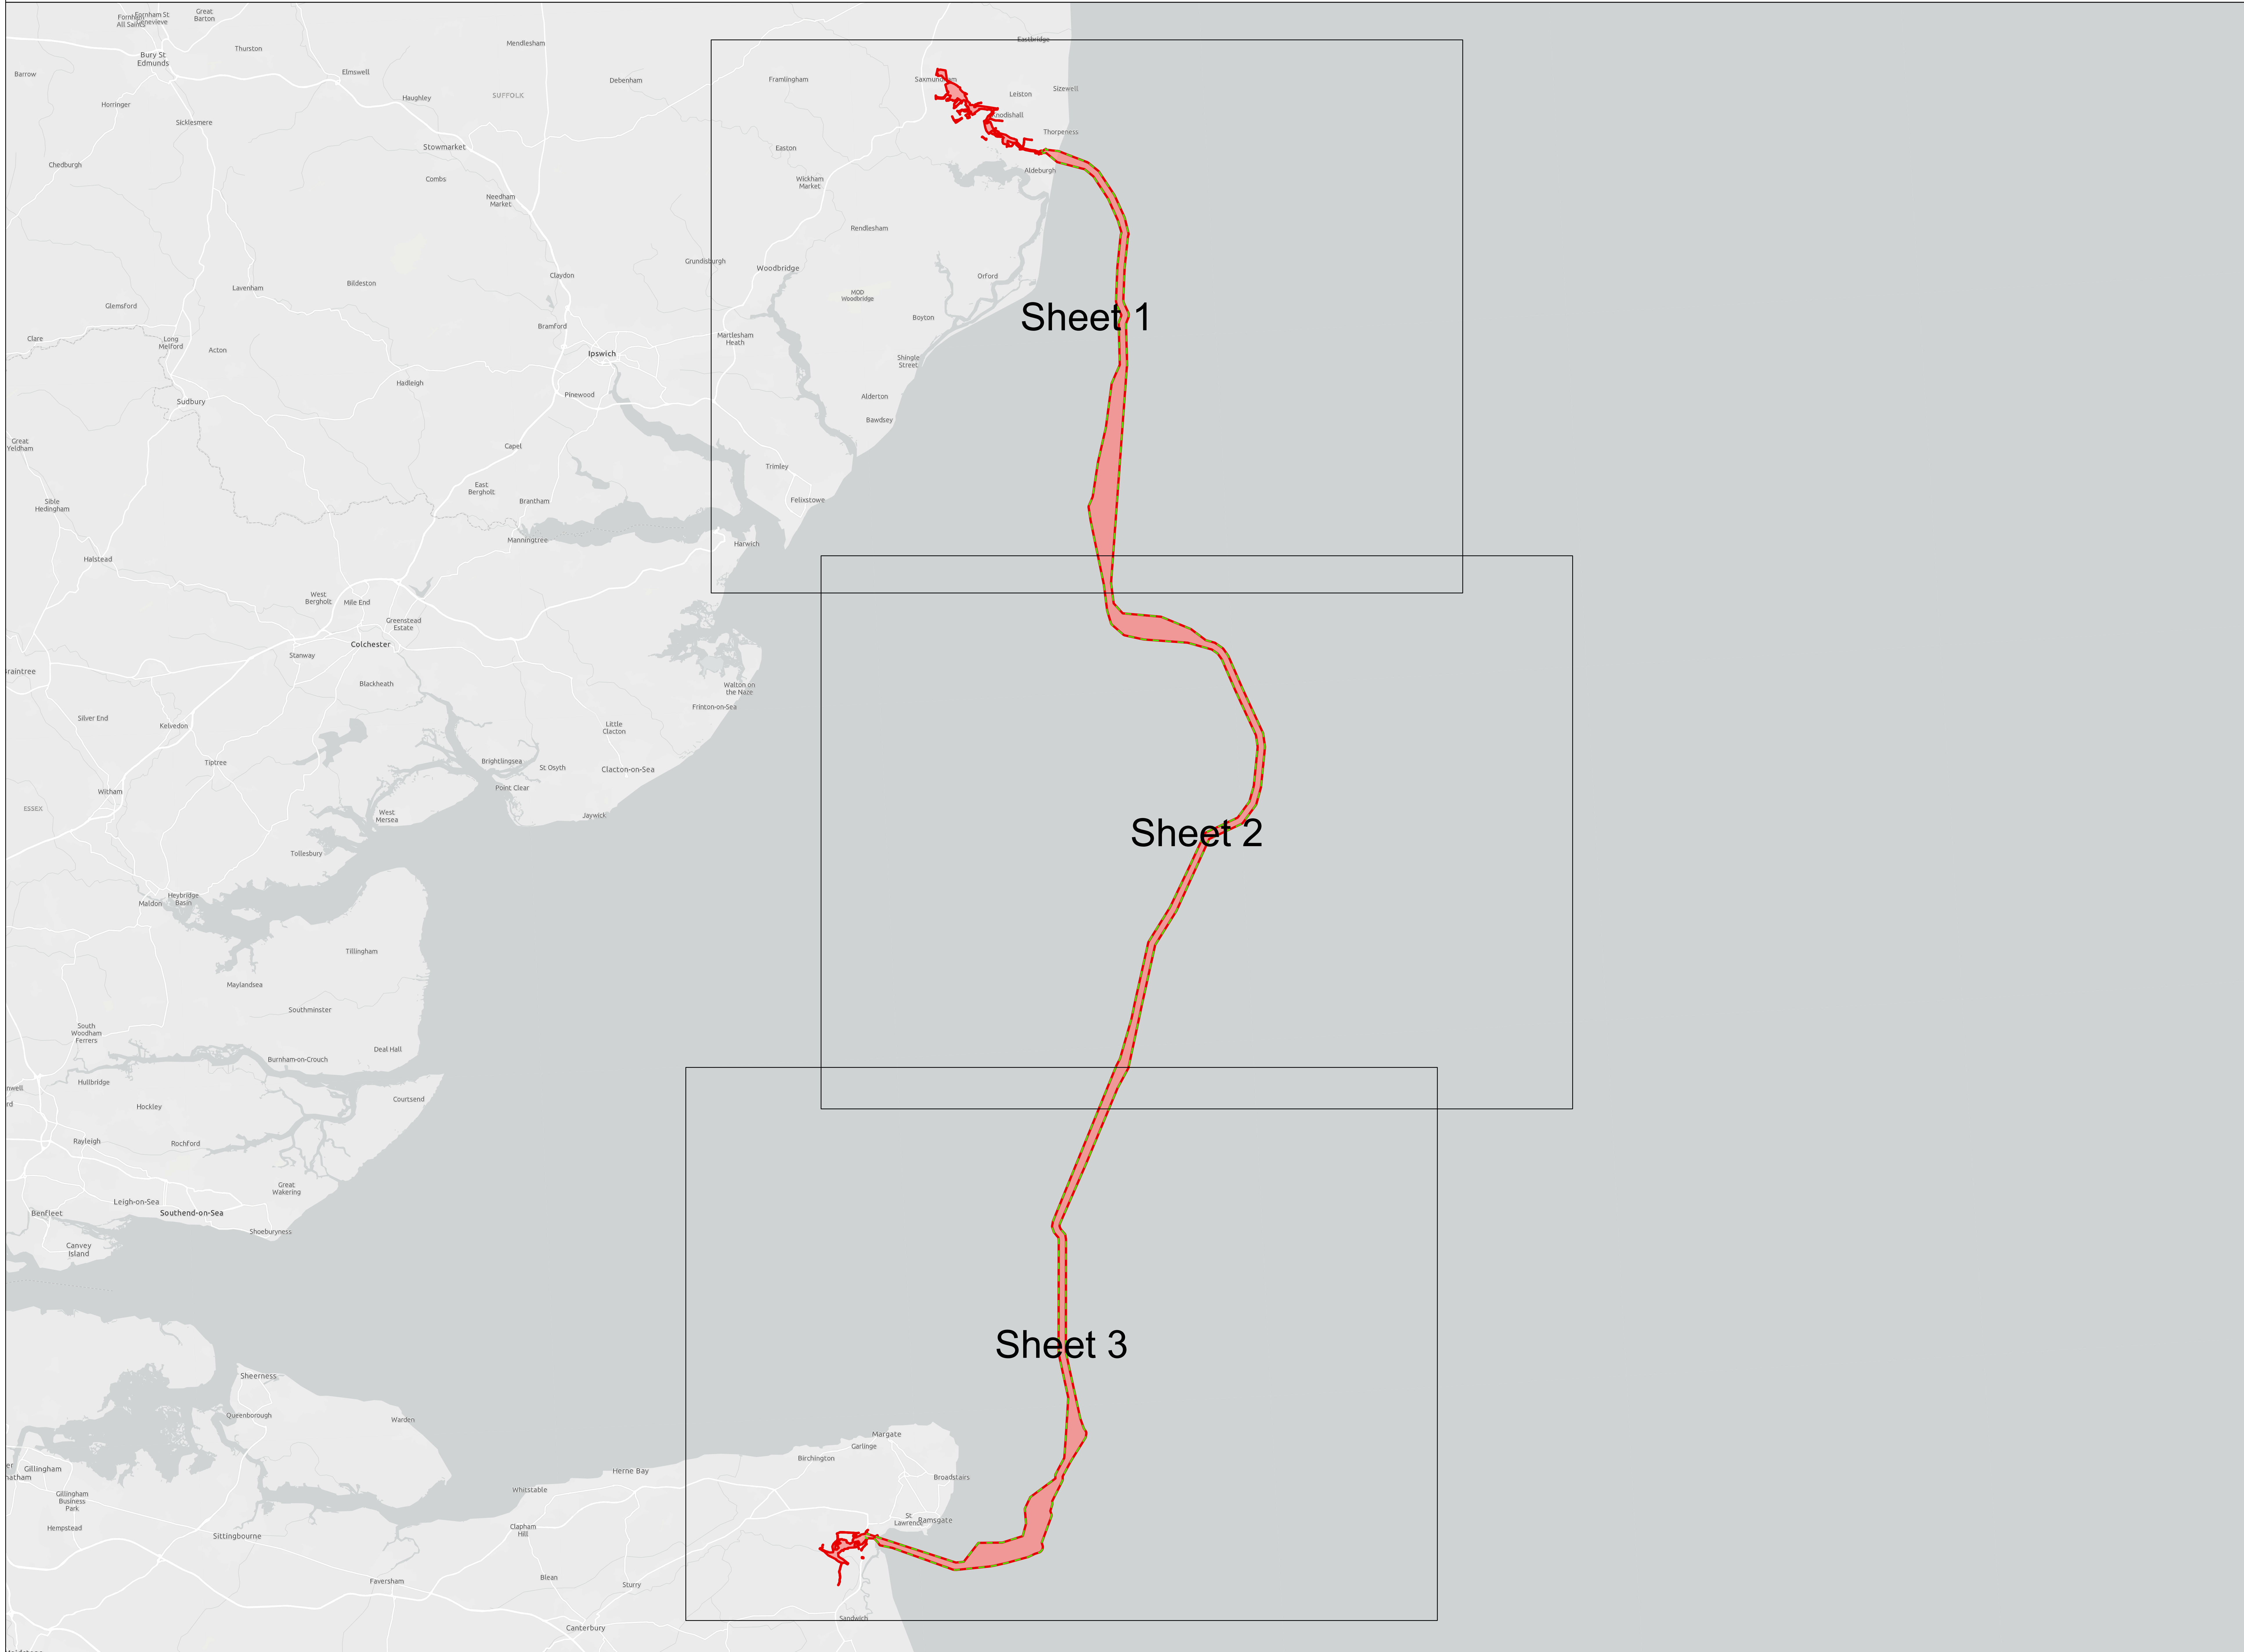


Legend

- Marine Limit of Deviation (LoD)
- Draft Order Limits
- Detailed sheet

Notes
For statutory consultation purposes only.

- This plan is scaled at paper size A0, therefore any prints taken at smaller sizes will affect accuracy of the measurement units and should not be scaled against.
- These plans show the Draft Order Limits and cable alignment and potential pylon locations. Due to the need for future flexibility, National Grid will be applying for Order Limits and Limits of Deviation within its Development Consent Order, within which any final alignment (including pylon locations) would lie. Therefore the cable alignment and pylon locations should be treated as indicative only. Further information is provided in our 'Guide to interacting with our consultation plans' document.
- For further information on construction please refer to the construction section of the Preliminary Environmental Impact Report, Volume 1, Part 1, Chapter 4.

Coordinate System: British National Grid
 Sheet X Centroid Coordinate: N/A Sheet Y Centroid Coordinate: N/A




BACKGROUND MAPPING INFORMATION HAS BEEN REPRODUCED FROM THE ORDINANCE SURVEY BY PERMISSION OF ORDINANCE SURVEY OF THE CONTROLLER OF HIS MAJESTY'S STATIONERY OFFICE. CROWN COPYRIGHT ORDNANCE SURVEY © - 100024241. BLUESKY INTERNATIONAL LTD © NATIONAL GRID ELECTRICITY. ESRI COMMUNITY MAPS CONTRIBUTORS, ESRI UK, ESRI, HERE, GARMIN, FOUR SQUARE, GEOTECHNOLOGIES, INC, METIUNASA, USGS

Issue	Date	Remarks	Drawn	Checked	Approved
A	29/08/23	Final	JF	SC	KJ



Title

THE NATIONAL GRID ELECTRICITY TRANSMISSION PLC
 (SEA LINK) ORDER
 MASTER KEY PLAN FOR CONSULTATION
 SHEET 1 OF 1
 MARINE

Application Number		EN020026	
National Grid Drawing Reference			
S42_MIMKP/SS/1001			
Scale	Sheet Size	Sheet	Issue
1:150,000	A0	SHEET 1 OF 1	A

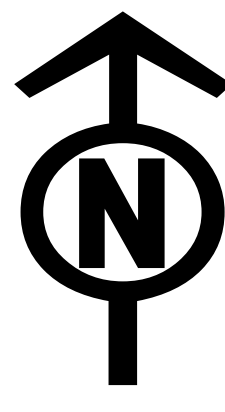

THE NATIONAL GRID ELECTRICITY TRANSMISSION PLC (SEA LINK) ORDER
 GENERAL ARRANGEMENT PLAN SERIES FOR CONSULTATION
 SHEET 1 OF 3
 MARINE
 SUFFOLK COUNTY COUNCIL, EAST SUFFOLK DISTRICT COUNCIL

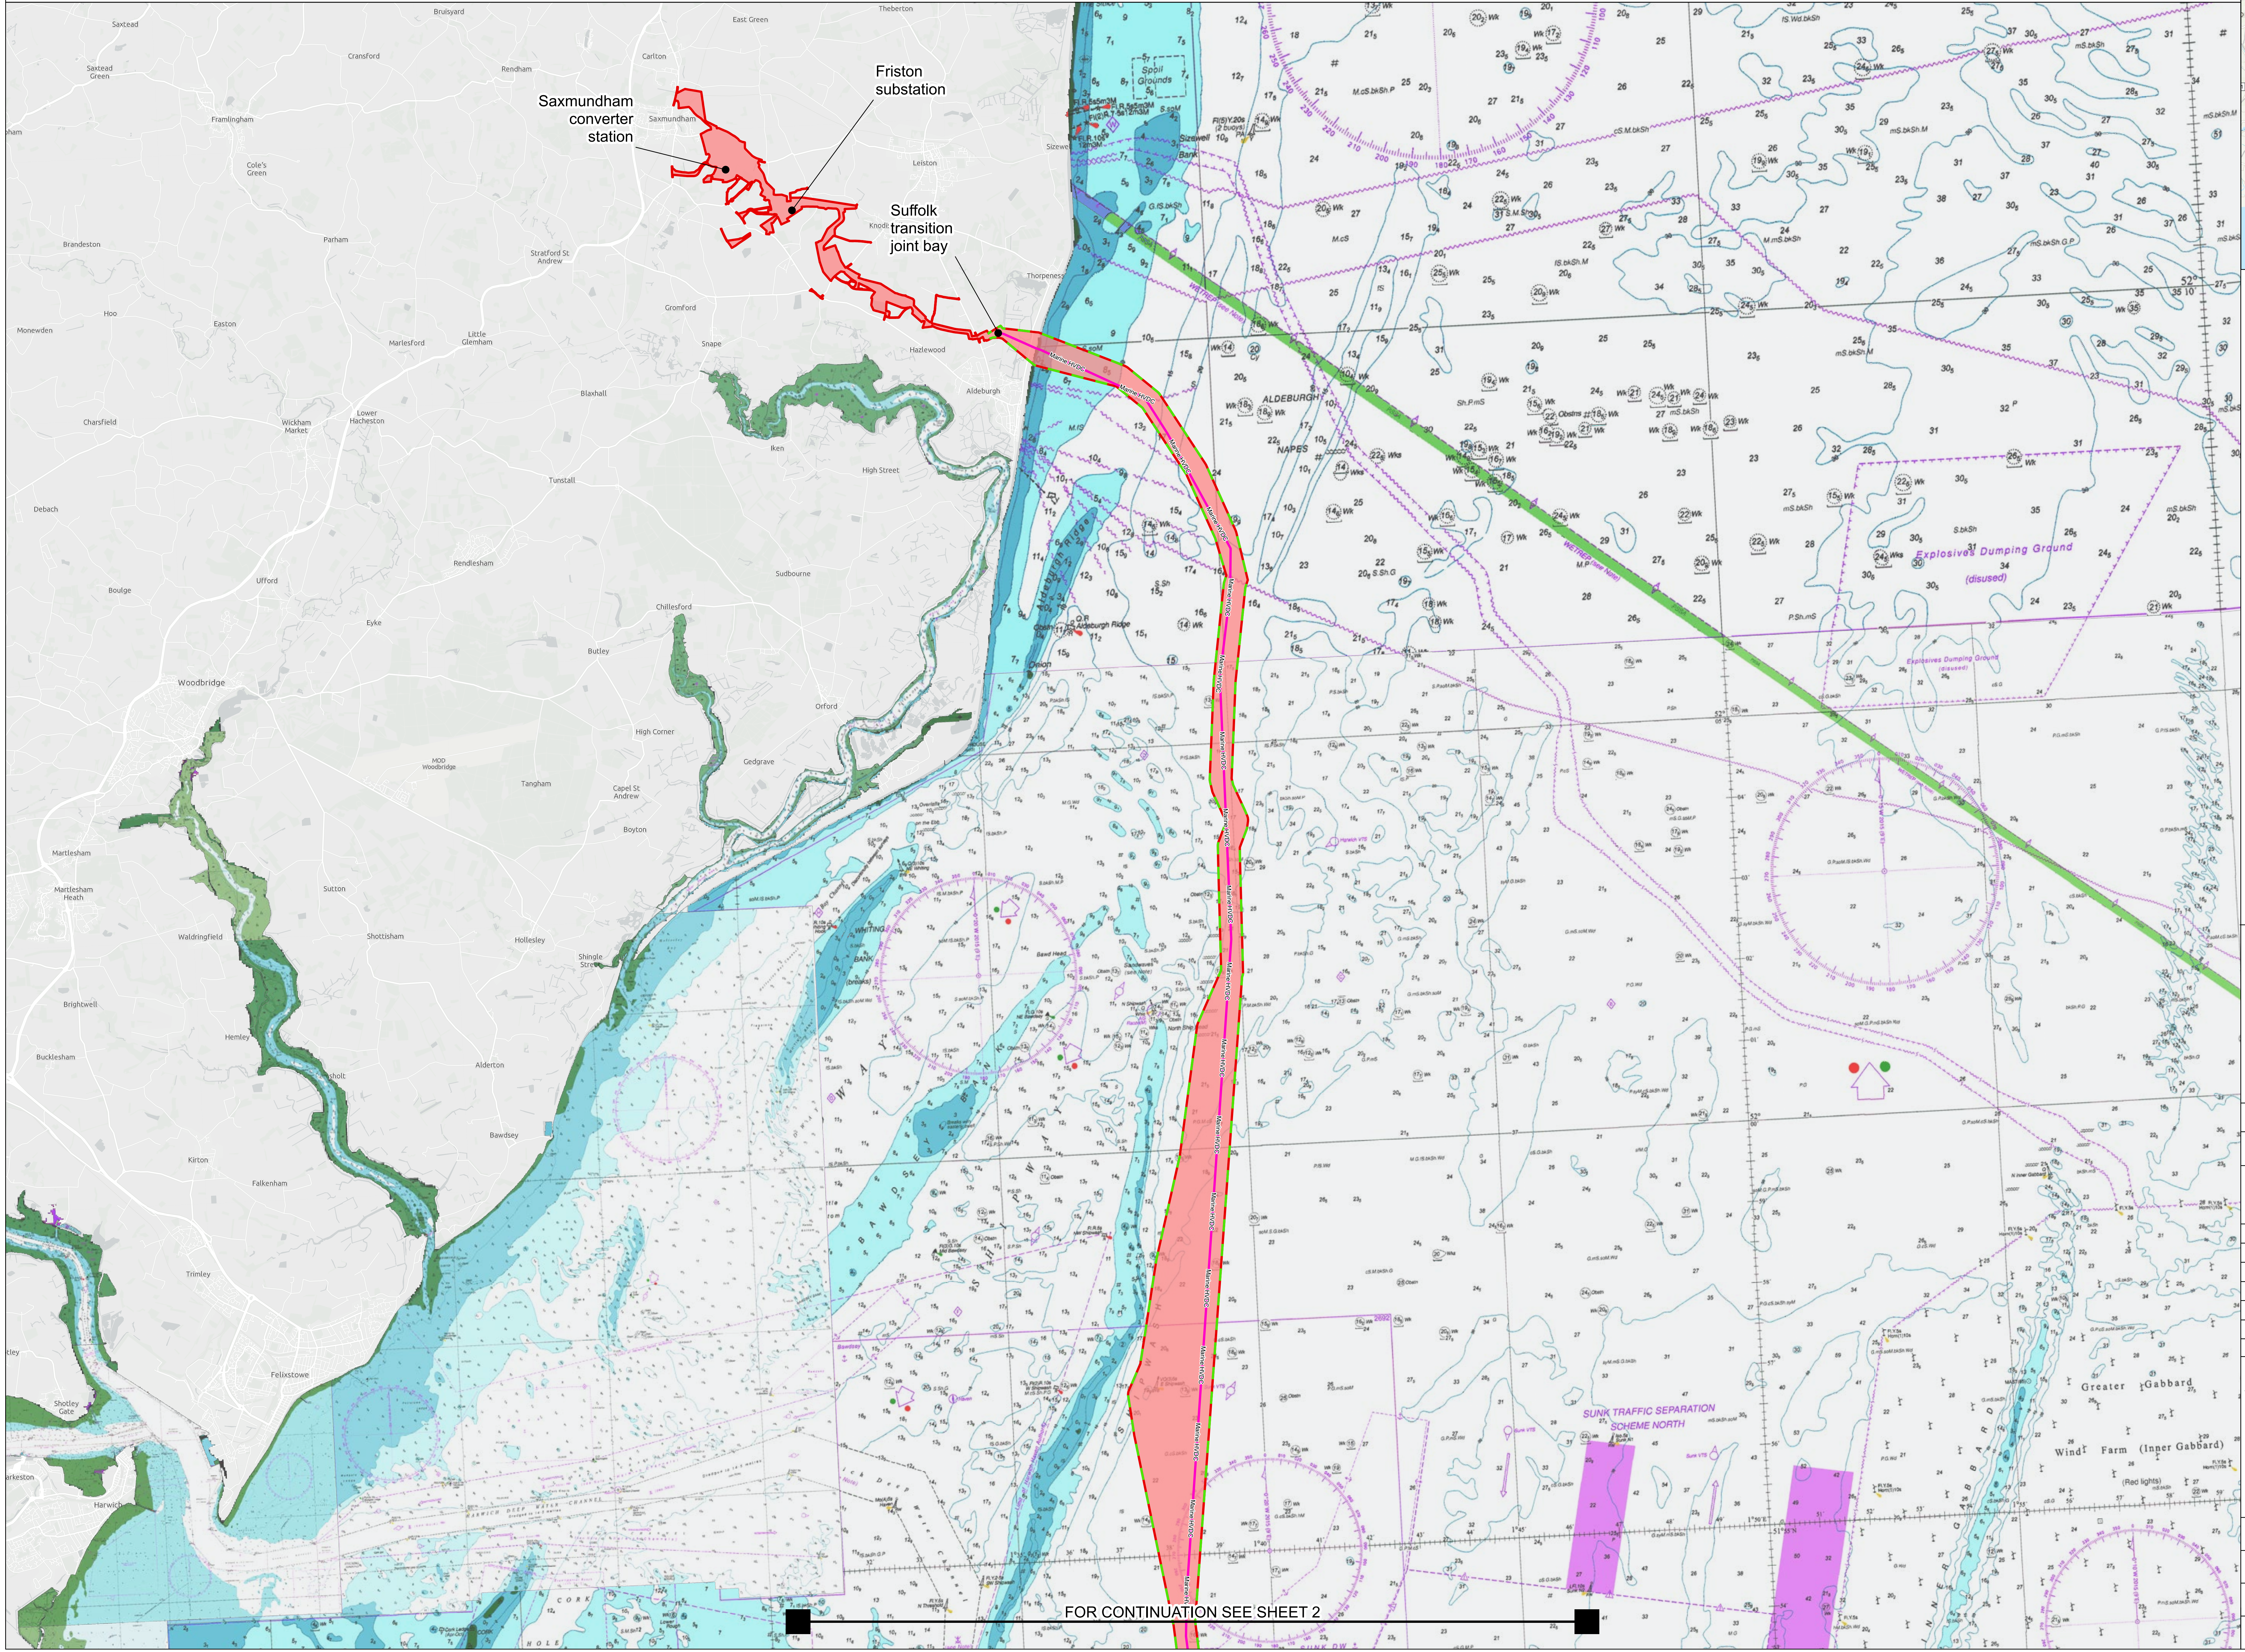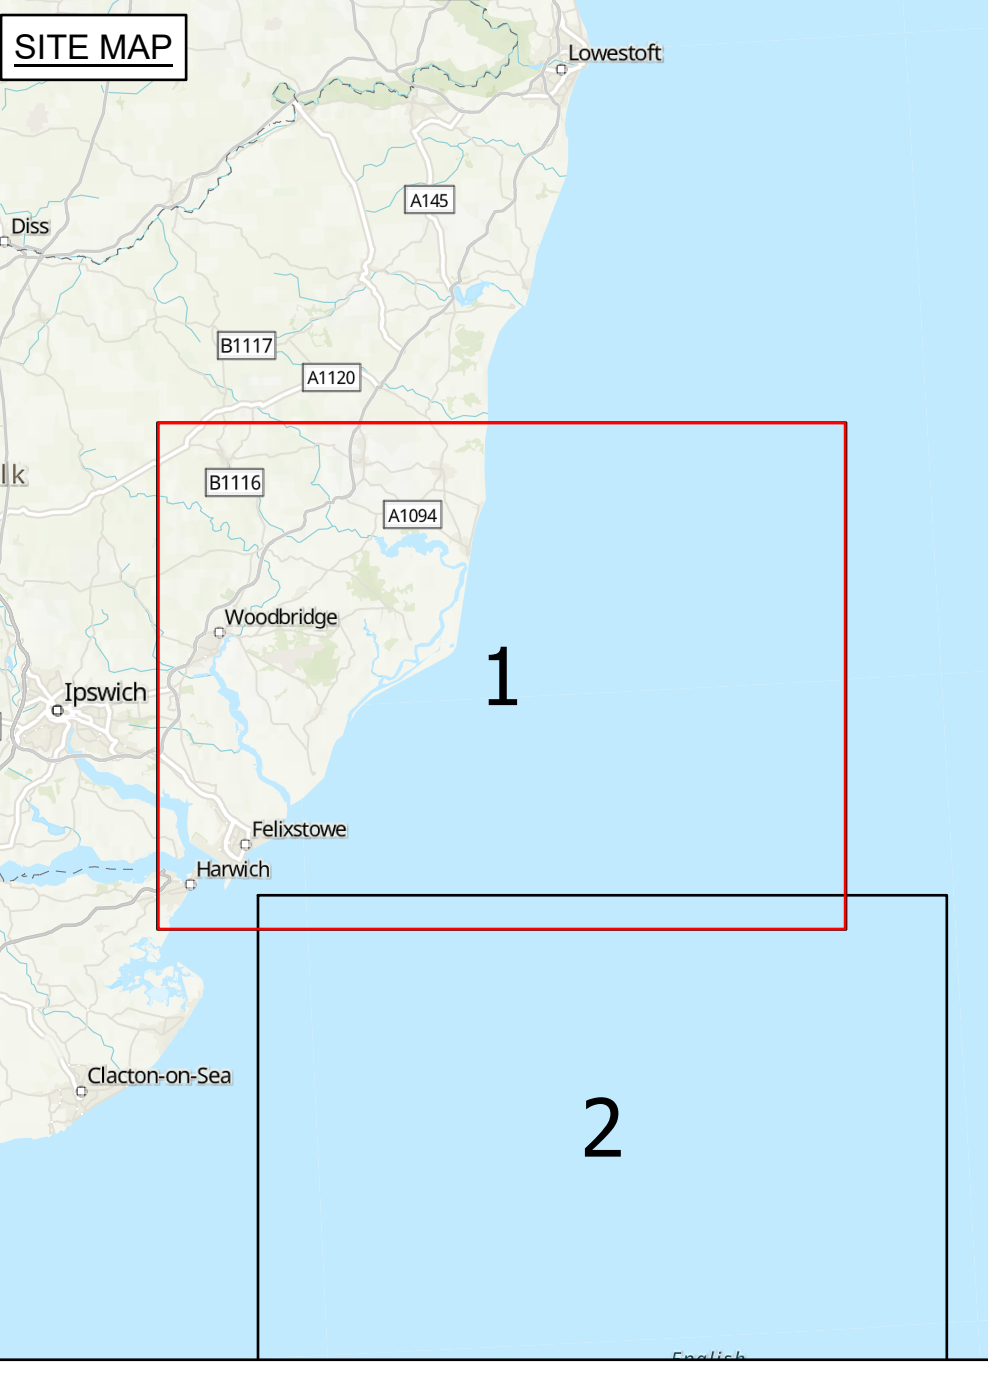

Legend

- ▭ Draft Order Limits
- ▭ Marine Limit of Deviation (LoD)
- ▭ Proposed marine High Voltage Direct Current (HVDC) cable alignment

Notes
For statutory consultation purposes only.

- This plan is scaled at paper size A0, therefore any prints taken at smaller sizes will affect accuracy of the measurement units and should not be scaled against.
- These plans show the Draft Order Limits and cable alignment and potential pylon locations. Due to the need for future flexibility, National Grid will be applying for Order Limits and Limits of Deviation within its Development Consent Order, within which any final alignment (including pylon locations) would lie. Therefore the cable alignment and pylon locations should be treated as indicative only. Further information is provided in our 'Guide to interacting with our consultation plans' document.
- For further information on construction please refer to the construction section of the Preliminary Environmental Impact Report, Volume 1, Part 1, Chapter 4.

Coordinate System: British National Grid
 Sheet X Centroid Coordinate: 648898.25 Sheet Y Centroid Coordinate: 247191.859376



BACKGROUND MAPPING INFORMATION HAS BEEN REPRODUCED FROM THE UK HYDROGRAPHIC OFFICE
 © BRITISH CROWN AND OCEANWISE, 2023. ALL RIGHTS RESERVED. LICENSE NUMBER EMIS-EX01-882114. NOT TO BE USED FOR NAVIGATION.
 © NATIONAL GRID ELECTRICITY

Issue	Date	Remarks	Drawn	Checked	Approved
A	29/08/23	Final	JF	SC	KJ

THE NATIONAL GRID ELECTRICITY TRANSMISSION PLC (SEA LINK) ORDER
 GENERAL ARRANGEMENT PLAN SERIES FOR CONSULTATION
 SHEET 1 OF 3
 MARINE





Application Number: EN020026
 National Grid Drawing Reference: S42_MIGA/PS/1001

Scale	Sheet Size	Sheet	Issue
1:50,000	A0	SHEET 1 OF 3	A

FOR CONTINUATION SEE SHEET 2


THE NATIONAL GRID ELECTRICITY TRANSMISSION PLC (SEA LINK) ORDER
 GENERAL ARRANGEMENT PLAN SERIES FOR CONSULTATION
 SHEET 2 OF 3
 MARINE

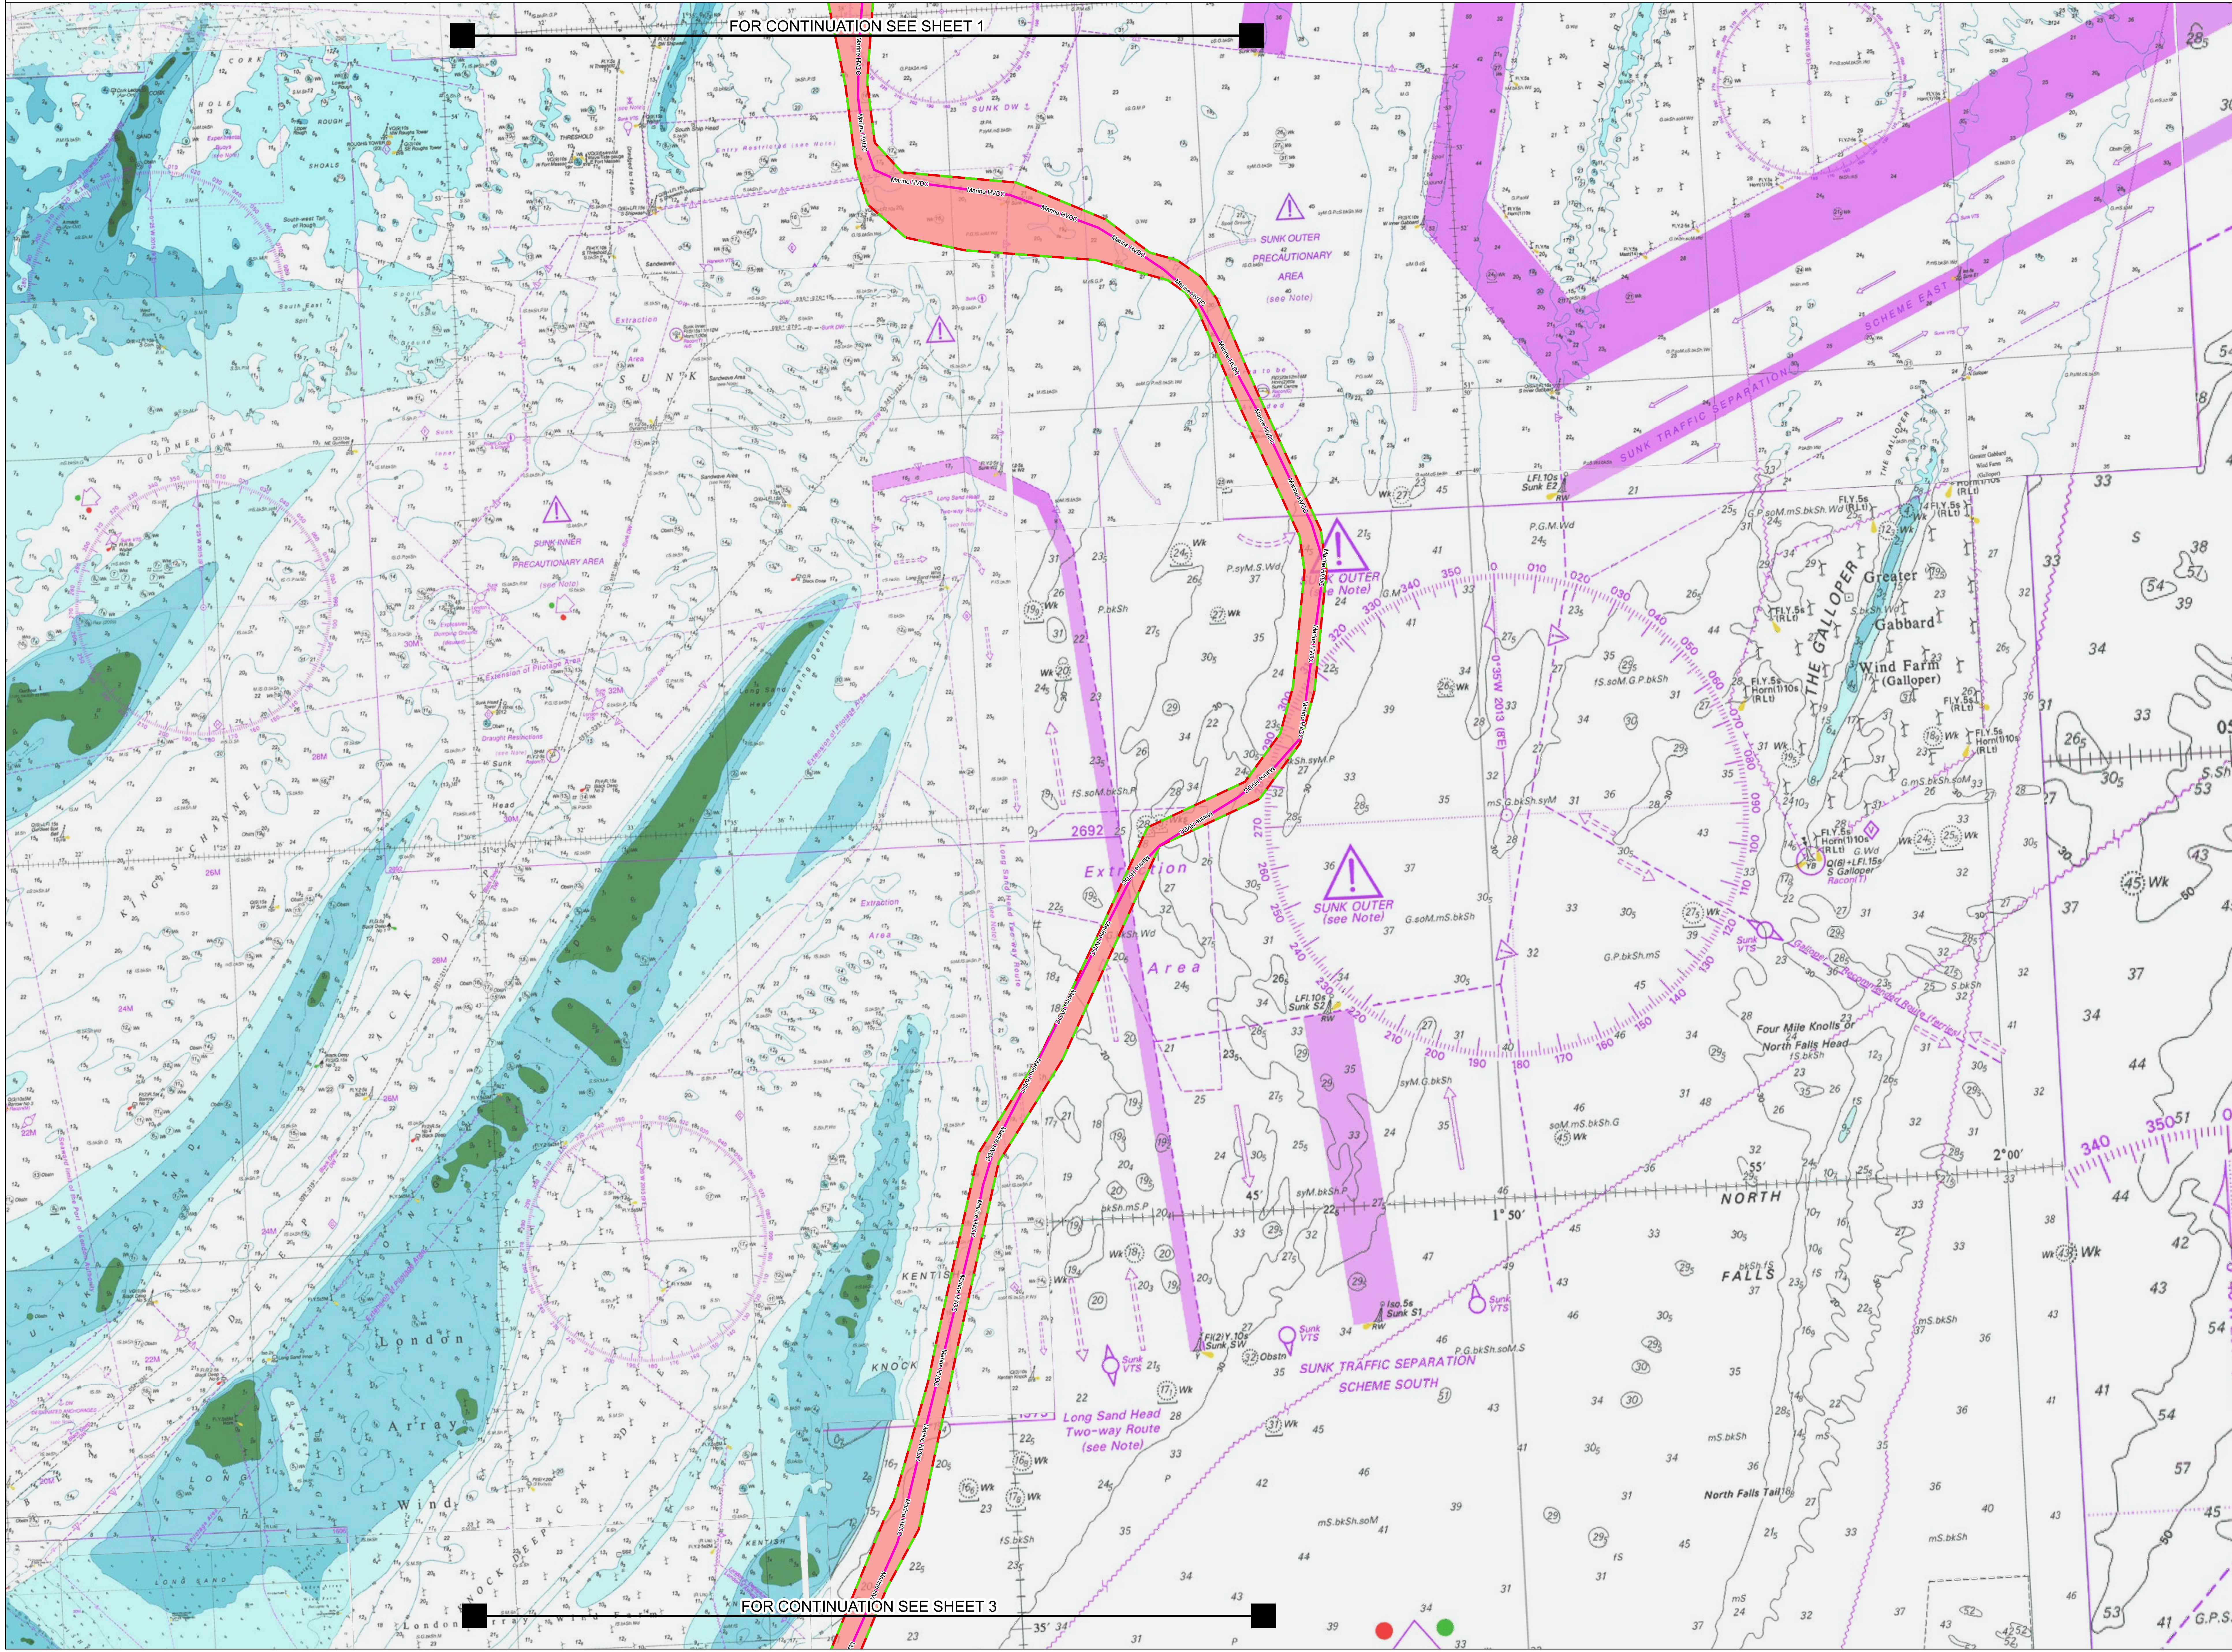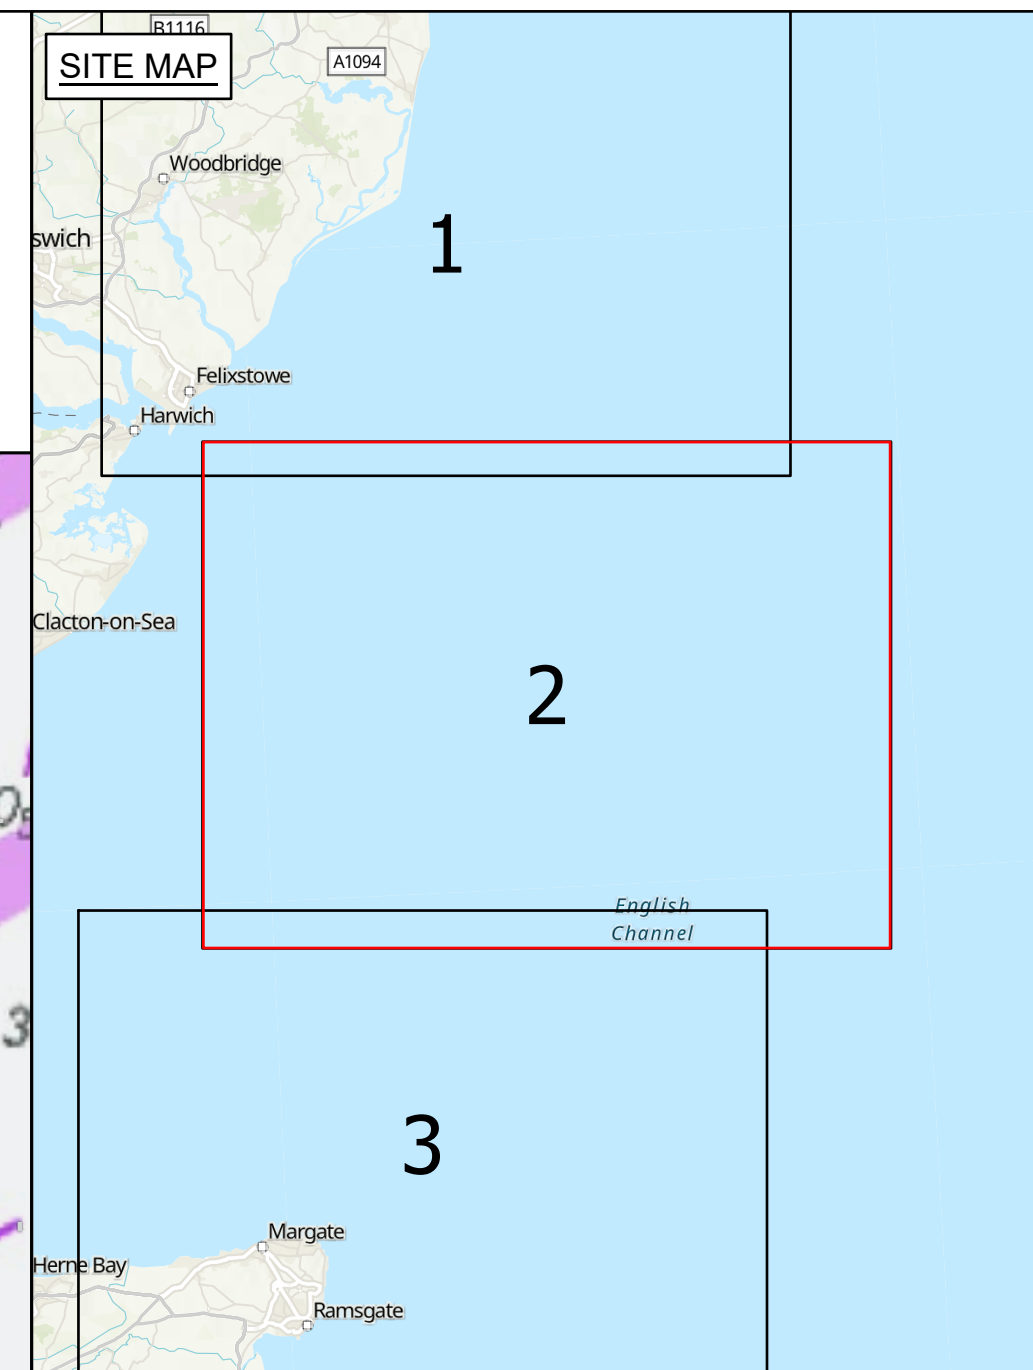

- Legend**
- Draft Order Limits
 - Marine Limit of Deviation (LoD)
 - Proposed marine High Voltage Direct Current (HVDC) cable alignment

Notes
For statutory consultation purposes only.

- This plan is scaled at paper size A0, therefore any prints taken at smaller sizes will affect accuracy of the measurement units and should not be scaled against.
- These plans show the Draft Order Limits and cable alignment and potential pylon locations. Due to the need for future flexibility, National Grid will be applying for Order Limits and Limits of Deviation within its Development Consent Order, within which any final alignment (including pylon locations) would lie. Therefore the cable alignment and pylon locations should be treated as indicative only. Further information is provided in our 'Guide to interacting with our consultation plans' document.
- For further information on construction please refer to the construction section of the Preliminary Environmental Impact Report, Volume 1, Part 1, Chapter 4.

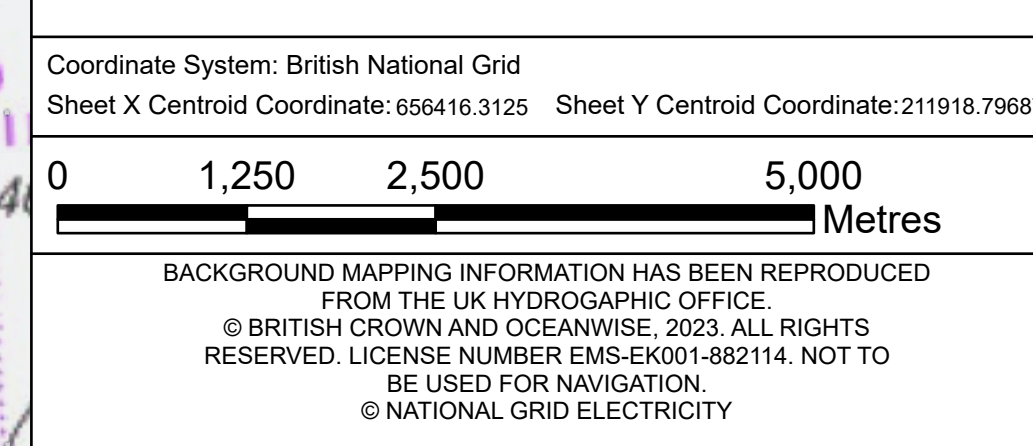


Issue	Date	Remarks	Drawn	Checked	Approved
A	29/08/23	Final	JF	SC	KJ


THE NATIONAL GRID ELECTRICITY TRANSMISSION PLC
 (SEA LINK) ORDER
 GENERAL ARRANGEMENT PLAN SERIES
 FOR CONSULTATION
 SHEET 2 OF 3
 MARINE

nationalgrid

Application Number	EN020026		
National Grid Drawing Reference	S42_MIGA/PS/1002		
Scale	Sheet Size	Sheet	Issue
1:50,000	A0	SHEET 2 OF 3	A

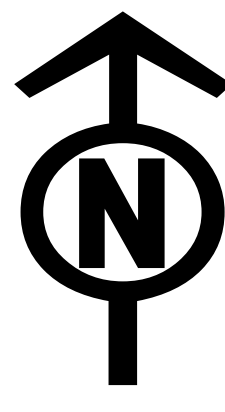

THE NATIONAL GRID ELECTRICITY TRANSMISSION PLC (SEA LINK) ORDER
 GENERAL ARRANGEMENT PLAN SERIES FOR CONSULTATION
 SHEET 3 OF 3
 MARINE
 KENT COUNTY COUNCIL, DOVER DISTRICT COUNCIL, THANET DISTRICT COUNCIL

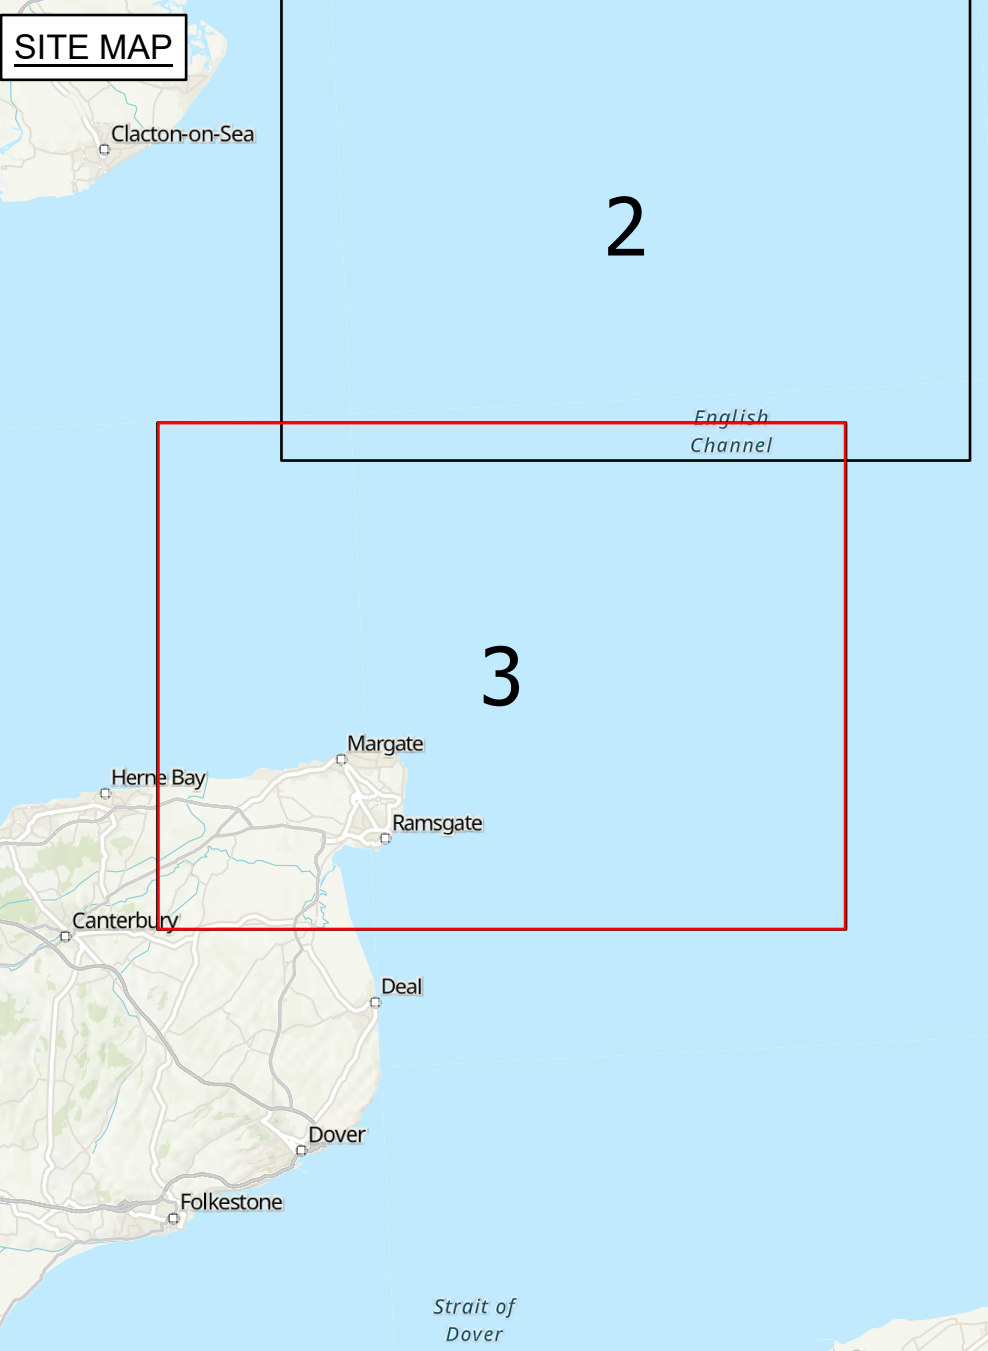

FOR CONTINUATION SEE SHEET 2


Legend

- Draft Order Limits
- Marine Limit of Deviation (LoD)
- Proposed marine High Voltage Direct Current (HVDC) cable alignment

Notes
For statutory consultation purposes only.

- This plan is scaled at paper size A0, therefore any prints taken at smaller sizes will affect accuracy of the measurement units and should not be scaled against.
- These plans show the Draft Order Limits and cable alignment and potential pylon locations. Due to the need for future flexibility, National Grid will be applying for Order Limits and Limits of Deviation within its Development Consent Order, within which any final alignment (including pylon locations) would lie. Therefore the cable alignment and pylon locations should be treated as indicative only. Further information is provided in our 'Guide to interacting with our consultation plans' document.
- For further information on construction please refer to the construction section of the Preliminary Environmental Impact Report, Volume 1, Part 1, Chapter 4.

Coordinate System: British National Grid
 Sheet X Centroid Coordinate: 647163.3125 Sheet Y Centroid Coordinate: 176934.84375

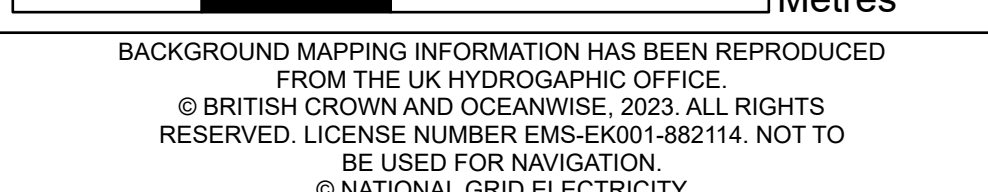

BACKGROUND MAPPING INFORMATION HAS BEEN REPRODUCED FROM THE UK HYDROGRAPHIC OFFICE
 © BRITISH CROWN AND OCEANWISE, 2023. ALL RIGHTS RESERVED. LICENSE NUMBER EMS-EK01-882114. NOT TO BE USED FOR NAVIGATION.
 © NATIONAL GRID ELECTRICITY

Issue	Date	Remarks	Drawn	Checked	Approved
A	29/08/23	Final	JF	SC	KJ

THE NATIONAL GRID ELECTRICITY TRANSMISSION PLC (SEA LINK) ORDER
 GENERAL ARRANGEMENT PLAN SERIES FOR CONSULTATION
 SHEET 3 OF 3
 MARINE



Application Number	EN020026		
National Grid Drawing Reference	S42_MIGA/PS/1003		
Scale	Sheet Size	Sheet	Issue
1:50,000	A0	SHEET 3 OF 3	A