




OUTLINE TREE REMOVAL AND  
IMPACT PLAN FOR PEIR

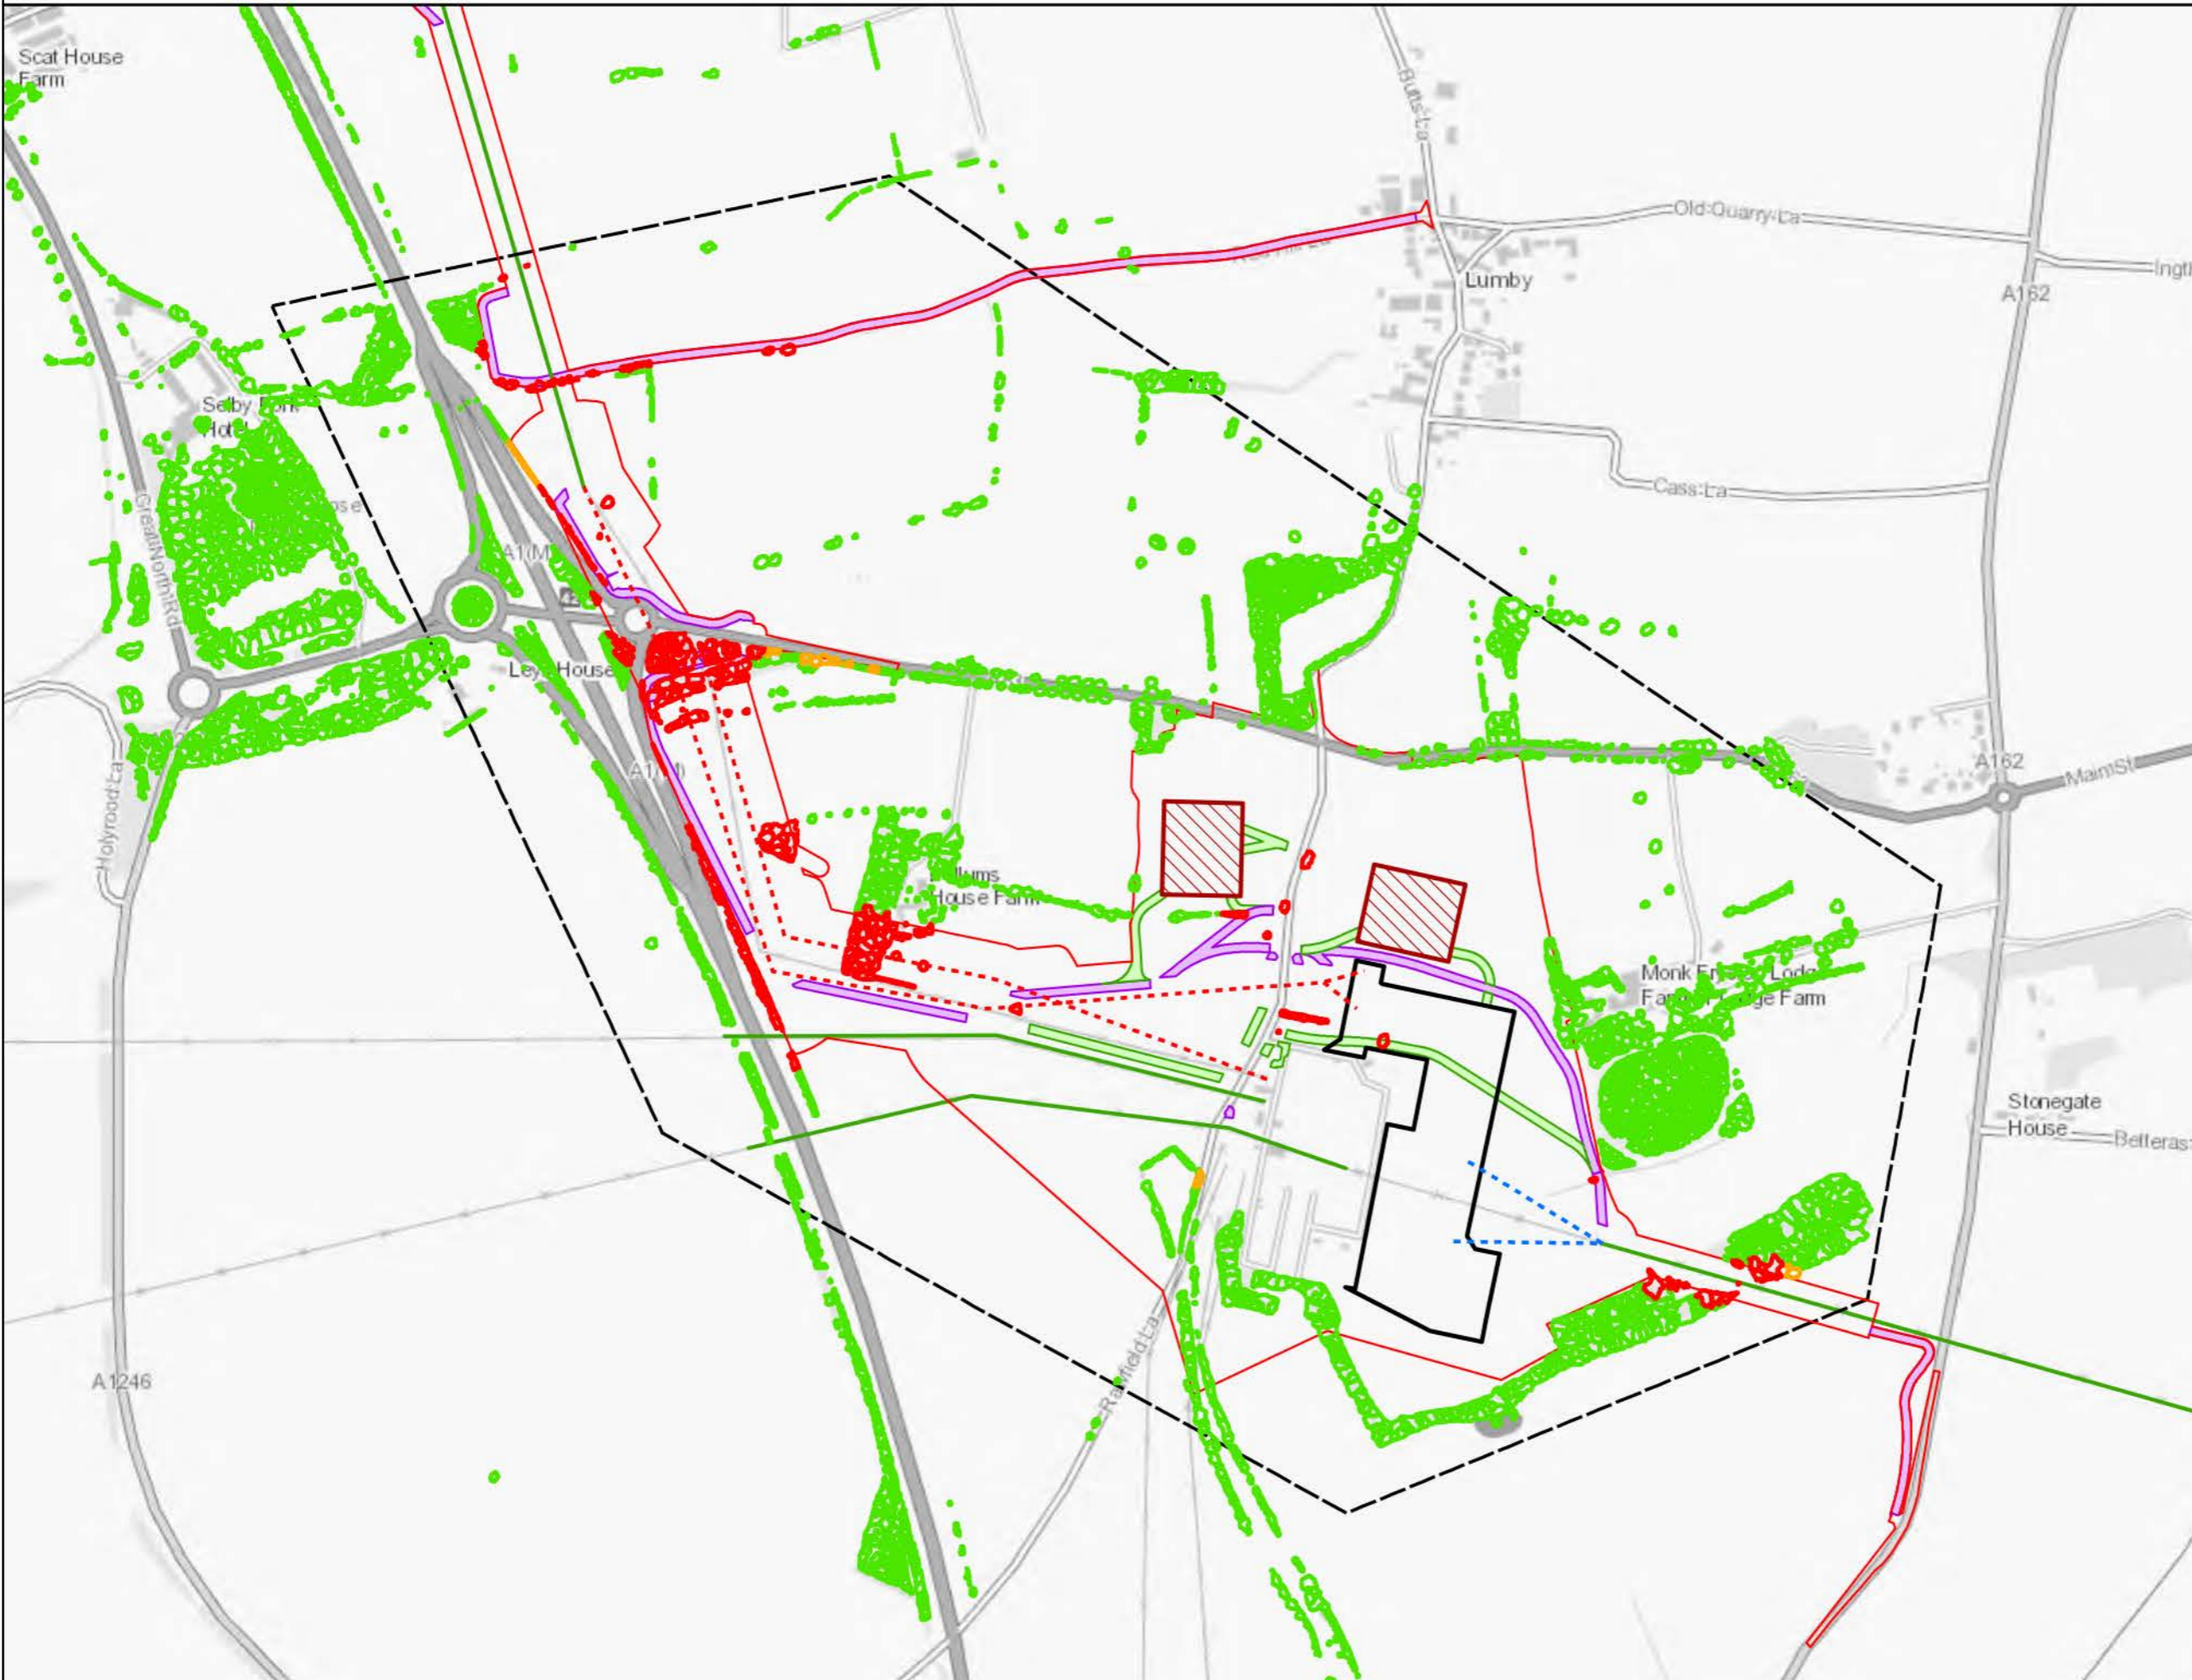


**Legend**

- Draft Order Limits
- 275kV OHL
- 400kV OHL
- Existing OHL
- Substation
- Construction compound
- CESC area
- Indicative accesses**
- Permanent
- Temporary
- Arboricultural study area
- Trees likely to be removed
- Potentially removed or impacted trees
- Retained trees

**Notes**  
This drawing is scaled at paper size A3, therefore any prints taken at smaller sizes will affect accuracy of the measurement units and should not be scaled against.



Coordinate System: British National Grid  
Sheet X Centroid Coordinate: 448,163.37 Sheet Y Centroid Coordinate: 429,570.27



BACKGROUND MAPPING INFORMATION HAS BEEN REPRODUCED FROM THE ORDNANCE SURVEY BY PERMISSION OF ORDNANCE SURVEY OF THE CONTROLLER OF HER MAJESTY'S STATIONERY OFFICE. © CROWN COPYRIGHT ORDNANCE SURVEY. NATIONAL GRID ELECTRICITY - 100024241. NATIONAL GRID GAS - 100024886.

1	SEP 21		COLLJ	DIMMR	CHADC
Issue	Date	Remarks	Drawn	Checked	Approved

Title  
**PRELIMINARY ENVIRONMENTAL  
INFORMATION REPORT  
TREE LOSS / IMPACT ASSESSMENT  
FOR PEIR  
OUTLINE TREE REMOVAL AND  
IMPACT PLAN FOR PEIR**

Figure Number	FIGURE 1.4		
Drawing Reference	806503-WOOD-0133		
Scale	Sheet Size	Sheet	Issue
1:9,000	A3	SHEET 4 OF 4	1