


LANDSCAPING AT THE PROPOSED MONK FRYSTON SUBSTATION

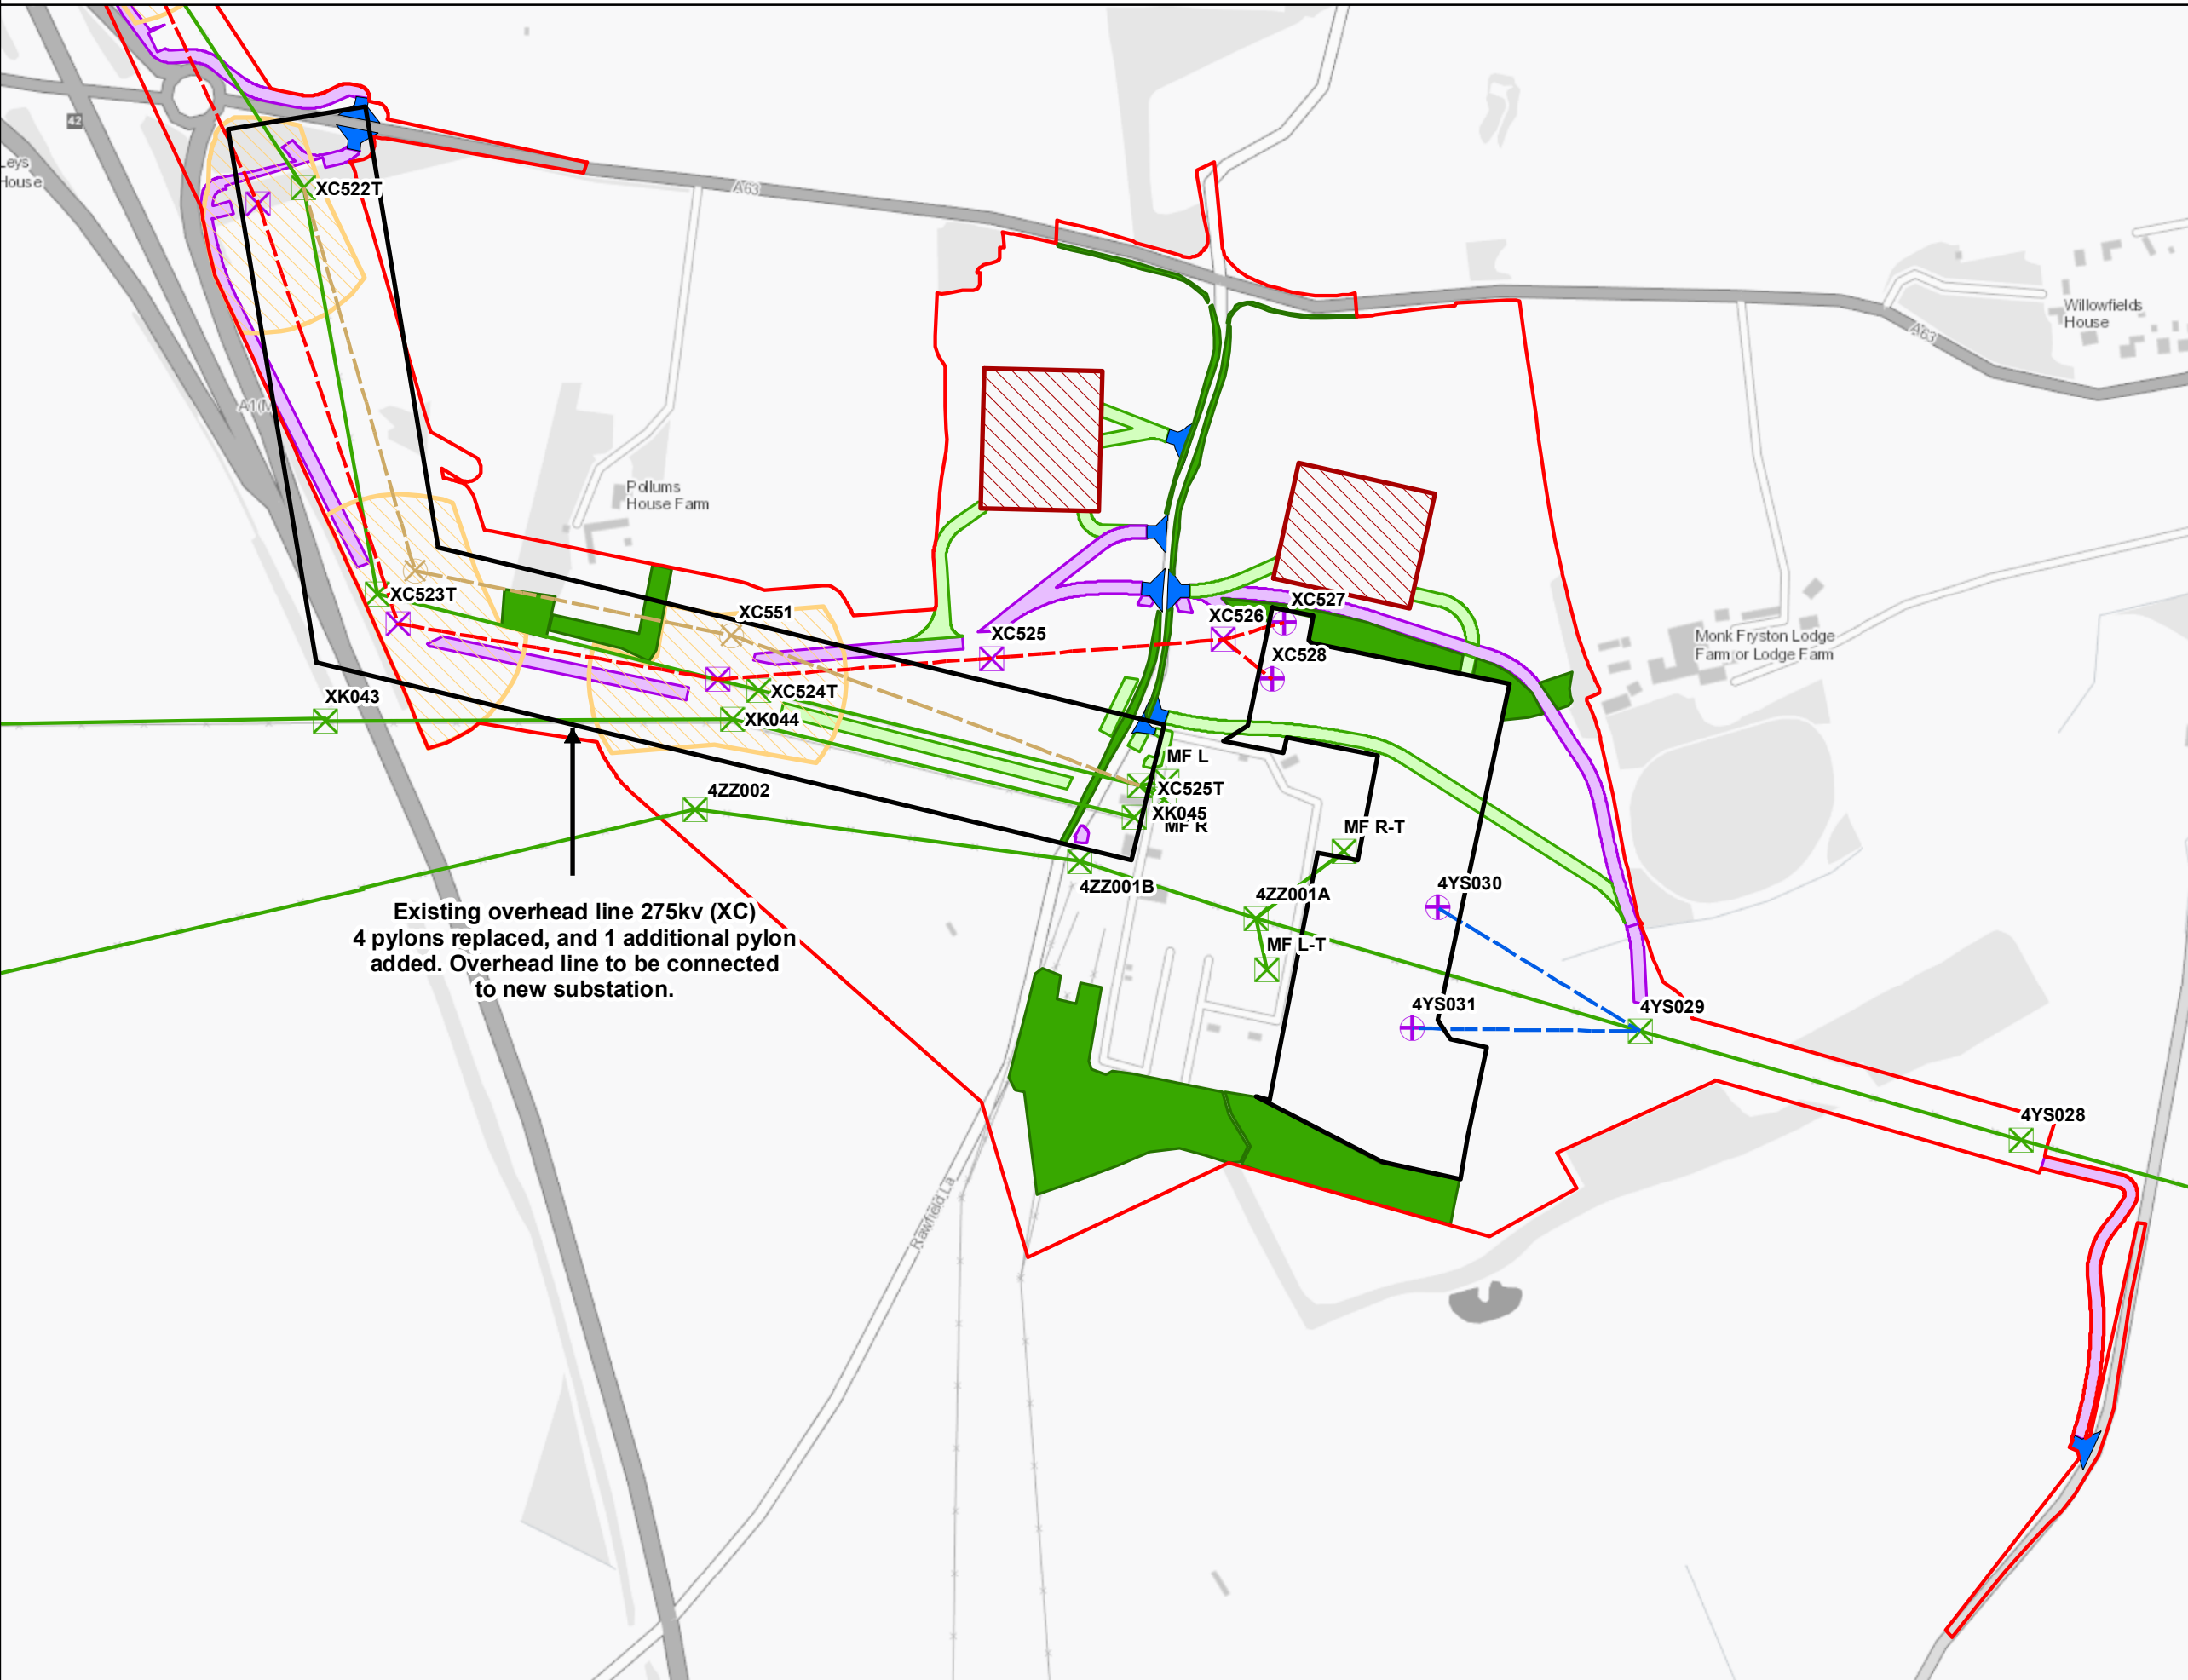


Existing overhead line 275kv (XC)
4 pylons replaced, and 1 additional pylon
added. Overhead line to be connected
to new substation.


Legend

- Draft Order Limits
- Proposed Monk Fyston Substation boundary
- Proposed 275kV Overhead Line
- Proposed 400kV Overhead Line
- Temporary Overhead Line
- Existing Overhead Line
- Proposed new pylons
- Proposed new gantry
- Proposed temporary structures
- Existing pylons
- Indicative construction compounds
- Indicative stringing area
- Proposed landscaping
- Bellmouths
- Indicative accesses
- Permanent
- Temporary

Notes
This drawing is scaled at paper size A3, therefore any prints taken at smaller sizes will affect accuracy of the measurement units and should not be scaled against.

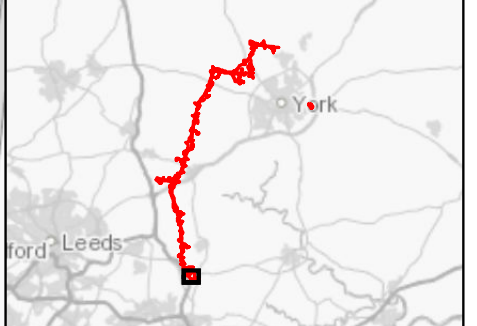

Coordinate System: British National Grid
Sheet X Centroid Coordinate: 448,354.99 Sheet Y Centroid Coordinate: 429,187.36



BACKGROUND MAPPING INFORMATION HAS BEEN REPRODUCED FROM THE ORDNANCE SURVEY BY PERMISSION OF ORDNANCE SURVEY OF THE CONTROLLER OF HER MAJESTY'S STATIONERY OFFICE. © CROWN COPYRIGHT ORDNANCE SURVEY. NATIONAL GRID ELECTRICITY - 100024241. NATIONAL GRID GAS - 100024886.

1	OCT 21		COLLJ	DIMMR	CHADC
Issue	Date	Remarks	Drawn	Checked	Approved

Title

PRELIMINARY ENVIRONMENTAL
INFORMATION REPORT
CHAPTER 3
LANDSCAPING AT THE PROPOSED
MONK FRYSTON SUBSTATION



Figure Number	FIGURE 3.8		
Drawing Reference	806503-WOOD-0154		
Scale	Sheet Size	Sheet	Issue
1:6,000	A3	SHEET 1 OF 1	1